

7 January 2025

Jonathan Mullen
Planning Director
Town of Waterford
15 Rope Ferry Road
Waterford, CT 06385

**RE: Stormwater Management Report
Oswegatchie Fire Station
441 Boston Post Road
Waterford, Connecticut
Langan Project No.: 140286501**

Dear Mr. Mullen,

This report provides an analysis of the proposed peak runoff discharges and the engineering design for the proposed stormwater conveyance system at 441 Boston Post Road.

PROJECT DESCRIPTION

Existing Conditions

The project site is located at 441 Boston Post Road in Waterford CT; see Figure 1. The overall approximately 2.0-acre parcel is currently occupied by the existing Oswegatchie Fire Station, including impervious and grass areas. The parcel is located within the Niantic River sub regional drainage basin. The parcel area does not contain any known locations of State and Federal Listed Species and Critical Habitats per the CT Natural Diversity Data Base Areas map of Waterford, CT dated June 2024. The project site is located on the western part of the parcel within the limits of the existing fire station site. To the west the project site is bordered by a garden shop. To the south, the project site is bordered by Boston Post Road. To the east the project site is bordered by residential properties on Boston Post Road. To the north the site is bordered by lightly wooded wetland areas. The existing project site is mostly impervious areas with the majority of stormwater running overland towards the wetlands in the north.

Based upon a topographic survey prepared by Langan, dated June 28, 2024, the site grades slope downward from the southern corner of the property towards the northern property line, with elevations ranging from approximately 35 feet to about 30 feet.

According to the Federal Emergency Management Agency (FEMA) Flood Insurance Study of the town of Waterford, Connecticut map number 09011C0481J with an effective date of August 5, 2013, the proposed development is located within Zone X (Unshaded). Zone X (Unshaded) is considered a Low-Risk Area and described by FEMA as areas outside the 0.2-percent-annual-chance chance flood. No base flood elevations or base flood depths are shown within these zones.

According to the USDA Natural Resources Conservation Service Web Soil Survey, the site's soil type varies throughout. The site is mostly classified as Hinckley Loamy Sand with an A hydrologic rating and slopes between 3 and 15 percent. Additionally, the eastern corner of the site is classified as Walpole Sandy Loam with a D hydrologic rating and slopes between 0 and 3 percent.

There are wetland areas to the east and north of the site. While some of the site work is proposed within the 100-foot upland review area, no direct wetland impacts are proposed.

Proposed Project

The proposed project consists of the demolition of the existing fire station and the construction of a new fire station building with new landscaped areas, driveways, and parking areas. Additional improvements include new stormwater and utility infrastructure. A summary of the change in impervious is shown below.

Project Site Impervious Cover [SF]

Existing Conditions	Proposed Conditions	Net Decrease
±52,200	±31,500	±20,700

The proposed stormwater system has been designed to maintain existing site hydrology to the maximum extent practicable. The majority of runoff from the new development will be conveyed to various stormwater management systems before discharging to either the existing stormwater network in Boston Post Road or overland towards the existing offsite wetlands. Water quality improvements include yard drains with sumps, a pretreatment swale and a rain garden. These water quality improvements have been designed to retain 100% of the proposed project's water quality volume onsite. This achieves the average annual pollutant load reduction requirements as per the recommendations of the 2024 CT Stormwater Quality Manual.

Details of the size and location of the stormwater network can be found on the Grading &

Drainage Plans, detail sheets and supporting calculations in the appendices of this report.

PEAK RUNOFF ANALYSIS (See Appendices A & B)

The stormwater management system is designed to control the rate of runoff from the site's watersheds to be equal or less than existing conditions up to, and including, a 100-year design storm event.


The peak runoff discharges for the existing and proposed conditions were analyzed using Soil Conservation Service (SCS) methodology which outlines procedures for calculating peak rates of runoff resulting from precipitation events as well as procedures for developing runoff hydrographs. The entire site was included in the analysis; see Figures EXWS and PRWS. Values for area, curve number (CN), and a time of concentration were calculated for the existing and proposed conditions.

The curve number is a land sensitive coefficient that dictates the relationship between total rainfall depth and direct storm runoff. The soils within the watershed are divided into hydrologic soil groups (A, B, C, and D). The SCS classification system evaluates the runoff potential of a soil according to its infiltration and transmission rates. "A" soils have the lowest runoff potential, while "D" soils have the greatest runoff potential.

The time of concentration (T_c) is defined as the time for runoff to travel from the hydraulically most distant point in the watershed to a point of interest. Values of time of concentration were determined for existing and proposed conditions based on land cover and slope of the flow path using methods outlined in TR-55.

For this study, a 24-hour SCS Type III standard rainfall distribution was used to determine the peak flow rate and volume to all points of discharge from the site. Precipitation data used for the various storm events is based on the "NOAA Atlas 14 Point Precipitation Frequency Estimates: CT" for Lake Konomoc Station. Lake Konomoc Station was chosen for rainfall data because it is the station located within the closest proximity of the project location as shown in Graphic 1. A summary of all rainfall data utilized in the analysis for this site is provided below and a complete compilation of data provided by NOAA for this location is included in Appendix C.

Graphic 1. NOAA Rainfall Data Location Map

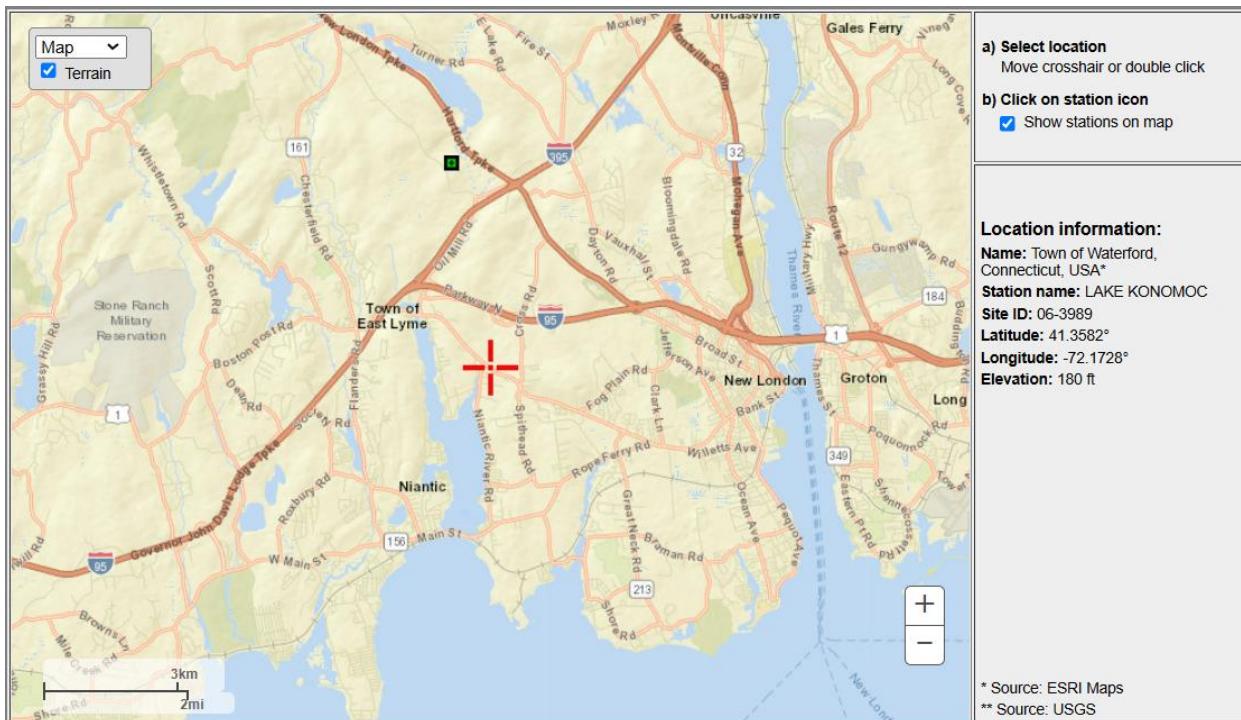

NOAA Precipitation Depth per Average Recurrence Interval [in]

Duration	2-Year	10-Year	25-Year	100-Year
24-hour	3.45	5.13	6.17	7.79

Existing Condition (See Appendix A)

The project area's existing drainage conditions were analyzed as Watersheds A, B, and C (See Drawing EXWS).

Existing Watershed A is approximately 0.26 acres and comprises grassy areas, driveway aprons onto the site and the southwestern portion of the existing building. Stormwater runoff from this watershed either flows into the existing storm drainage network or overland and offsite towards Boston Post Road.

Existing Watershed B is approximately 0.08 acres and consists of grass and brush areas at the east of the site. Stormwater runoff from this watershed flows overland to the wetlands #2 to the east of the site.

Existing Watershed C is about 1.27 acres and consists of the existing building and parking areas along with grassy and brush areas. Stormwater runoff from this watershed flows overland to the wetlands #1 offsite to the north.

Proposed Condition (See Appendix B)

In the proposed condition, site hydrology attempts to mimic existing conditions and all watershed outlets remain the same.

Proposed Watershed A is about 0.37 acres and consists of grassy areas and the proposed driveway aprons. Stormwater will continue to flow overland to Boston Post Road. The proposed site within this watershed has been designed to significantly reduce impervious area as compared with the existing condition.

Proposed Watershed B is about 0.09 acres and includes grass and brush areas to the east of the site. This watershed will remain generally unchanged, and stormwater collected within this watershed will flow overland to the wetlands #2 offsite to the east.

Proposed Watershed C is divided into two sub-watersheds: Sub-watershed C1 and Sub-watershed C2. Sub-watershed C1 is about 1.04 acres and consists of the proposed building and parking areas along with grassy areas; stormwater within this watershed will flow either through a pretreatment swale conveyance feature or directly into a rain garden before flowing to the wetlands #2 offsite to the north. Sub-watershed C2 is about 0.12 acres and consists of grassy and brush areas; stormwater within this watershed will continue to flow overland to the wetlands #2 offsite to the north.

Details of the sizes and locations of the stormwater collection systems can be found on drawings CG101. A conservative design infiltration rate for the rain garden is 1 inch per hour. The design infiltration rate will be confirmed with on-site testing prior to construction. Please refer to Appendix F for boring log data within the vicinity of the proposed rain garden. This testing was performed by Barton & Loguidice as a part of a Limited Phase II Environmental Site Assessment report, dated 08/27/2024. According to the boring log data, groundwater was encountered between 6' and 13' below existing grade, and existing site soils within the rain gardens consist of a mainly sandy material.

Site Discharge Peak Flow Comparison for WS-A (CF)

Storm	Current	Proposed	Delta	% Reduction
2-Year	0.37	0.09	-0.28	75.68%
10-Year	0.77	0.44	-0.33	42.86%
25-Year	1.04	0.71	-0.33	31.73%
100-Year	1.46	1.20	-0.26	17.81%

Site Discharge Peak Flow Comparison for WS-B (CF)

Storm	Current	Proposed	Delta	% Reduction
2-Year	0.02	0.01	-0.01	50.00%
10-Year	0.09	0.09	0.00	0.00%
25-Year	0.15	0.19	0.00	0.00%
100-Year	0.26	0.26	0.00	0.00%

Site Discharge Peak Flow Comparison for WS-C (CF)

Storm	Current	Proposed	Delta	% Reduction
2-Year	3.77	0.32	-3.45	91.51%
10-Year	5.91	2.04	-3.87	65.48%
25-Year	7.22	3.73	-3.49	48.34%
100-Year	9.24	5.62	-3.62	39.18%

Site Discharge Peak Flow Comparison for Total Site (CF)

Storm	Current	Proposed	Delta	% Reduction
2-Year	4.15	0.38	-3.77	90.84%
10-Year	6.76	2.39	-4.37	64.65%
25-Year	8.39	4.44	-3.95	47.08%
100-Year	10.95	6.93	-4.02	36.71%

As can be seen from the tables above, runoff from each watershed and the total site will be attenuated for the storms up to and including the 100-year storm. Additionally, per the 2024 CT Stormwater Quality Manual requirements, runoff from each watershed that includes proposed site development will be attenuated by 50% for the 2-year storm event.

STORMWATER CONVEYANCE SYSTEM (See Appendix D)

The stormwater conveyance system was sized using the Rational Method for the 10-year storm event as per the CTDEEP Stormwater Quality Manual. Values for area, runoff coefficient, C, and

a time of concentration were calculated for each drainage area. The average runoff coefficient was calculated based upon the following cover types:

<u>Cover</u>	<u>C</u>
Grass/Pervious	0.3
Roof/Pavement/Impervious	0.9

Rainfall intensities were taken from the "NOAA Atlas 14 Point Precipitation Frequency Estimates: CT" for Lake Konomoc. Stormwater pipes were then sized based upon the Manning's Equation for full flow pipe capacity and solving for the hydraulic grade line. The computer program Hydraflow Storm Sewers 2011 by Intellisolve was used in the analysis.

Each proposed storm sewer system has been analyzed sing a starting HGL elevation equal to the outlet pipe's crown elevation. This mimics a tailwater elevation equal to the outlet pipe's diameter or a scenario where a proposed pipe is entering an existing pipe flow at full capacity.

STORMWATER QUALITY (See Appendix E)

The proposed stormwater management system has been designed to incorporate stormwater quality measures including a significant decrease in site imperviousness, yard drains with sumps, a pretreatment swale conveyance feature, and a rain garden. These measures will be implemented to increase water quality and minimize the passage of pollutants to the existing stormwater systems as compared to current conditions.

Under current conditions, the entirety of the site impervious cover ($\pm 52,200$ SF) is considered directly connected impervious area (DCIA). This project proposes to decrease DCIA by over 90%, which will decrease surface runoff and increase infiltration of rainfall into the soil.

Per Table 4.1 of the CT Stormwater Quality Manual, the site is considered a redevelopment with existing DCIA of 40% or more. As such, the Required Retention Volume (RRV) is 50% of the site's Water Quality Volume (WQV). Through coordination with the town of Waterford Environmental Planner, this project occurs within the Stony Brook watershed area. Stormwater discharge from the site contributes to an intermittent watercourse and wetland system located north of the parcel. The receiving portion of Stony Brook south of Route 1 has been designated as an impaired waterbody by CTDEEP. Because of this information, the stormwater system has

been designed to retain 100% of the site WQV and exceed the RRV requirements for our redevelopment site.

Table 4.3 of the CT Stormwater Quality Manual shows the minimum average annual pollutant load reductions for Total Suspended Solids (TSS), Total Phosphorus (TP) and Total Nitrogen (TN). Per the manual, “a proposed stormwater management system meets or exceeds these average pollutant load reductions when the RRV is retained on-site using suitable stormwater retention practices. Achieving these minimum required load reductions for sediment and nutrients is assumed to provide adequate reductions of other stormwater pollutants including floatable materials.” Through the use of the proposed rain garden, the stormwater system designed exceeds our RRV and will retain 100% of the WQV, thereby also exceeding the required average annual pollutant load reductions.

CONCLUSION

The proposed stormwater management system has been designed in general accordance with the 2024 CTDEEP Stormwater Quality Manual and the 2000 CTDOT Drainage Manual. It has been designed to maintain existing site hydrology to the maximum extent practicable with attenuated peak flows and multiple water quality improvements.

This Langan report shows that the proposed stormwater management system, as designed, will effectively manage quality and quantity of stormwater runoff for the proposed development. Please refer to the Drawings for additional drainage information.

Sincerely,
Langan CT, Inc.


Brian Phillips, P.E.
Senior Project Manager

LIST OF FIGURES

Fig. 1	Location Map
Fig. 2	FEMA Flood Map
Fig. 3	NRCS Soil Map

LIST OF DRAWINGS

EXWS	Existing Watershed Map
PRWS	Proposed Watershed Map
DACB	Drainage Area Catchment Basin Map

REFERENCE DRAWINGS

CG101	Grading & Drainage Plan
CG501	Grading & Drainage Details

LIST OF APPENDICES

Appendix A	Existing Stormwater Discharge Calculations
Appendix B	Proposed Stormwater Discharge Calculations
Appendix C	NOAA Rainfall Data
Appendix D	Stormwater Collection System Calculations
Appendix E	Supporting Calculations
Appendix F	Boring Logs (by others)
Appendix G	Stormwater Management System Operation and Maintenance Plan




Copyright © 2013 National Geographic Society, i-cubed; © 2013 National Geographic Society, i-cubed

LANGAN 300 Kimball Drive 4th Floor Parsippany NJ 07054-2172 T: 973-560-4900 F: 973-560-4901 www.langan.com	<p>Project Oswegatchie Fire Station</p> <p>WATERFORD CONNECTICUT SOUTHEASTERN</p>	<p>Drawing Title SITE LOCATION</p> <p>CT</p>	<p>Project No. 140286501</p> <p>Date 1/3/2025</p> <p>Scale 1:200</p> <p>Drawn By Site Analyzer</p> <p>Submission Date 1/3/2025</p>	<p>Figure 1</p> <p>Sheet 1 of 2</p>
--	--	---	--	-------------------------------------

Disclaimer: This information is produced by an automated system and may not be complete. The absence of a feature is not a confirmation that the feature is not present at the subject location. Information produced is in the public domain and unless noted has not been field verified or provided for any specific use. Users are also cautioned to confirm the information shown is suitable for their intended use.


Spatial Reference: NAD 1983 StatePlane Connecticut FIPS 0600 Feet

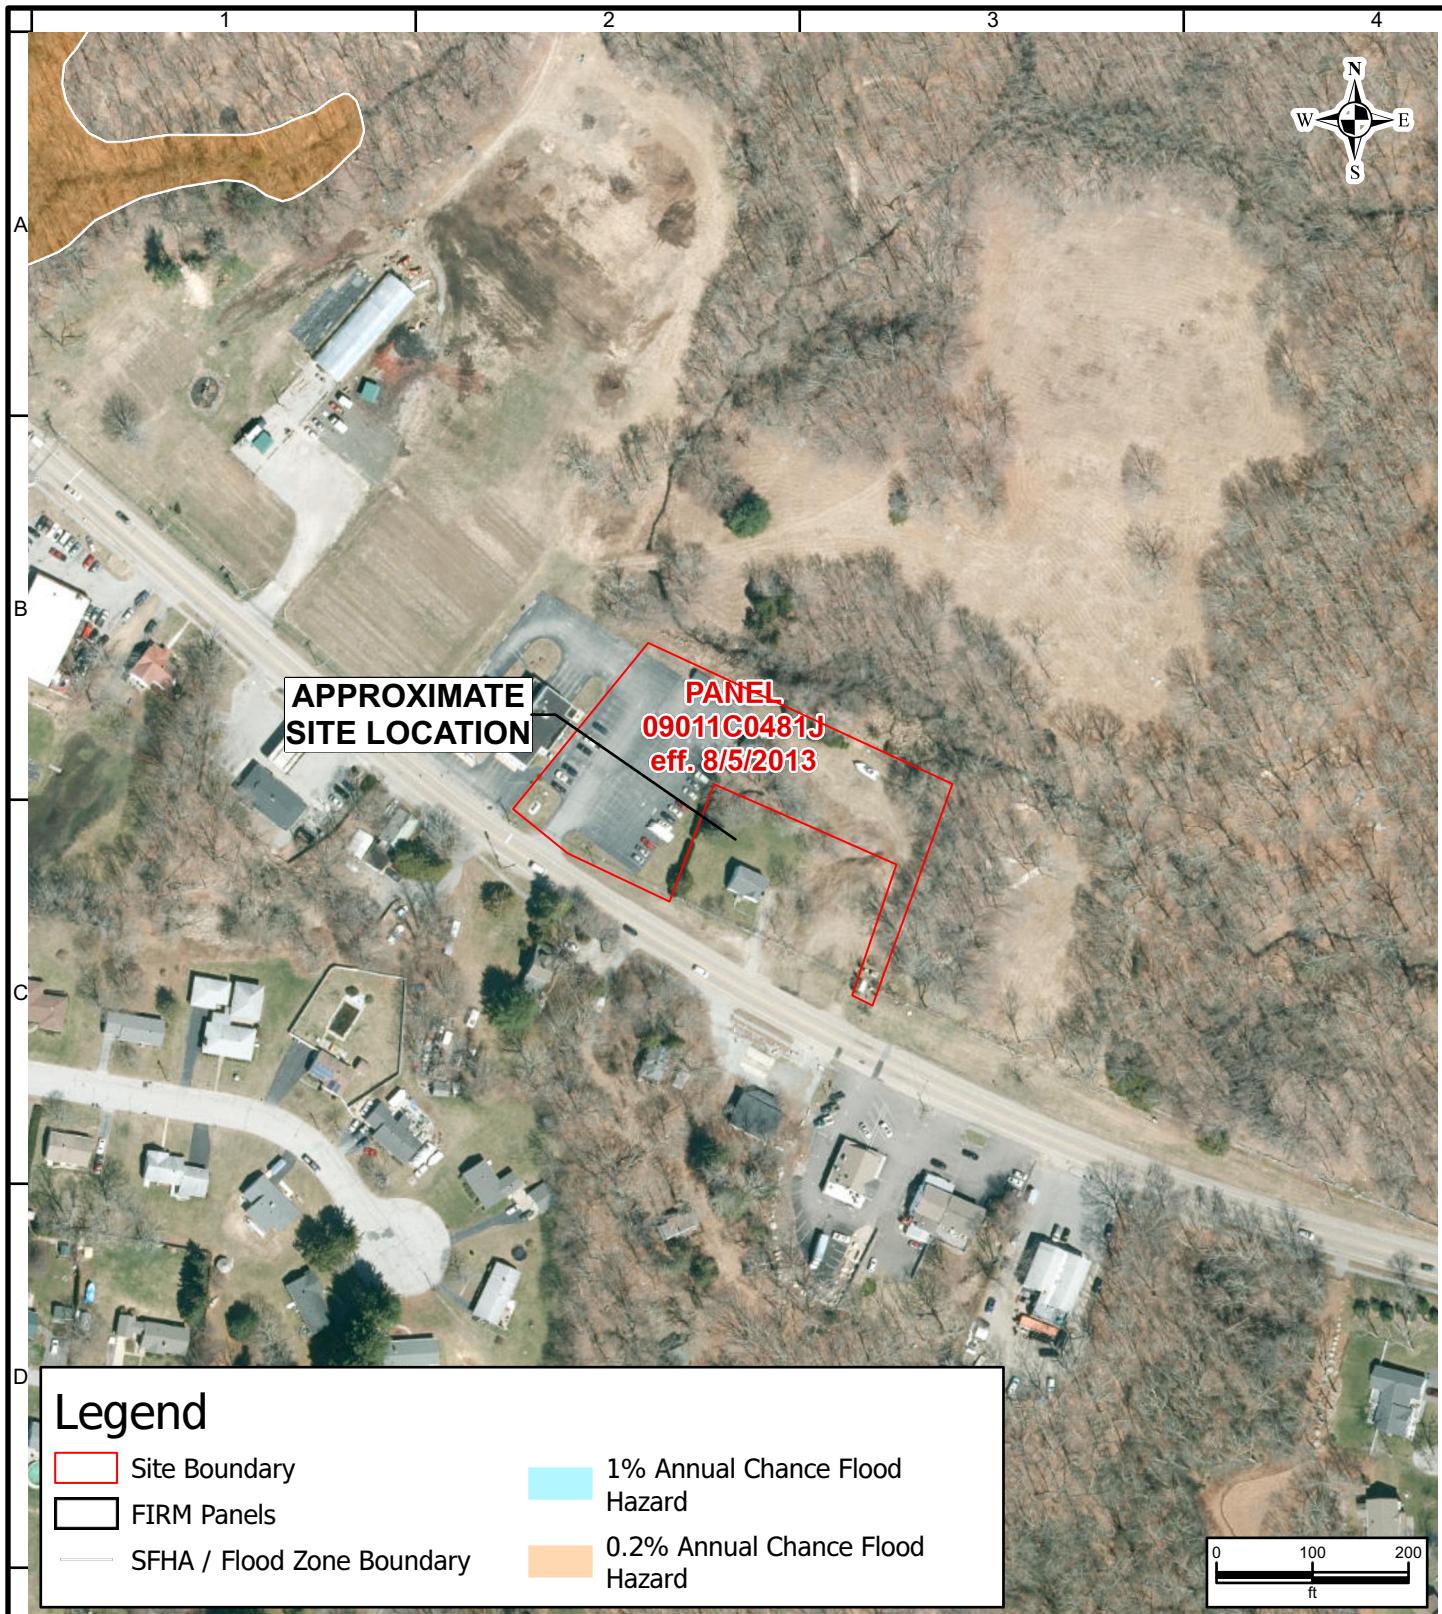

LANGAN 300 Kimball Drive 4th Floor Parsippany NJ 07054-2172 T: 973-560-4900 F: 973-560-4901 www.langan.com	Project Oswegatchie Fire Station WATERFORD CONNECTICUT SOUTHEASTERN	Drawing Title EFFECTIVE FEMA FIRM CT	Project No. 140286501 Date 1/3/2025 Scale 1:200 Drawn By Site Analyzer Submission Date 1/3/2025	Figure 2 Sheet 2 of 2
--	--	---	--	--

Disclaimer: This information is produced by an automated system and may not be complete. The absence of a feature is not a confirmation that the feature is not present at the subject location. Information produced is in the public domain and unless noted has not been field verified or provided for any specific use. Users are also cautioned to confirm the information shown is suitable for their intended use.

Spatial Reference: NAD 1983 StatePlane Connecticut FIPS 0600 Feet

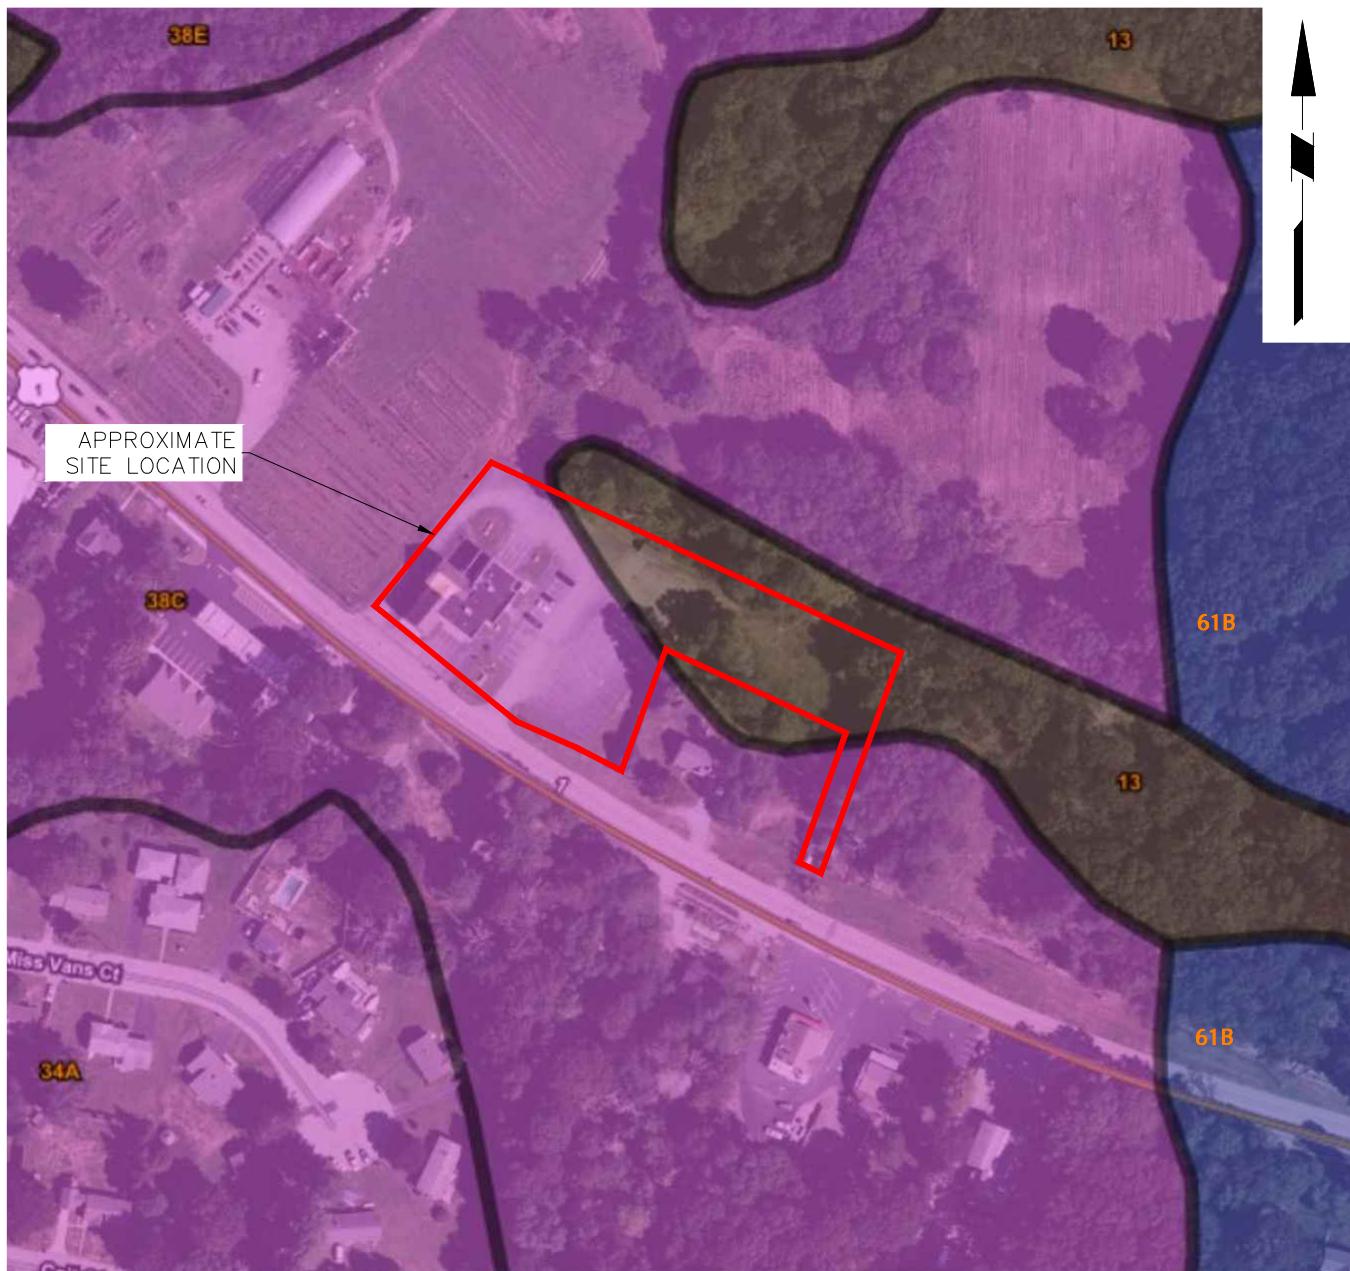


SCALE: 1 INCH = 200 FEET

SOIL TYPE LEGEND

SYMBOL	NAME	GROUP
13	WALPOLE SANDY LOAM, 0 TO 3 PERCENT SLOPES	B/D
38C	HINCKLEY LOAMY SAND, 3 TO 15 PERCENT SLOPES	A

REFERENCE: WEB SOIL SURVEY BY THE UNITED STATES DEPARTMENT OF
AGRICULTURAL AND NATURAL RESOURCES CONSERVATION SERVICE.

LANGAN Langan CT, Inc. 555 Long Wharf Drive, 9th Floor New Haven, CT 06511 T: 203.562.5771 F: 203.789.6142 www.langan.com	Project OSWEGATCHIE FIRE STATION WATERFORD CONNECTICUT	Drawing Title NRCS SOILS MAP	Project No. 140286501 Date 1/7/2025 Drawn By APF Checked By BP	Drawing No. 3 Sheet 3 of 1
--	---	--	---	---

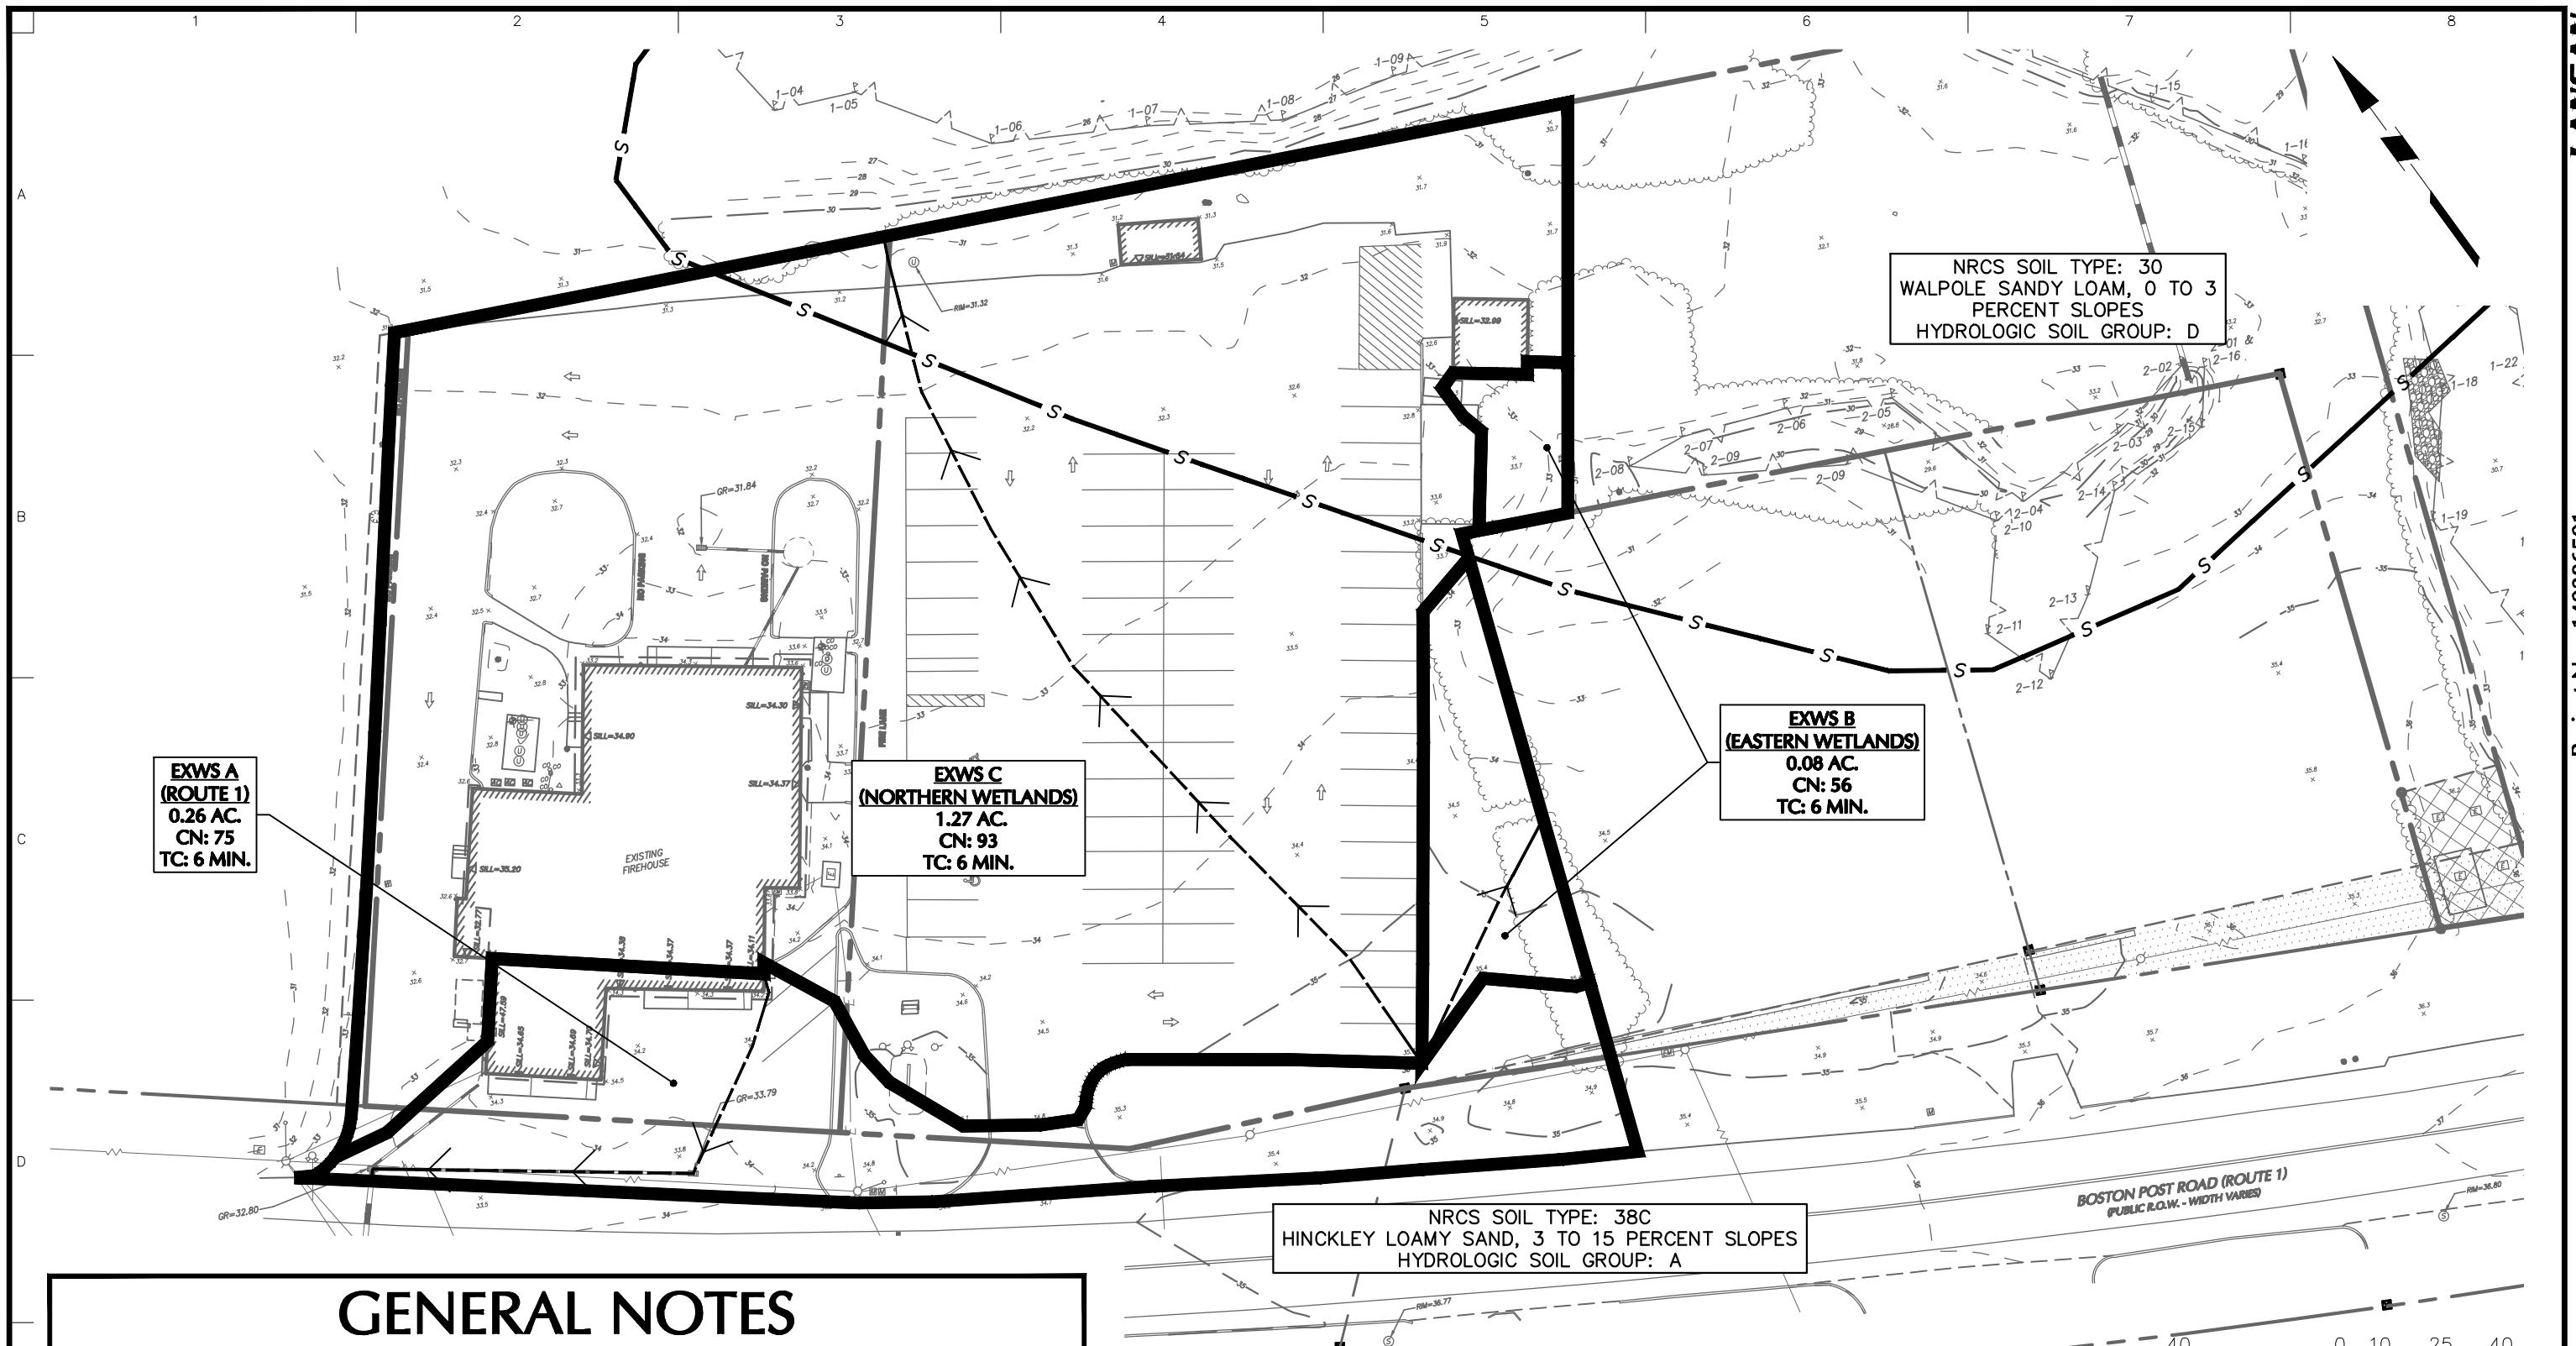

GENERAL NOTES

1. EXISTING INFORMATION OBTAINED FROM THE FOLLOWING "BOUNDARY AND TOPOGRAPHIC SURVEY", 439 & 441 BOSTON POST ROAD, WATERFORD, CT, DATED JUNE 28, 2024.
2. PROPOSED BUILDING FOOTPRINT RECEIVED ELECTRONICALLY FROM SILVER PETRUCELLI ARCHITECTURE IN DECEMBER 2024.
3. THE SITE IS LOCATED WITHIN ZONE X OF FEMA FIRM MAP 09011C0481J, EFFECTIVE AUGUST 5, 2013. ZONE X IS AN AREA OF MINIMAL FLOOD HAZARD WITH NO BASE FLOOD ELEVATIONS.

LANGAN


Langan CT, Inc.
555 Long Wharf Drive, 9th Floor
New Haven, CT 06511
T: 203.562.5771 F: 203.789.6142 www.langan.com

Project
Oswegatchie Fire Station
WATERFORD CONNECTICUT

Drawing Title
EXISTING WATERSHED MAP

Project No.
140286501
Date
1/7/2025
Drawn By
APF
Checked By
BP

Drawing No.
EXWS
Sheet 1 of 3
© 2024 Langan

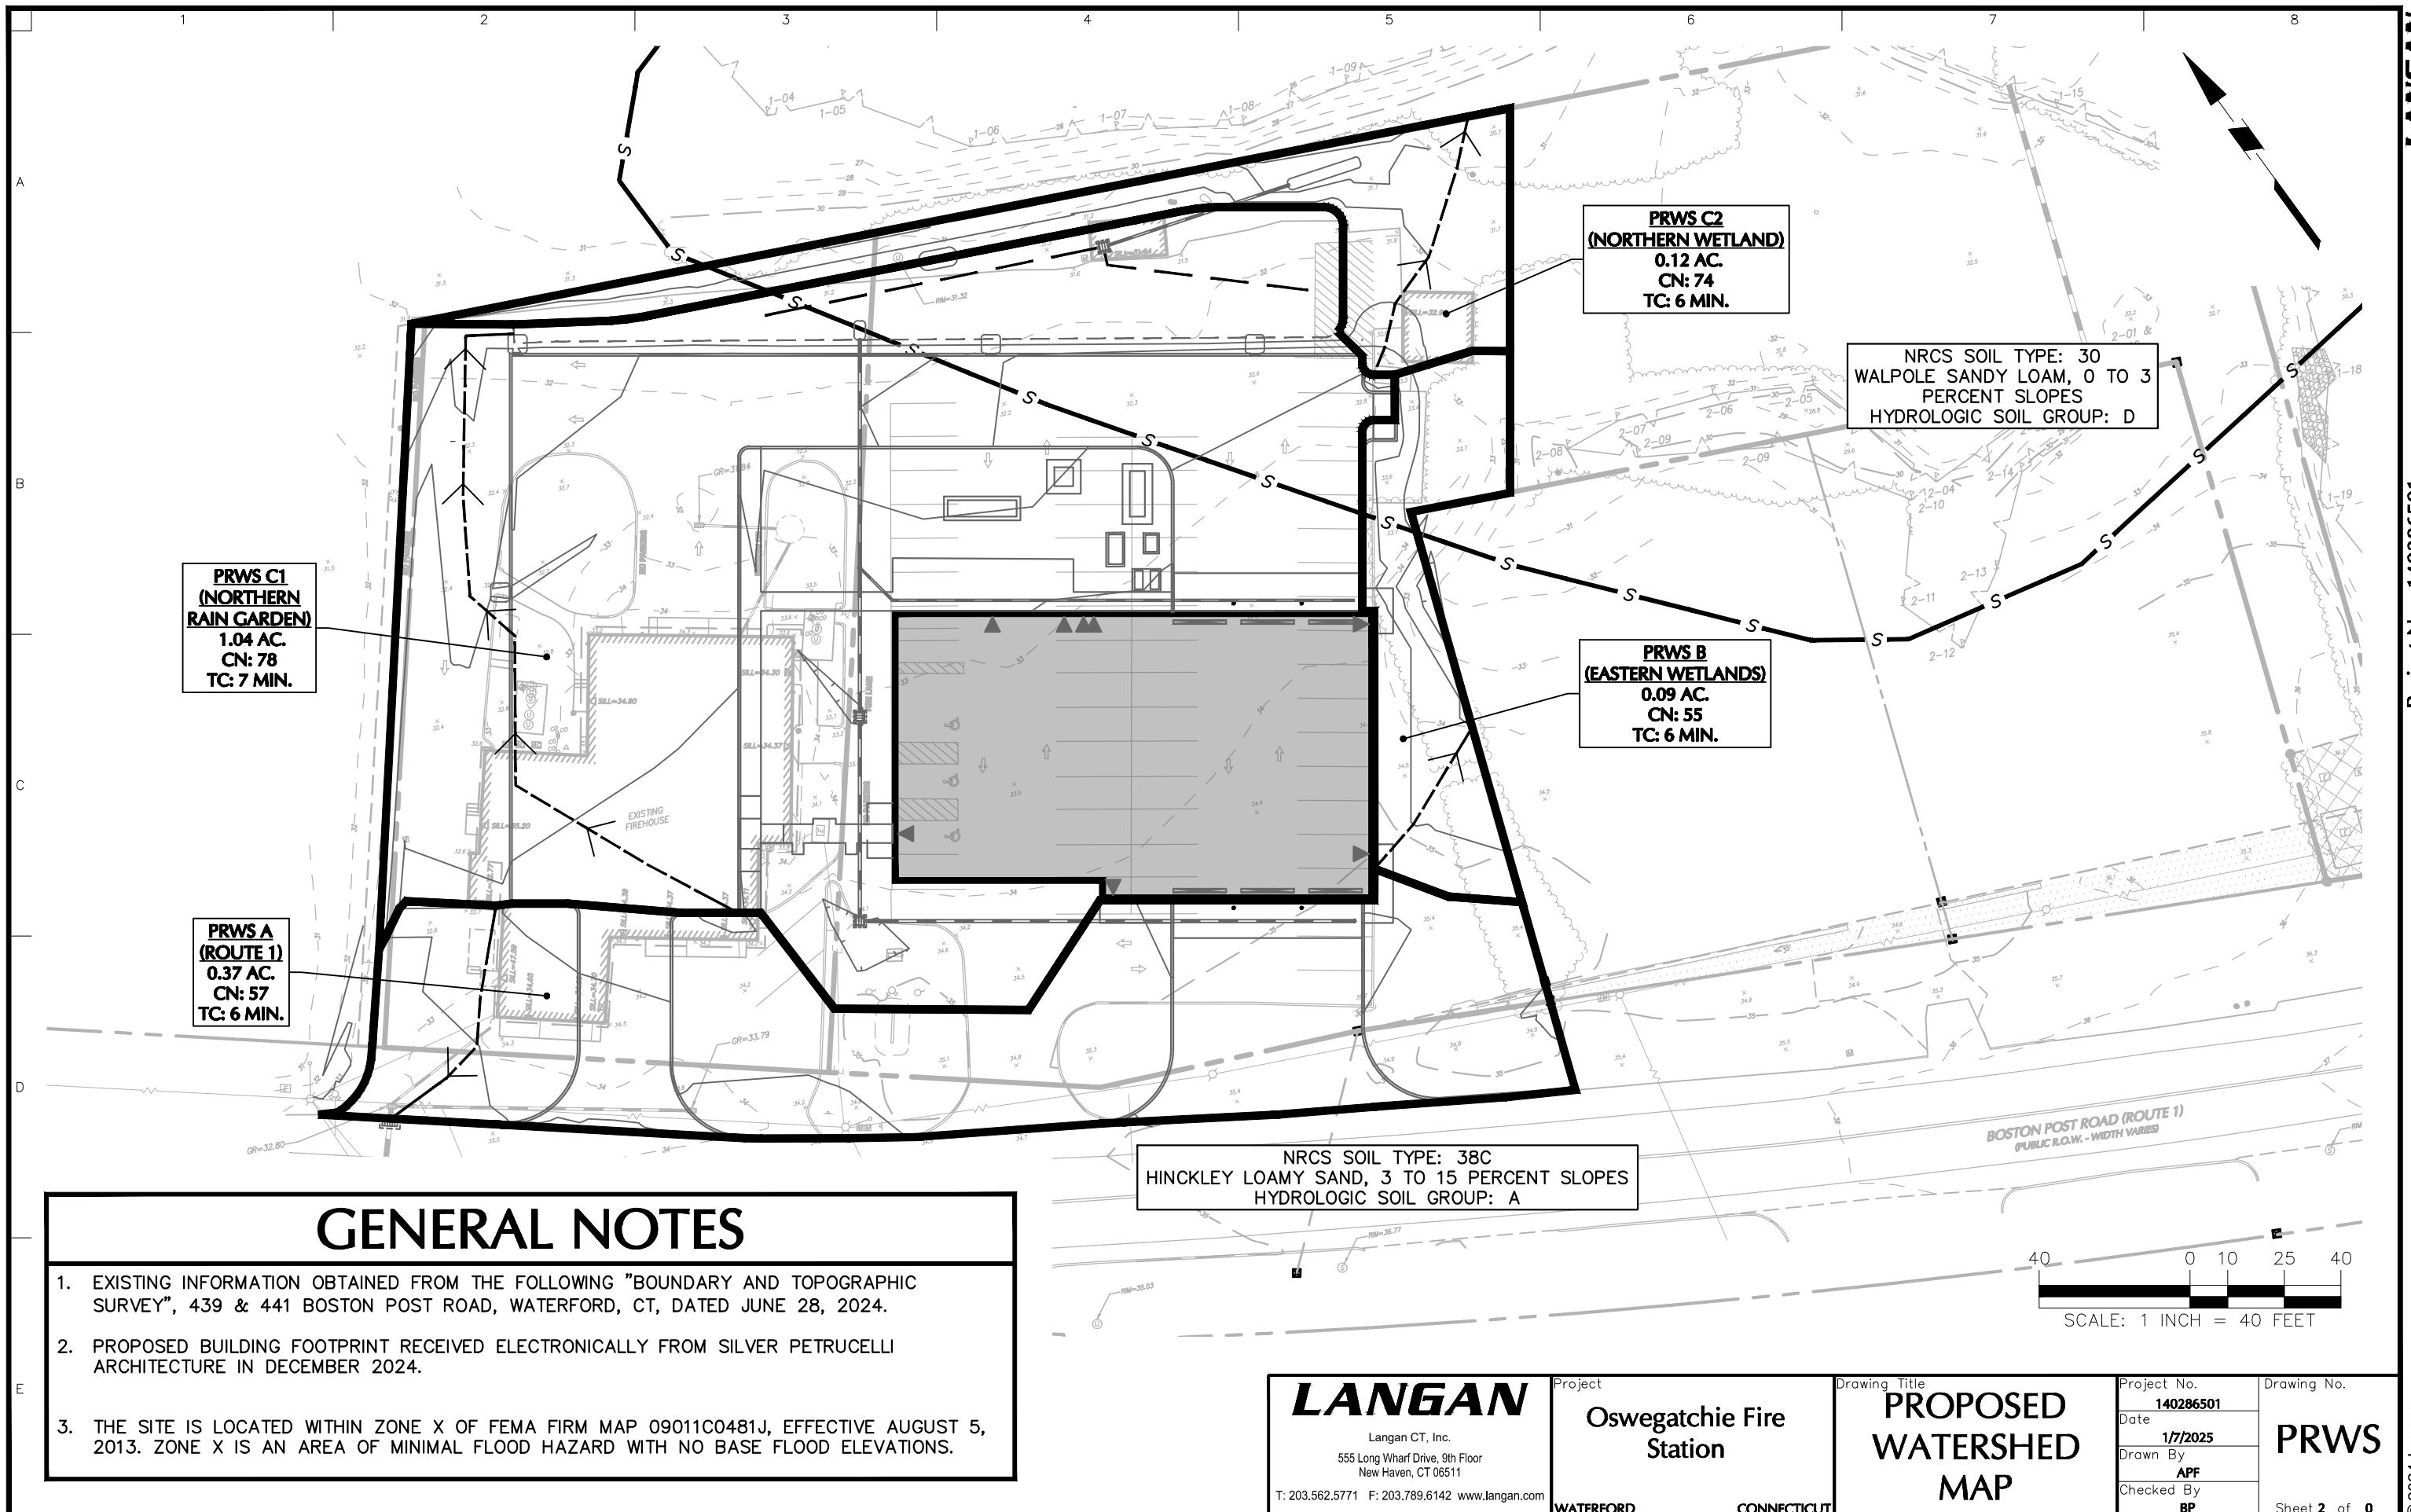


LANGAN

Langan CT, Inc.
555 Long Wharf Drive, 9th Floor
New Haven, CT 06511

T: 203.562.5771 F: 203.789.6142 www.langan.com

Project
Oswegatchie Fire
Station
WATERFORD CONNECTICUTDrawing Title
**PROPOSED
WATERSHED
MAP**Project No.
140286501
Date
1/7/2025
Drawn By
APF
Checked By
BPDrawing No.
PRWS

Sheet 2 of 0

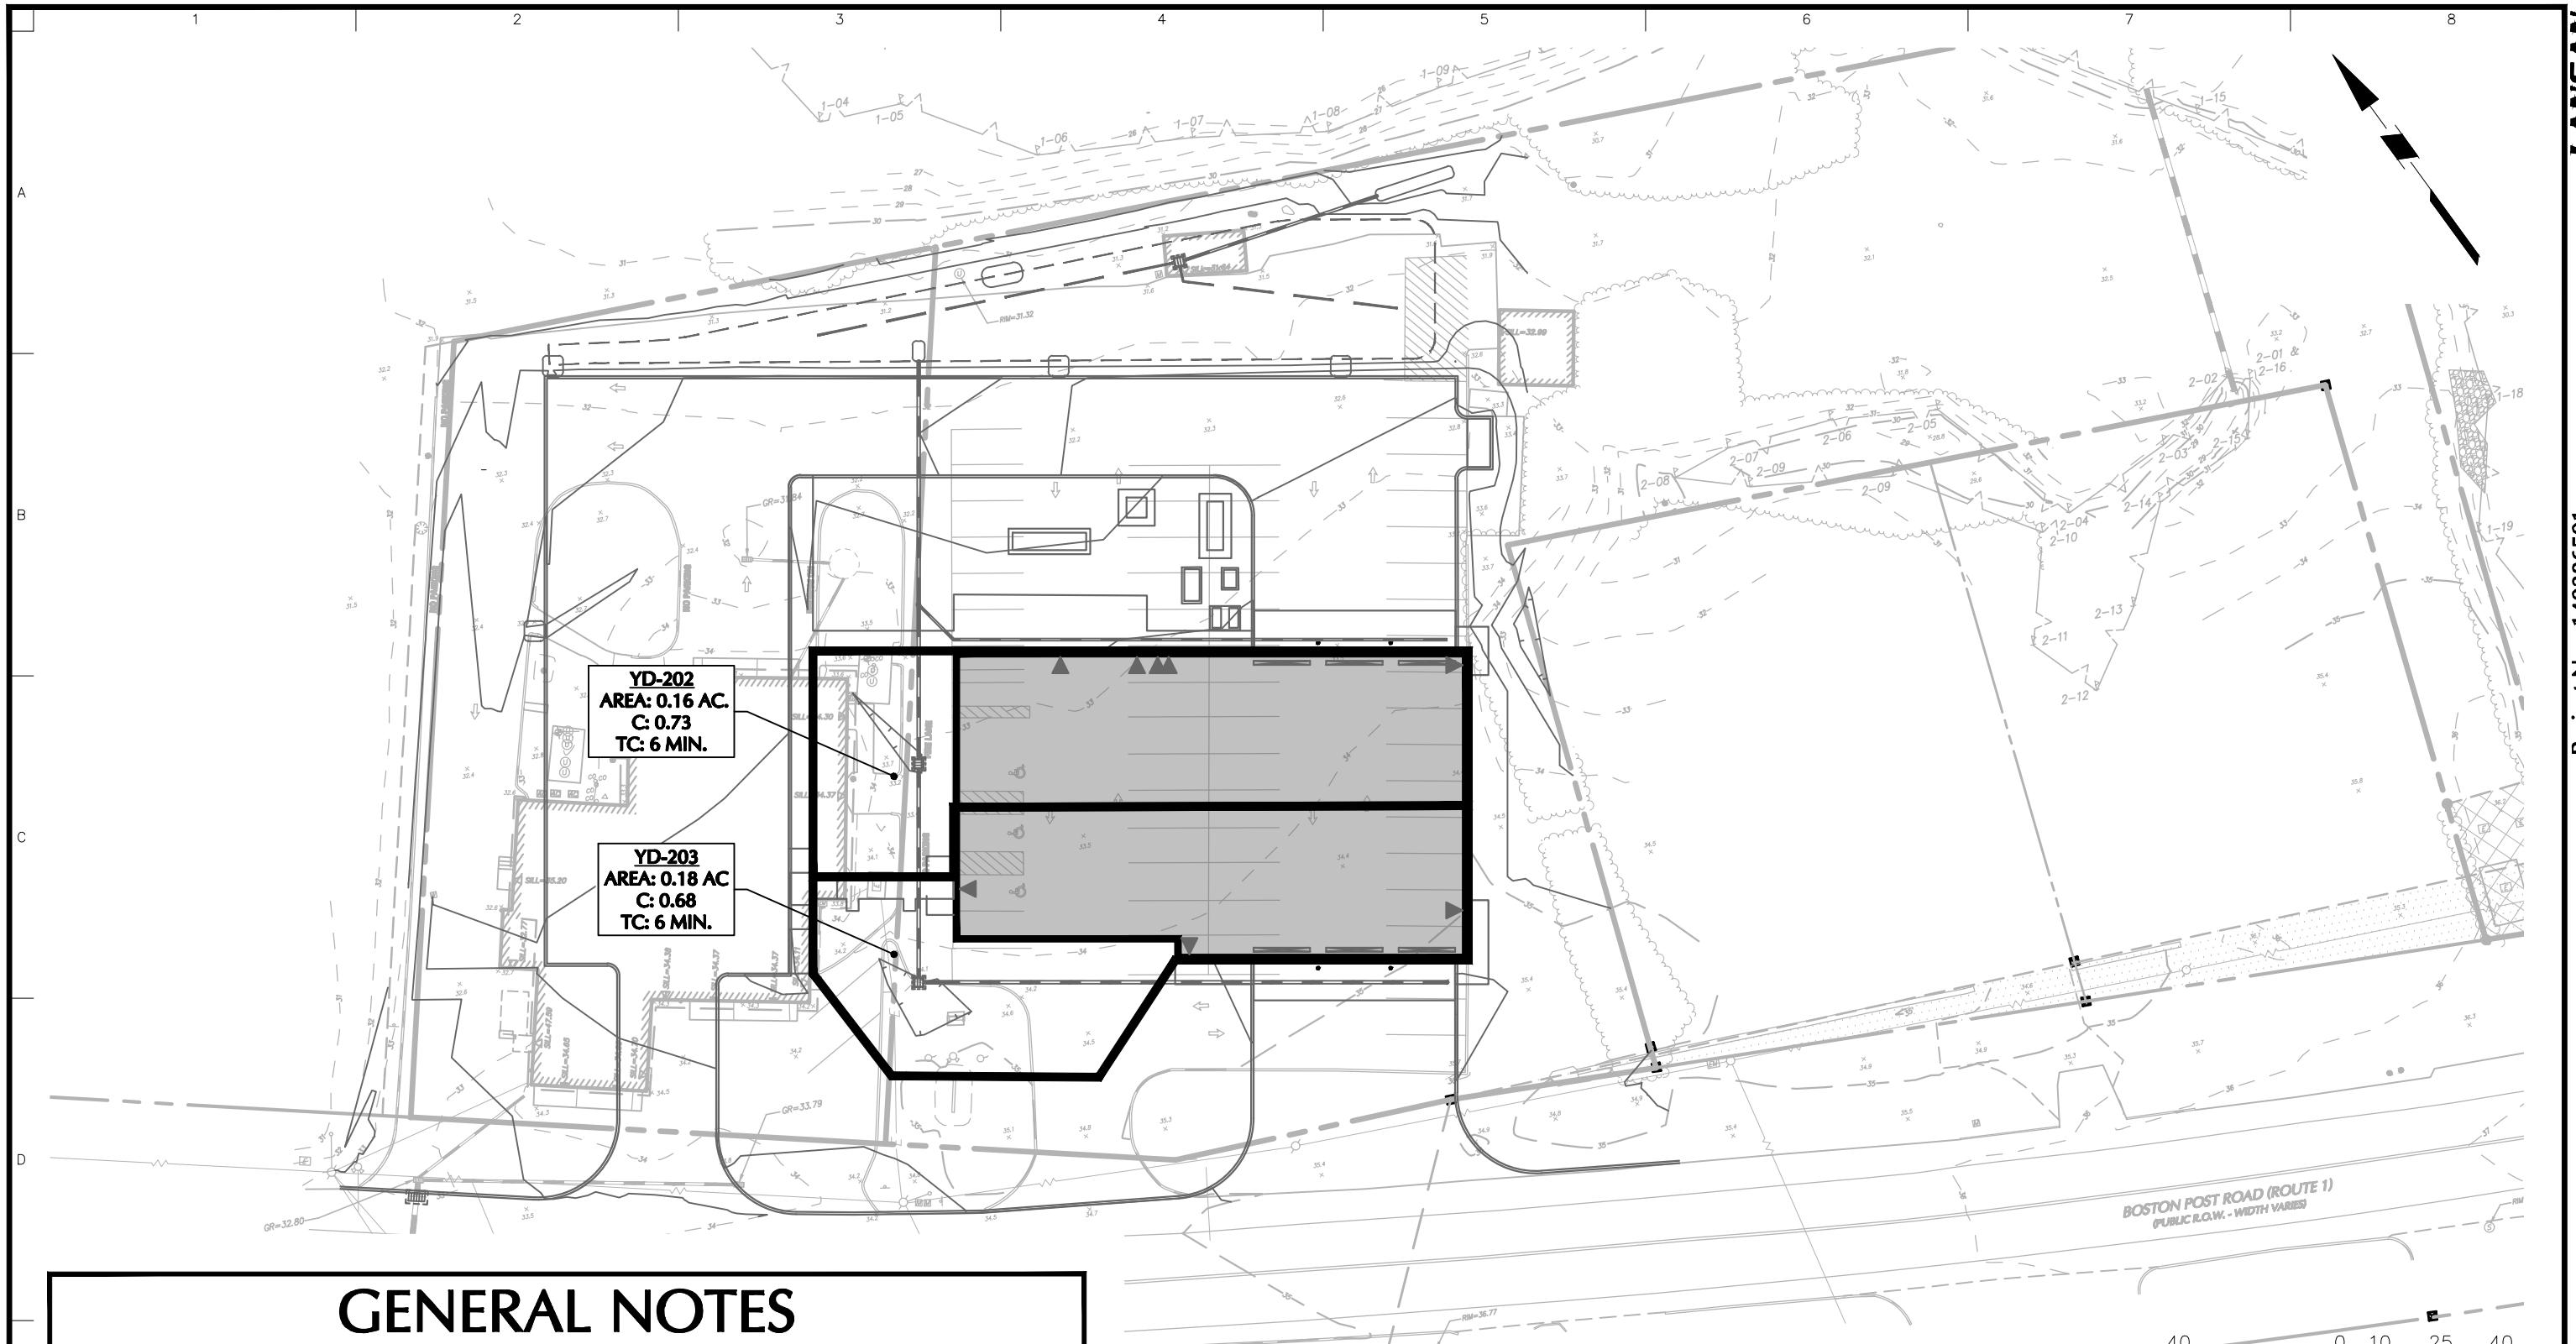

GENERAL NOTES

1. EXISTING INFORMATION OBTAINED FROM THE FOLLOWING "BOUNDARY AND TOPOGRAPHIC SURVEY", 439 & 441 BOSTON POST ROAD, WATERFORD, CT, DATED JUNE 28, 2024.
2. PROPOSED BUILDING FOOTPRINT RECEIVED ELECTRONICALLY FROM SILVER PETRUCELLI ARCHITECTURE IN DECEMBER 2024.
3. THE SITE IS LOCATED WITHIN ZONE X OF FEMA FIRM MAP 09011C0481J, EFFECTIVE AUGUST 5, 2013. ZONE X IS AN AREA OF MINIMAL FLOOD HAZARD WITH NO BASE FLOOD ELEVATIONS.

LANGAN


Langan CT, Inc.
555 Long Wharf Drive, 9th Floor
New Haven, CT 06511
T: 203.562.5771 F: 203.789.6142 www.langan.com


Project
Oswegatchie Fire
Station
WATERFORD CONNECTICUT

Drawing Title
**DRAINAGE AREA
CATCHMENT
BASIN MAP**

Project No. 140286501	Drawing No. DACP
Date 1/7/2024	
Drawn By APF	
Checked By BP	




© 2024 Langan

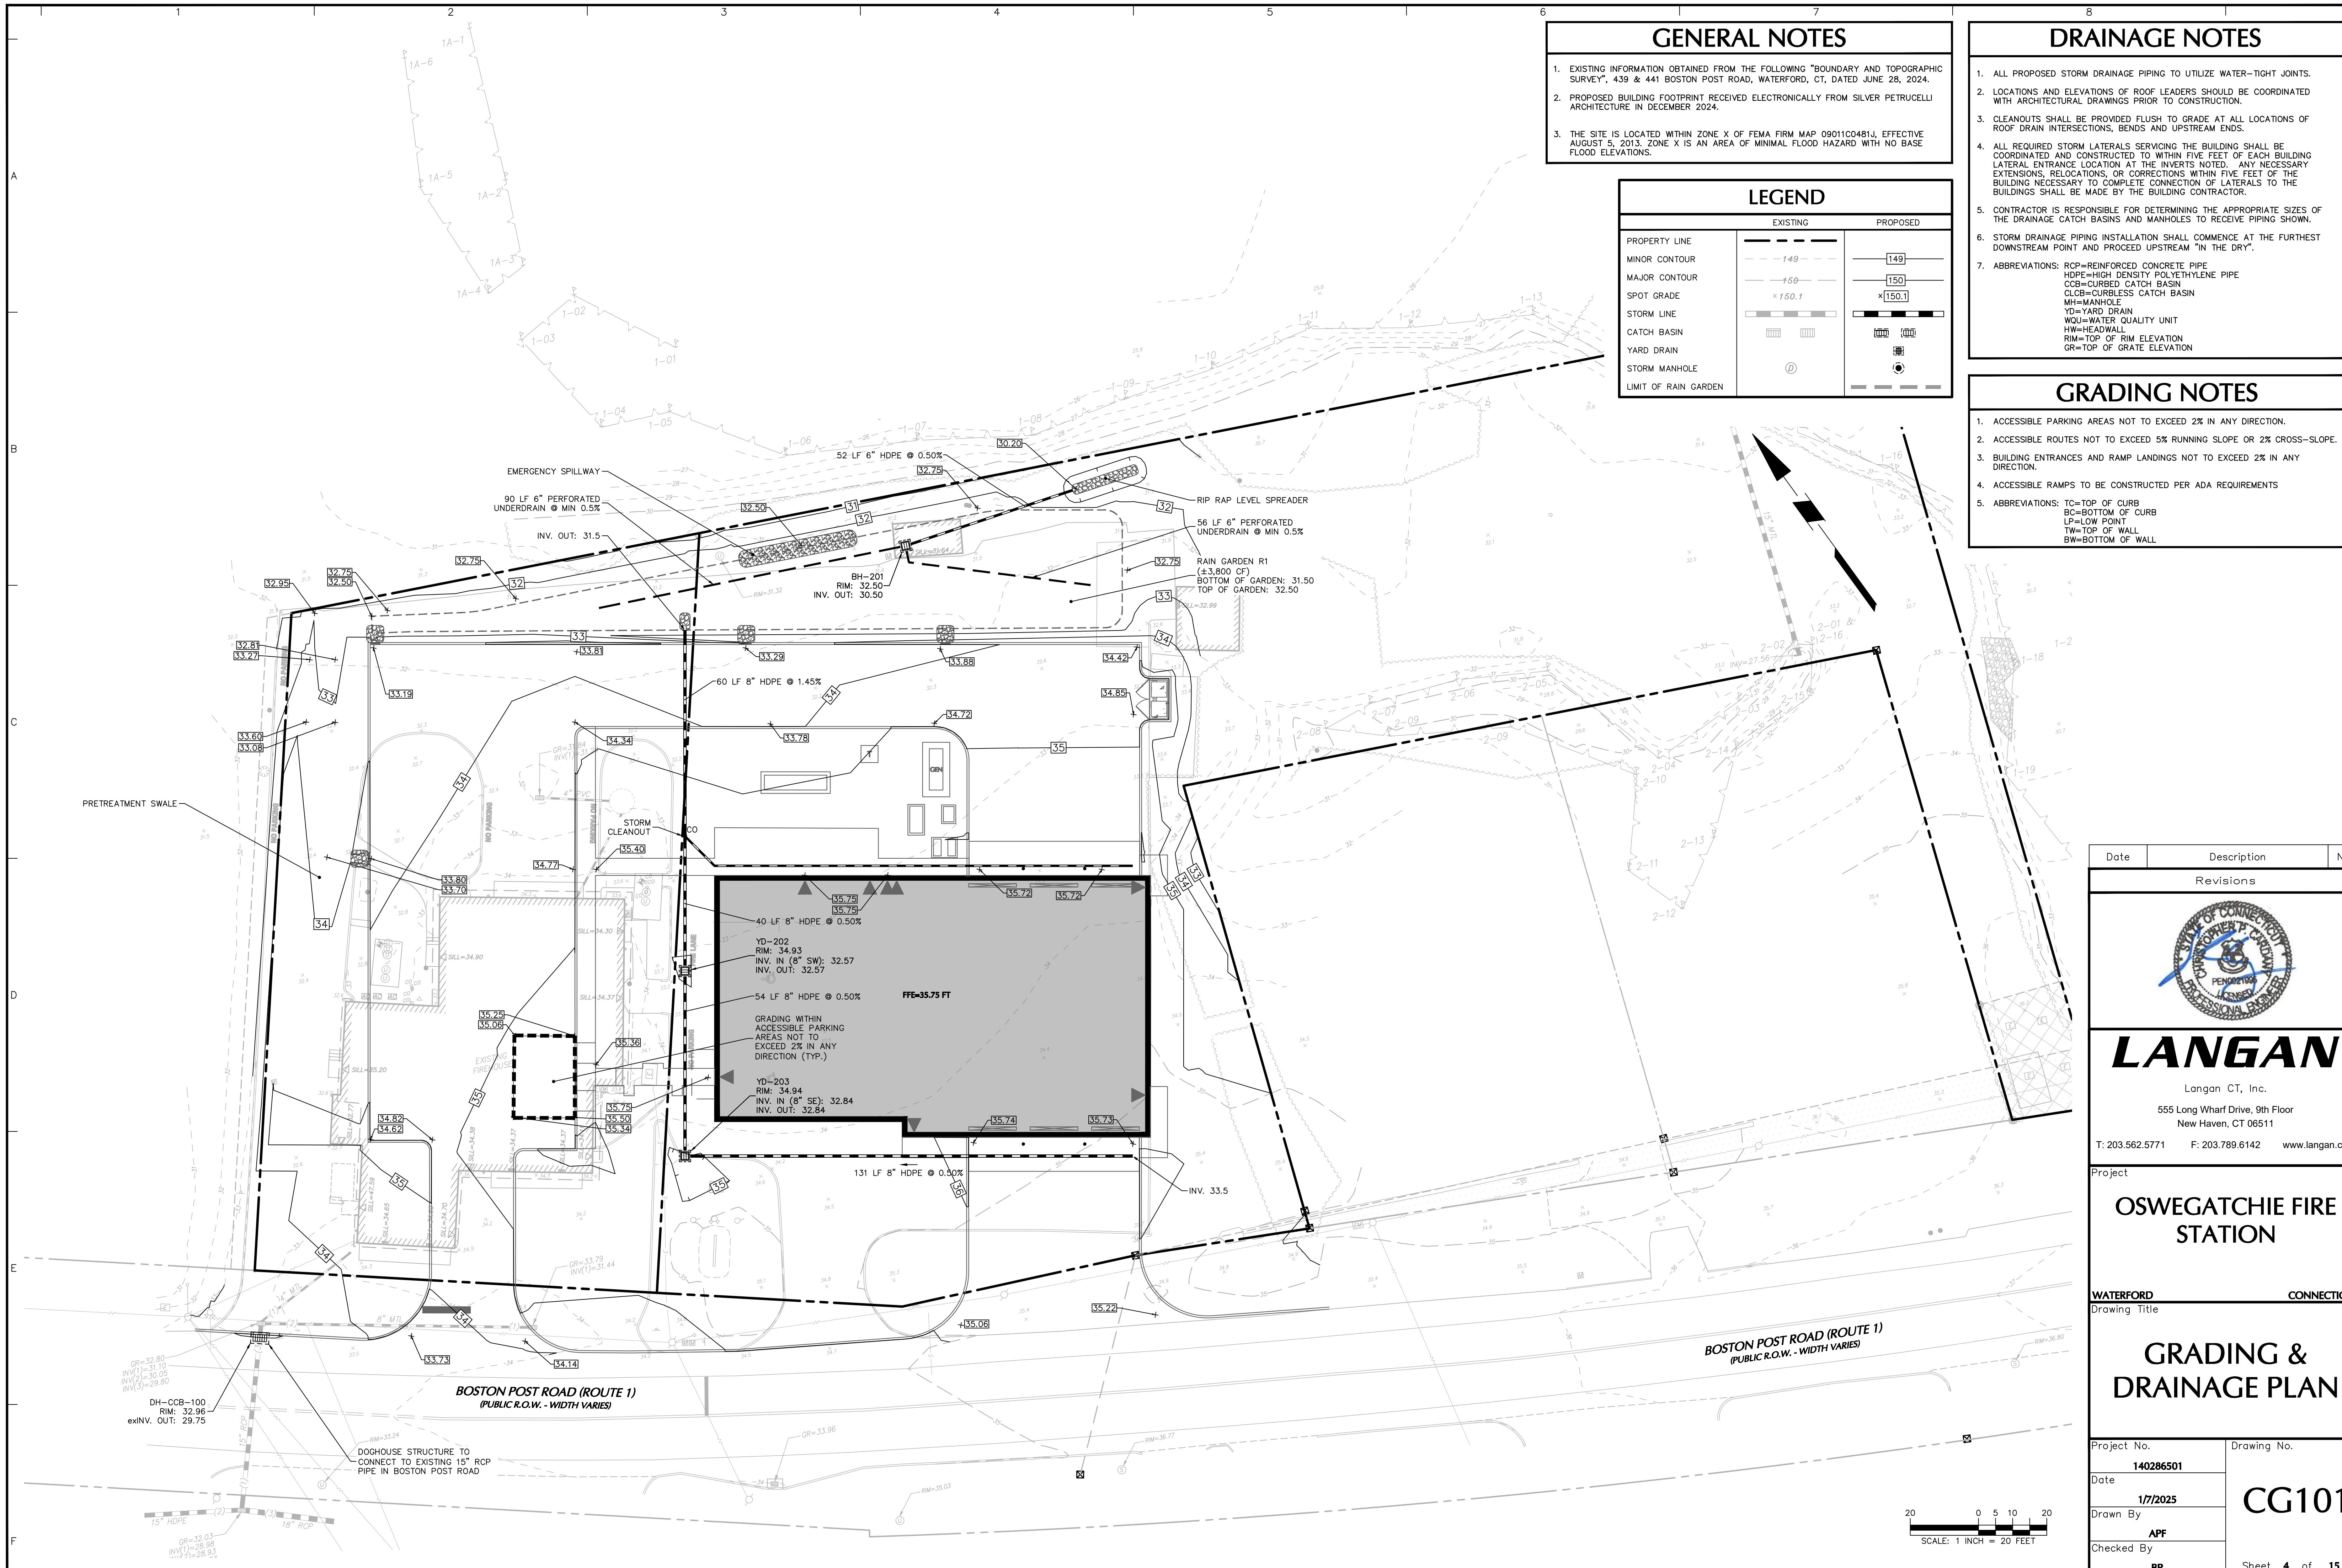

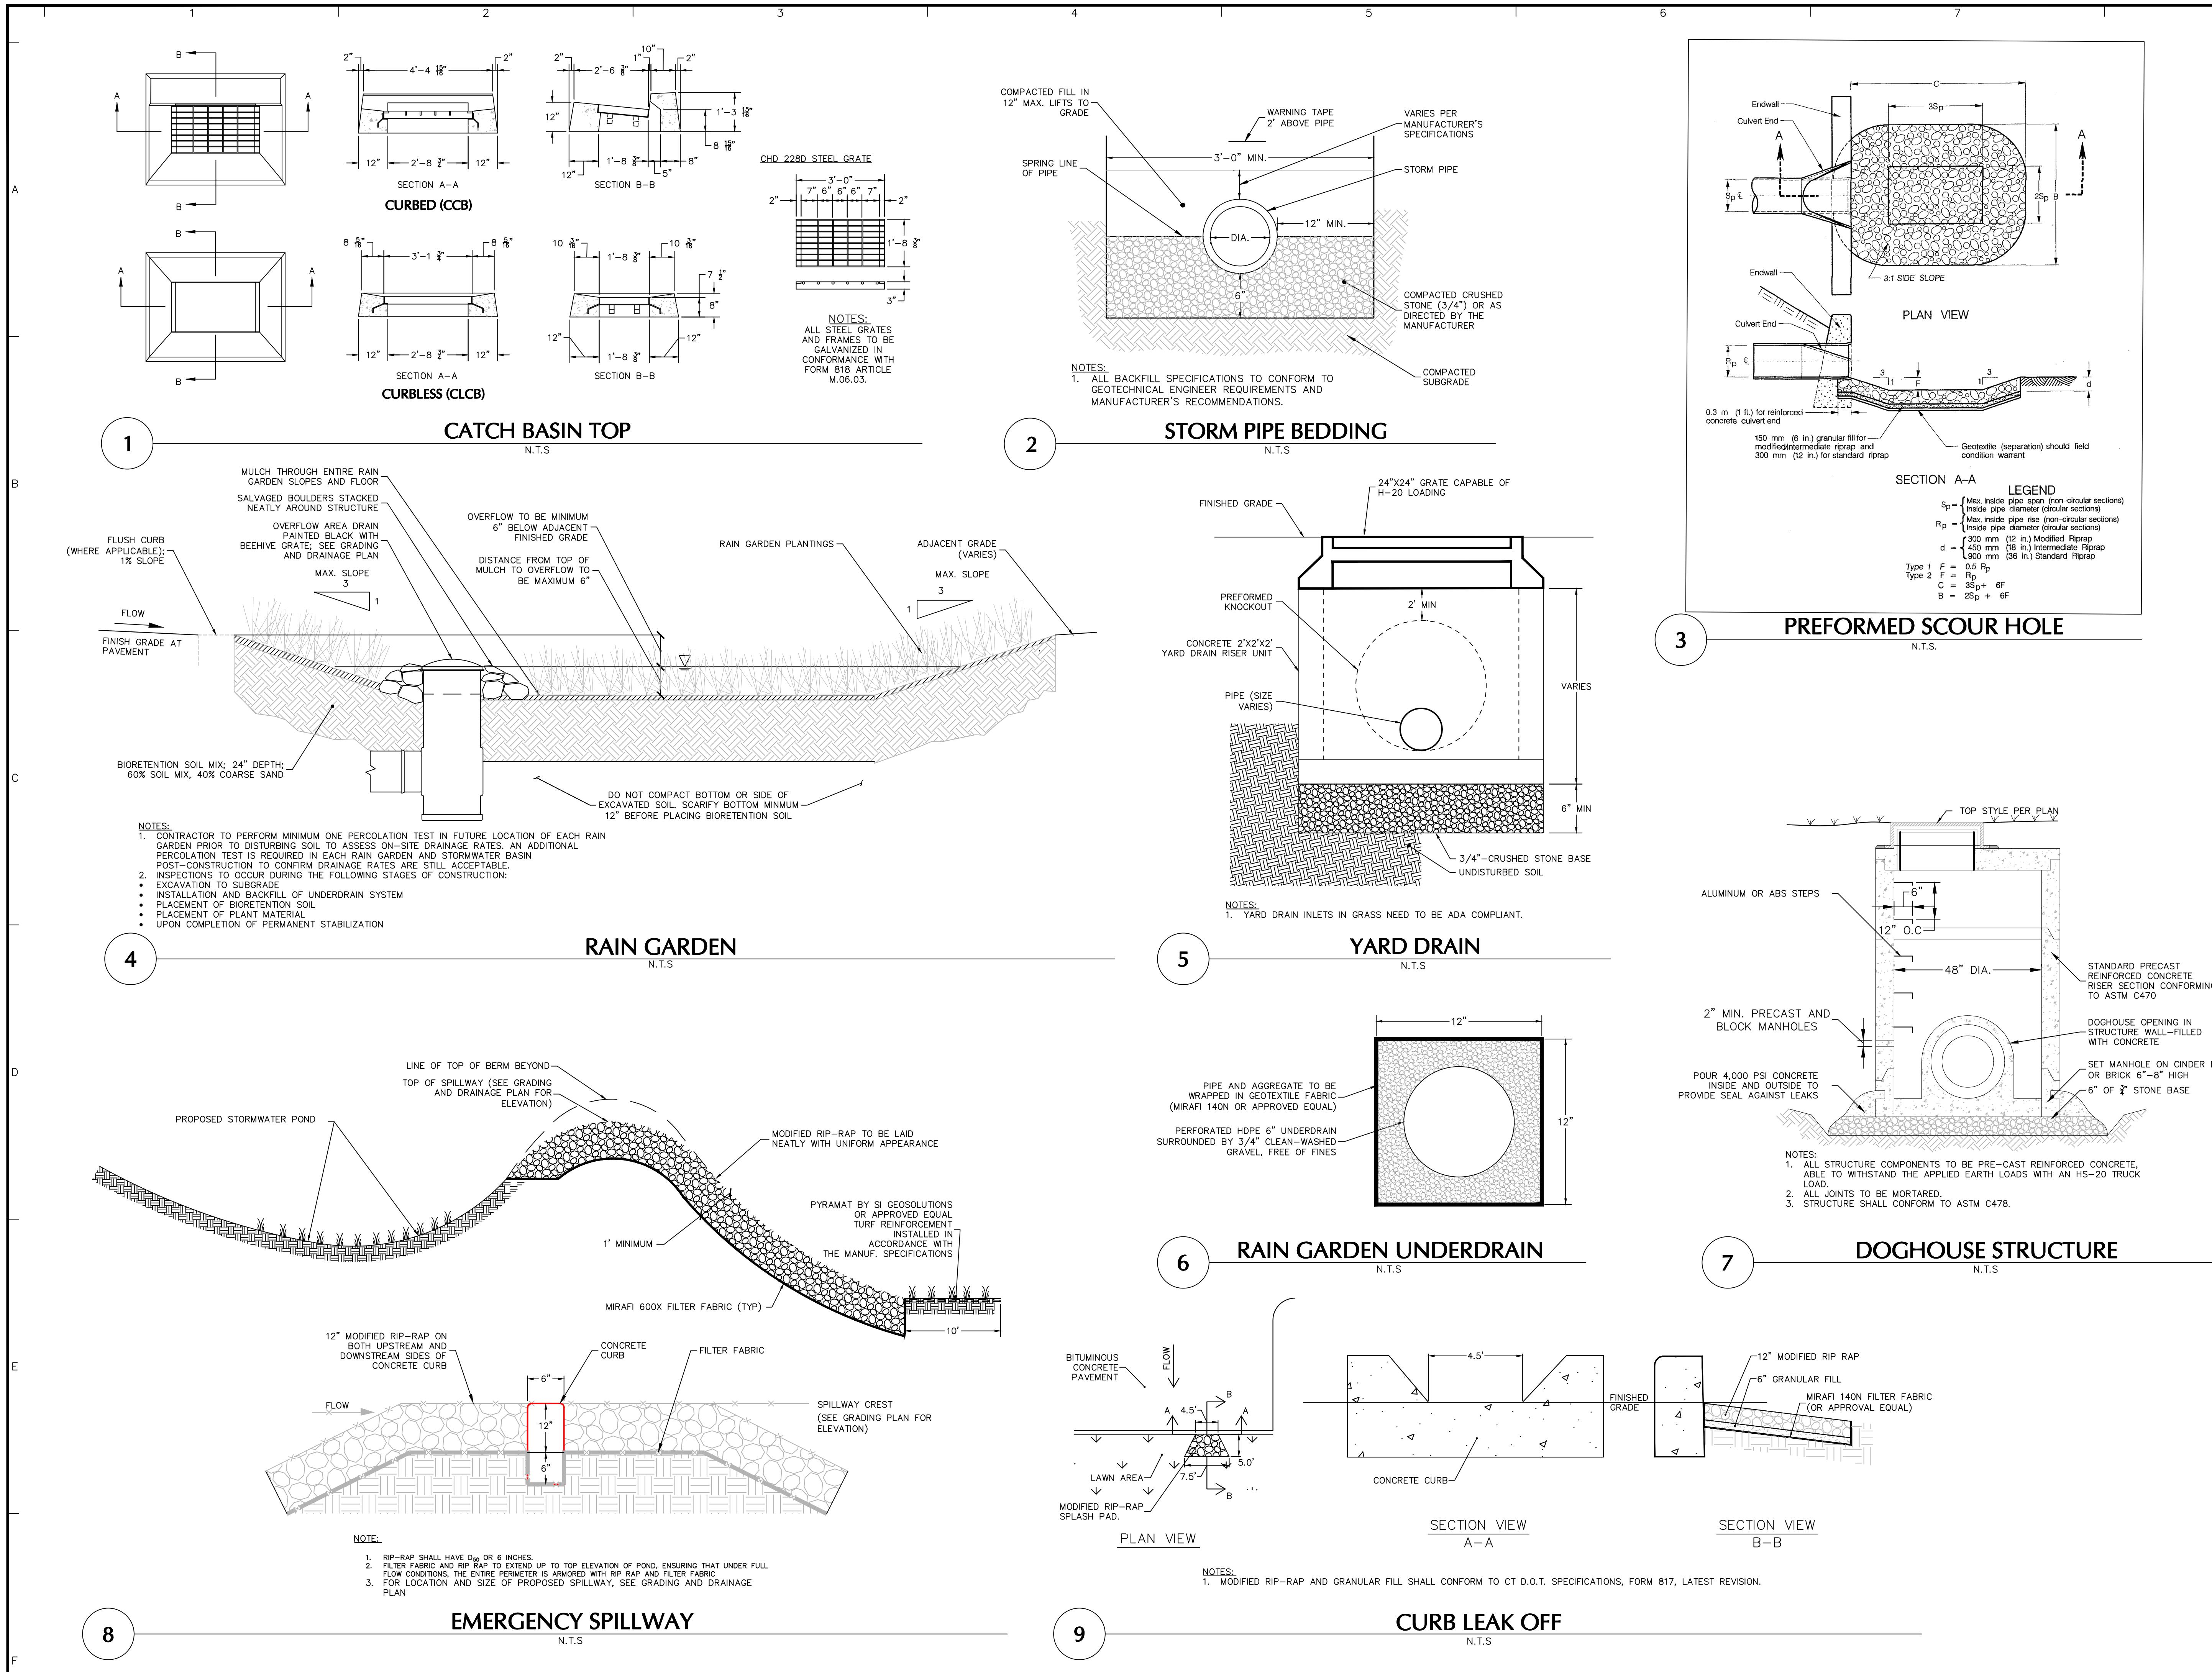

Date	Description	No.
Revisions		
LANGAN		
Langan CT, Inc. 555 Long Wharf Drive, 9th Floor New Haven, CT 06511 T: 203.562.5771 F: 203.789.6142 www.langan.com		
Project		
OSWEGATCHIE FIRE STATION		
WATERFORD CONNECTICUT		
GRADING AND DRAINAGE DETAILS		
Project No.	140286501	Drawing No.
Date	1/7/2025	
Drawn By	APF	
Checked By	BP	
Sheet	5	of 15

APPENDIX A
Existing Stormwater Discharge Calculations

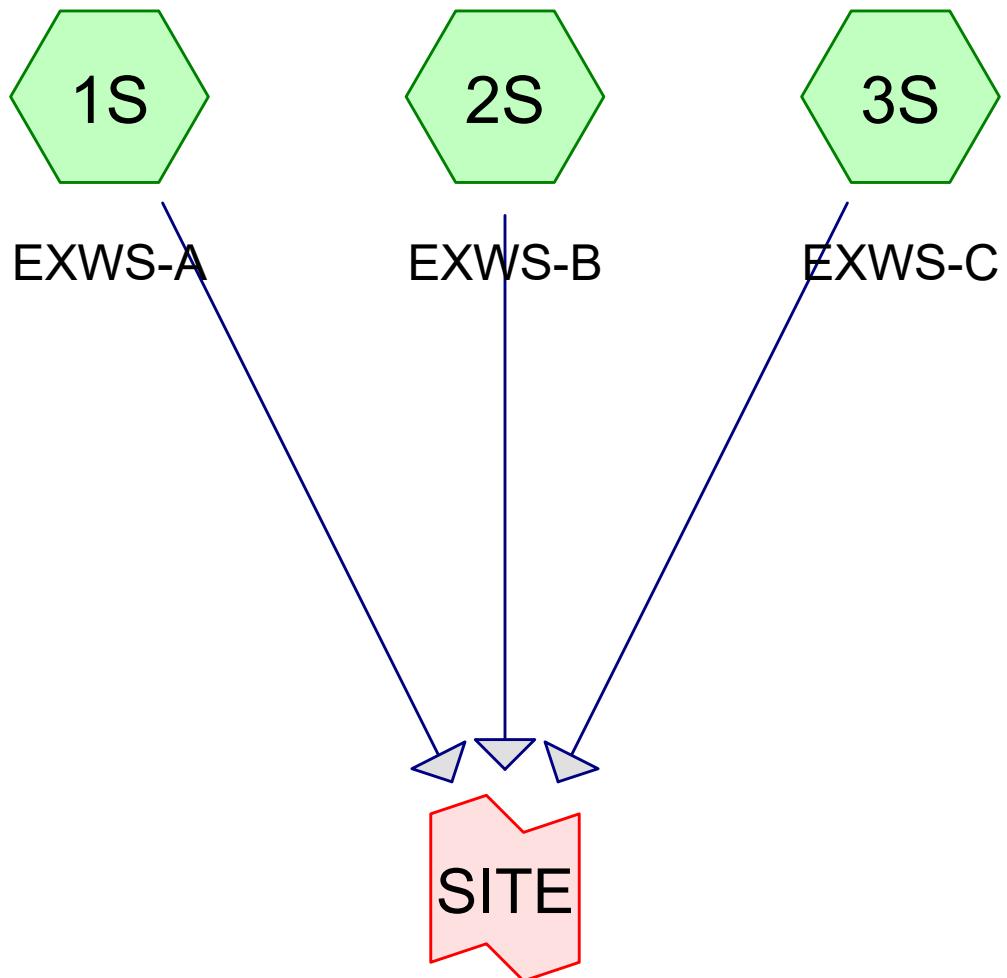

Routing Diagram for EX Hydro
Prepared by Langan Engineering, Printed 11/12/2024
HydroCAD® 10.20-3f s/n 08223 © 2023 HydroCAD Software Solutions LLC

EX Hydro

Prepared by Langan Engineering

HydroCAD® 10.20-3f s/n 08223 © 2023 HydroCAD Software Solutions LLC

Printed 11/12/2024

Page 2

Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
13,021	49	50-75% Grass cover, Fair, HSG A (1S, 2S, 3S)
4,022	84	50-75% Grass cover, Fair, HSG D (2S, 3S)
1,432	77	Brush, Fair, HSG D (2S, 3S)
52,049	98	Paved parking, HSG A (1S, 3S)
36	98	Paved parking, HSG D (2S)
70,560	88	TOTAL AREA

Time span=0.00-48.00 hrs, dt=0.05 hrs, 961 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EXWS-A

Runoff Area=11,475 sf 52.74% Impervious Runoff Depth=1.27"
Flow Length=137' Tc=6.0 min CN=75 Runoff=0.37 cfs 1,211 cf

Subcatchment 2S: EXWS-B

Runoff Area=3,749 sf 0.96% Impervious Runoff Depth=0.36"
Flow Length=68' Slope=0.0250 '/' Tc=6.4 min CN=56 Runoff=0.02 cfs 113 cf

Subcatchment 3S: EXWS-C

Runoff Area=55,336 sf 83.12% Impervious Runoff Depth=2.69"
Flow Length=248' Slope=0.0200 '/' Tc=6.0 min CN=93 Runoff=3.77 cfs 12,389 cf

Link SITE: Total Site

Inflow=4.15 cfs 13,713 cf
Primary=4.15 cfs 13,713 cf

Total Runoff Area = 70,560 sf Runoff Volume = 13,713 cf Average Runoff Depth = 2.33"
26.18% Pervious = 18,475 sf 73.82% Impervious = 52,085 sf


Summary for Subcatchment 1S: EXWS-A


Runoff = 0.37 cfs @ 12.10 hrs, Volume= 1,211 cf, Depth= 1.27"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-yr Rainfall=3.45"

Area (sf)	CN	Description
5,423	49	50-75% Grass cover, Fair, HSG A
6,052	98	Paved parking, HSG A
11,475	75	Weighted Average
5,423		47.26% Pervious Area
6,052		52.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	54	0.0075	0.85		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
0.3	83	0.0100	4.50	1.57	Pipe Channel, Segment 2 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
1.4	137				Total, Increased to minimum Tc = 6.0 min

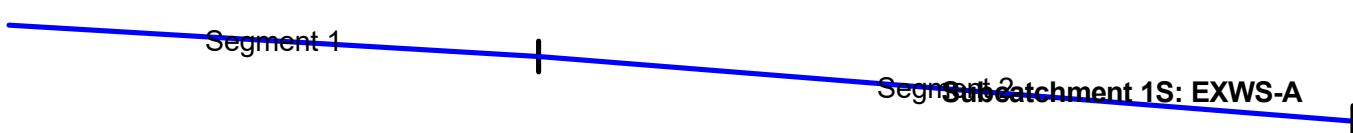

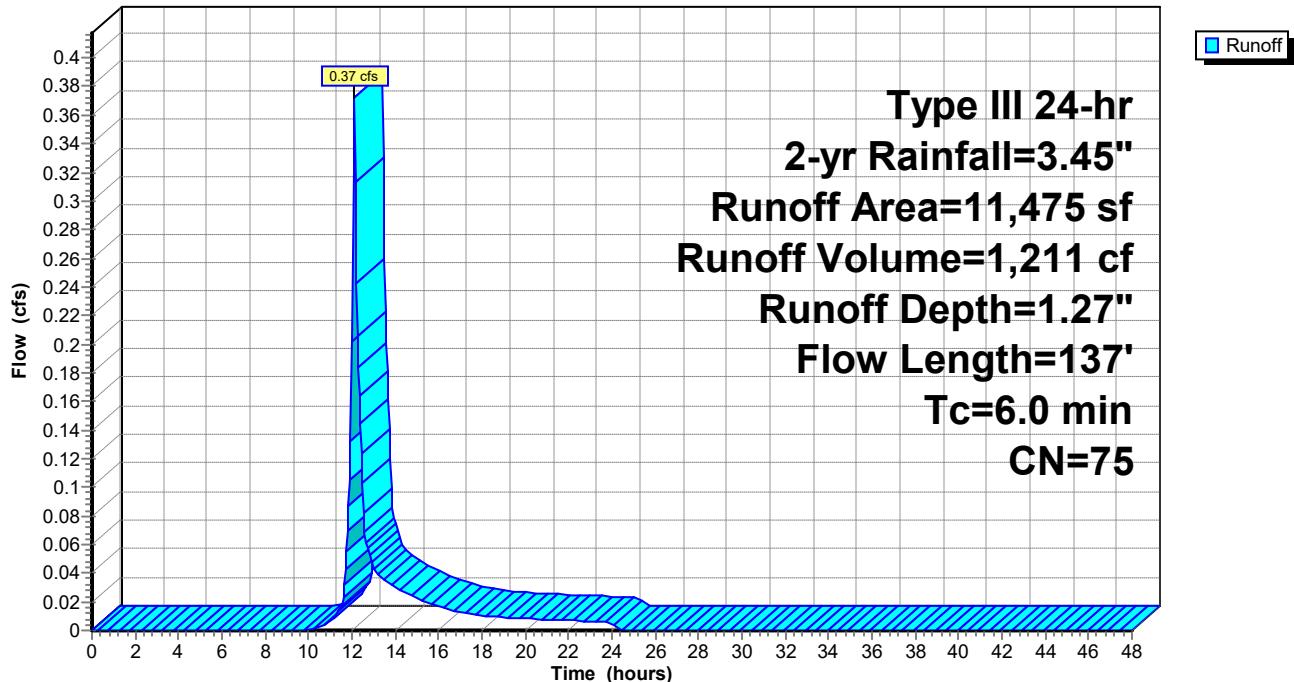Subcatchment 1S: EXWS-A**Hydrograph**

Summary for Subcatchment 2S: EXWS-B

Runoff = 0.02 cfs @ 12.15 hrs, Volume= 113 cf, Depth= 0.36"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-yr Rainfall=3.45"


Area (sf)	CN	Description
2,844	49	50-75% Grass cover, Fair, HSG A
770	77	Brush, Fair, HSG D
99	84	50-75% Grass cover, Fair, HSG D
36	98	Paved parking, HSG D
3,749	56	Weighted Average
3,713		99.04% Pervious Area
36		0.96% Impervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
6.4	68	0.0250	0.18	Sheet Flow, Segment 1	
				Grass: Short n= 0.150 P2= 3.43"	



Subcatchment 2S: EXWS-B

Hydrograph

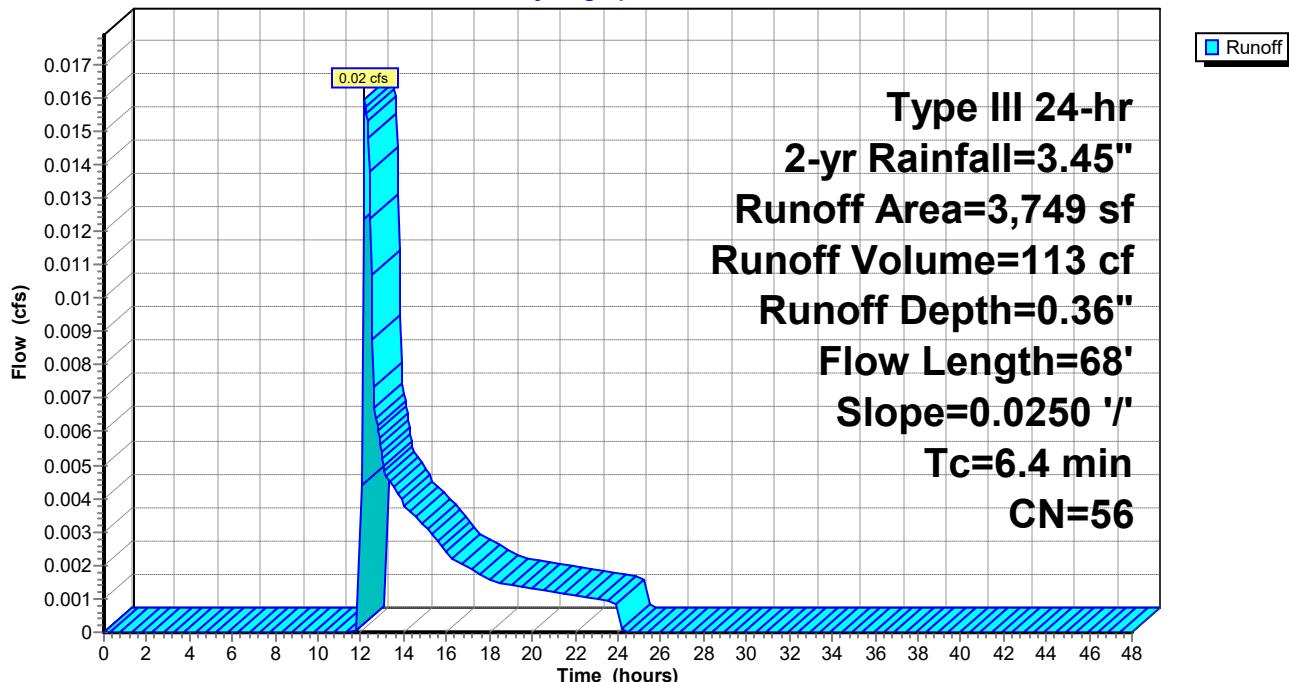

Summary for Subcatchment 3S: EXWS-C

Runoff = 3.77 cfs @ 12.09 hrs, Volume= 12,389 cf, Depth= 2.69"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-yr Rainfall=3.45"


Area (sf)	CN	Description
4,754	49	50-75% Grass cover, Fair, HSG A
3,923	84	50-75% Grass cover, Fair, HSG D
662	77	Brush, Fair, HSG D
45,997	98	Paved parking, HSG A
55,336	93	Weighted Average
9,339		16.88% Pervious Area
45,997		83.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	150	0.0200	1.54		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
0.5	86	0.0200	2.87		Shallow Concentrated Flow, Segment 2 Paved Kv= 20.3 fps
0.1	12	0.0200	2.12		Shallow Concentrated Flow, Segment 3 Grassed Waterway Kv= 15.0 fps
2.2	248	Total, Increased to minimum Tc = 6.0 min			

Segment 1

Subcatchment 3S: EXWS-C


Segment 2 Segment 3

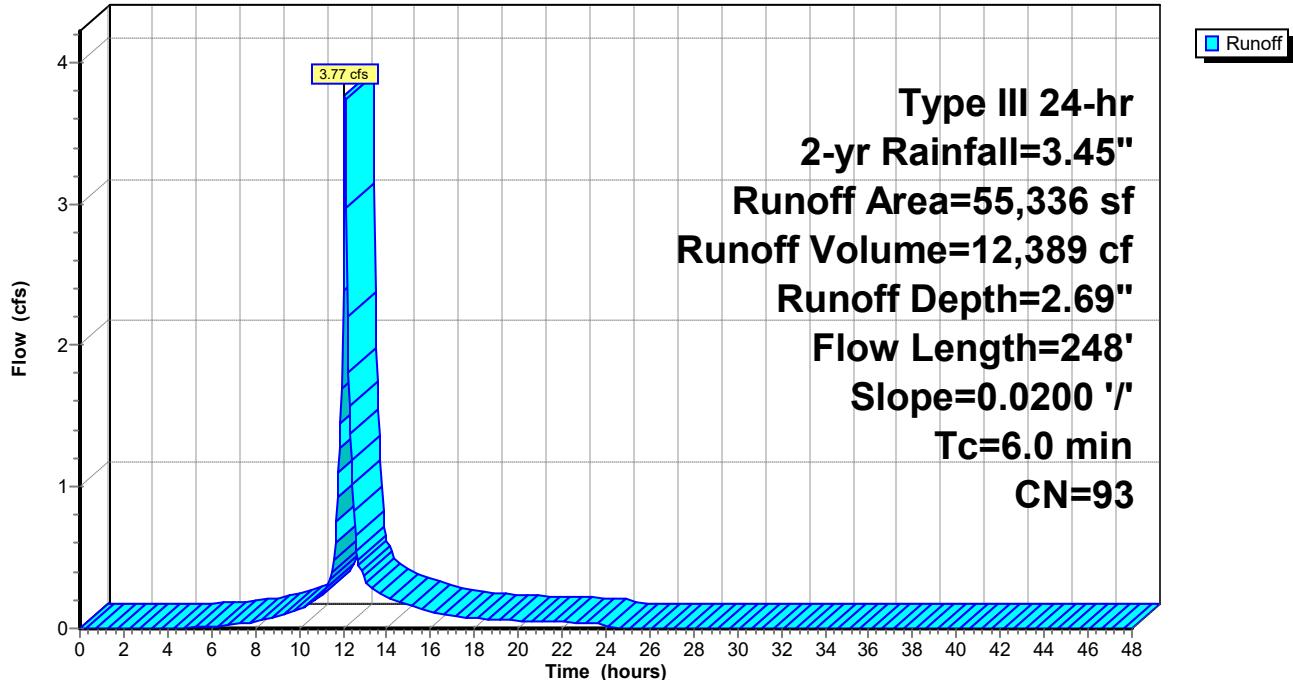Subcatchment 3S: EXWS-C**Hydrograph**

Summary for Link SITE: Total Site

Inflow Area = 70,560 sf, 73.82% Impervious, Inflow Depth = 2.33" for 2-yr event
Inflow = 4.15 cfs @ 12.09 hrs, Volume= 13,713 cf
Primary = 4.15 cfs @ 12.09 hrs, Volume= 13,713 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

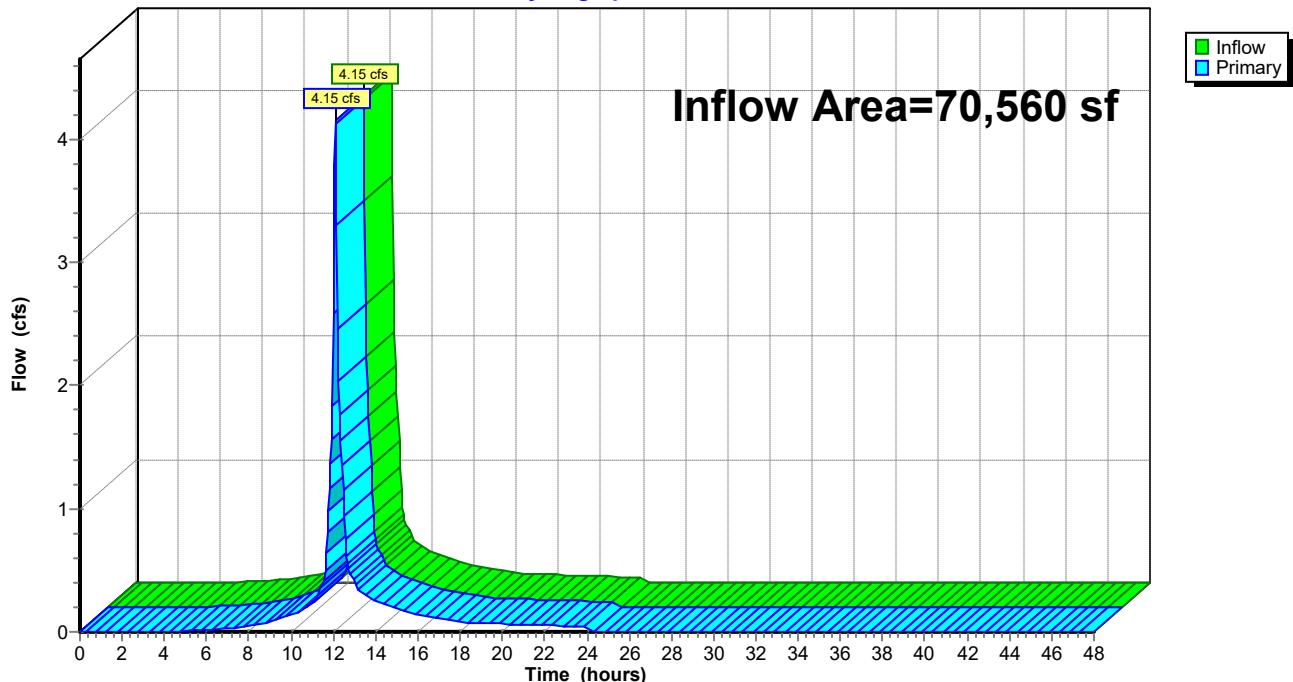Link SITE: Total Site**Hydrograph**

Time span=0.00-48.00 hrs, dt=0.05 hrs, 961 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EXWS-A

Runoff Area=11,475 sf 52.74% Impervious Runoff Depth=2.56"
Flow Length=137' Tc=6.0 min CN=75 Runoff=0.77 cfs 2,443 cf

Subcatchment 2S: EXWS-B

Runoff Area=3,749 sf 0.96% Impervious Runoff Depth=1.11"
Flow Length=68' Slope=0.0250 '/' Tc=6.4 min CN=56 Runoff=0.09 cfs 347 cf

Subcatchment 3S: EXWS-C

Runoff Area=55,336 sf 83.12% Impervious Runoff Depth=4.33"
Flow Length=248' Slope=0.0200 '/' Tc=6.0 min CN=93 Runoff=5.91 cfs 19,947 cf

Link SITE: Total Site

Inflow=6.76 cfs 22,737 cf
Primary=6.76 cfs 22,737 cf

Total Runoff Area = 70,560 sf Runoff Volume = 22,737 cf Average Runoff Depth = 3.87"
26.18% Pervious = 18,475 sf 73.82% Impervious = 52,085 sf


Summary for Subcatchment 1S: EXWS-A


Runoff = 0.77 cfs @ 12.09 hrs, Volume= 2,443 cf, Depth= 2.56"
Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-yr Rainfall=5.13"

Area (sf)	CN	Description
5,423	49	50-75% Grass cover, Fair, HSG A
6,052	98	Paved parking, HSG A
11,475	75	Weighted Average
5,423		47.26% Pervious Area
6,052		52.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	54	0.0075	0.85		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
0.3	83	0.0100	4.50	1.57	Pipe Channel, Segment 2 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
1.4	137				Total, Increased to minimum Tc = 6.0 min

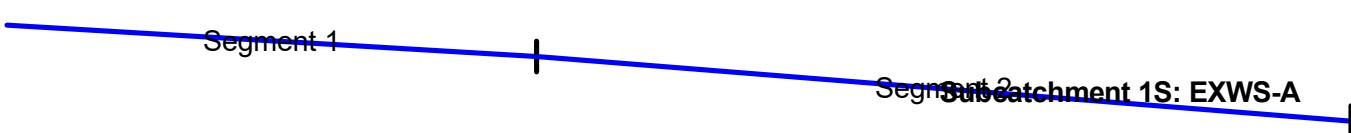

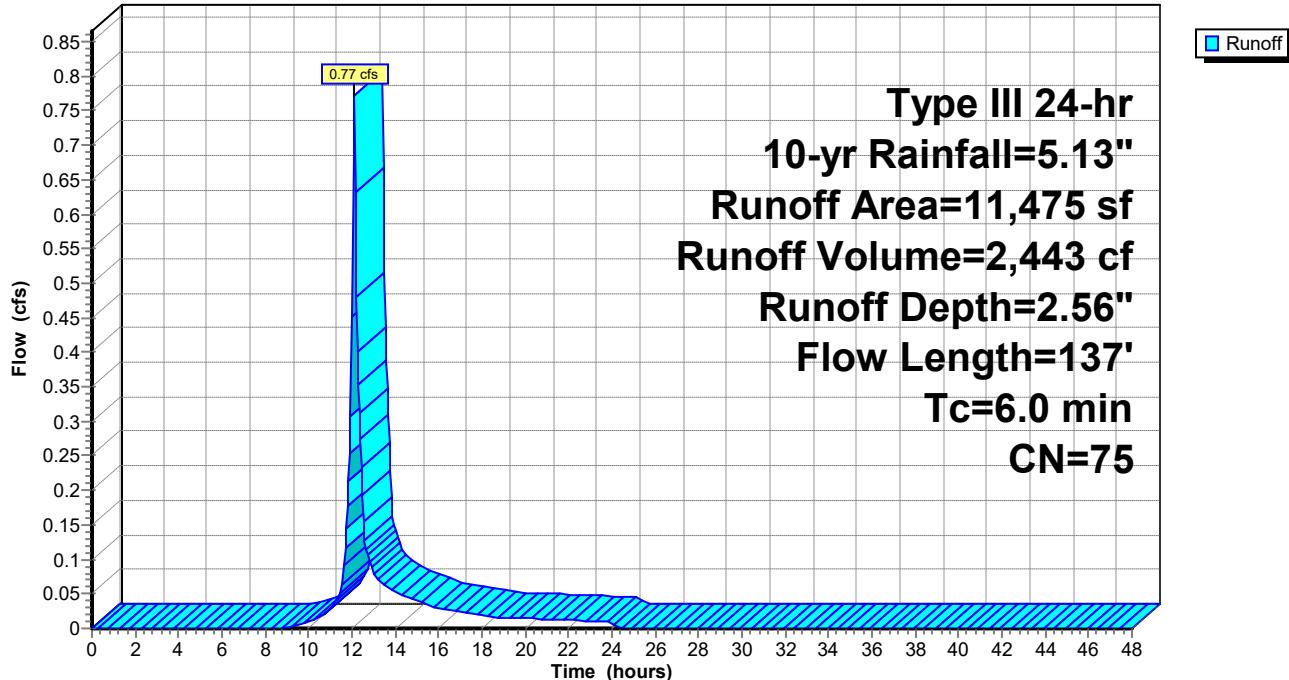Subcatchment 1S: EXWS-A**Hydrograph**

Summary for Subcatchment 2S: EXWS-B

Runoff = 0.09 cfs @ 12.11 hrs, Volume= 347 cf, Depth= 1.11"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-yr Rainfall=5.13"


Area (sf)	CN	Description
2,844	49	50-75% Grass cover, Fair, HSG A
770	77	Brush, Fair, HSG D
99	84	50-75% Grass cover, Fair, HSG D
36	98	Paved parking, HSG D
3,749	56	Weighted Average
3,713		99.04% Pervious Area
36		0.96% Impervious Area

Tc	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.4	68	0.0250	0.18		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"



Subcatchment 2S: EXWS-B

Hydrograph

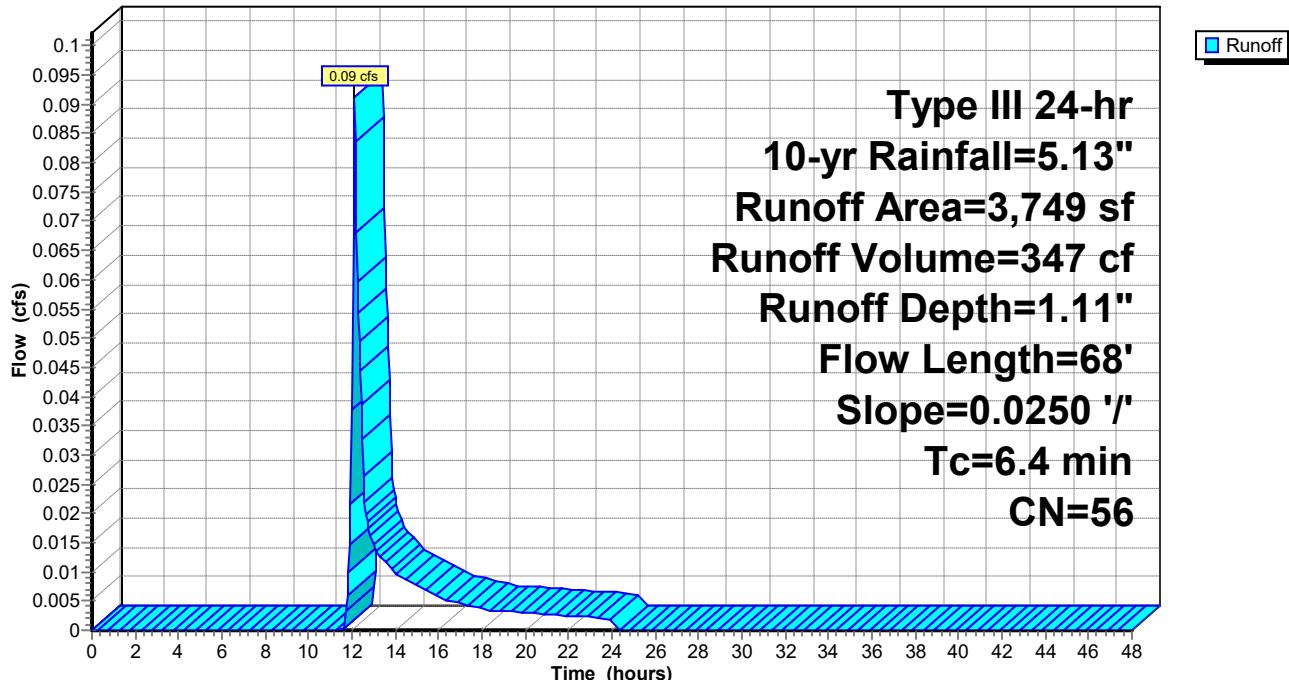

Summary for Subcatchment 3S: EXWS-C

Runoff = 5.91 cfs @ 12.09 hrs, Volume= 19,947 cf, Depth= 4.33"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-yr Rainfall=5.13"


Area (sf)	CN	Description
4,754	49	50-75% Grass cover, Fair, HSG A
3,923	84	50-75% Grass cover, Fair, HSG D
662	77	Brush, Fair, HSG D
45,997	98	Paved parking, HSG A
55,336	93	Weighted Average
9,339		16.88% Pervious Area
45,997		83.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	150	0.0200	1.54		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
0.5	86	0.0200	2.87		Shallow Concentrated Flow, Segment 2 Paved Kv= 20.3 fps
0.1	12	0.0200	2.12		Shallow Concentrated Flow, Segment 3 Grassed Waterway Kv= 15.0 fps
2.2	248	Total, Increased to minimum Tc = 6.0 min			

Segment 1

Subcatchment 3S: EXWS-C


Segment 2 Segment 3

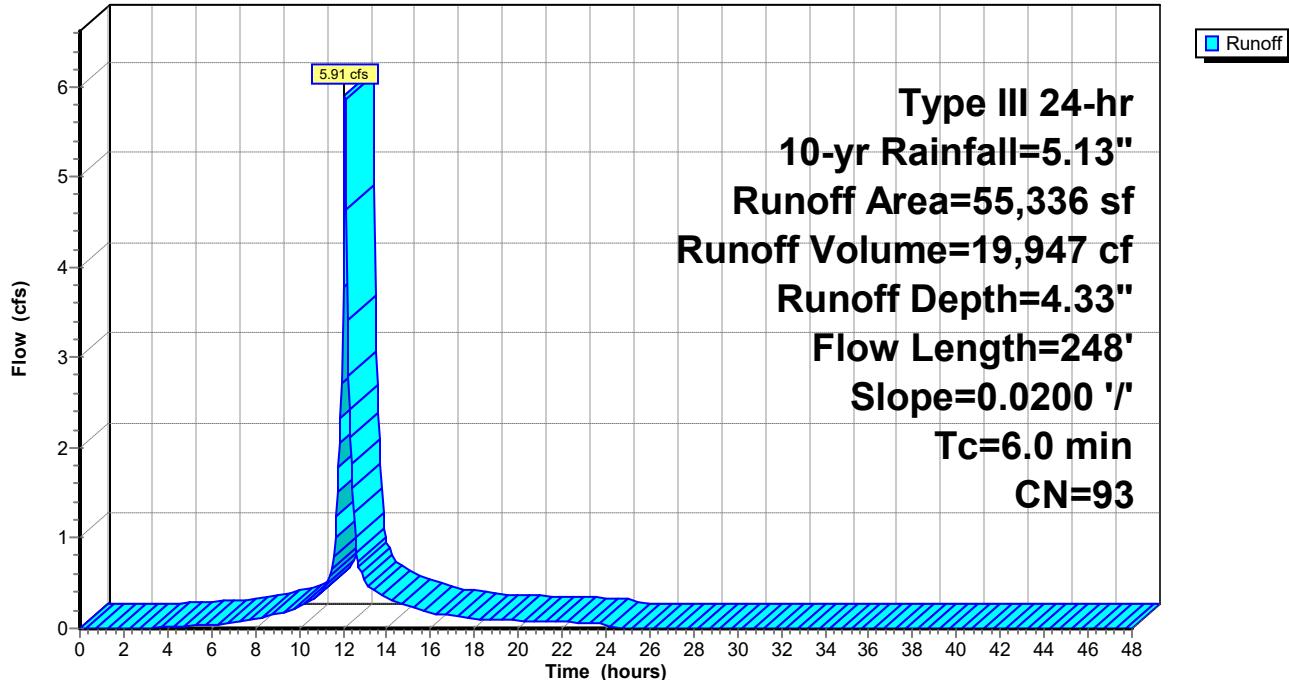Subcatchment 3S: EXWS-C**Hydrograph**

Summary for Link SITE: Total Site

Inflow Area = 70,560 sf, 73.82% Impervious, Inflow Depth = 3.87" for 10-yr event
Inflow = 6.76 cfs @ 12.09 hrs, Volume= 22,737 cf
Primary = 6.76 cfs @ 12.09 hrs, Volume= 22,737 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

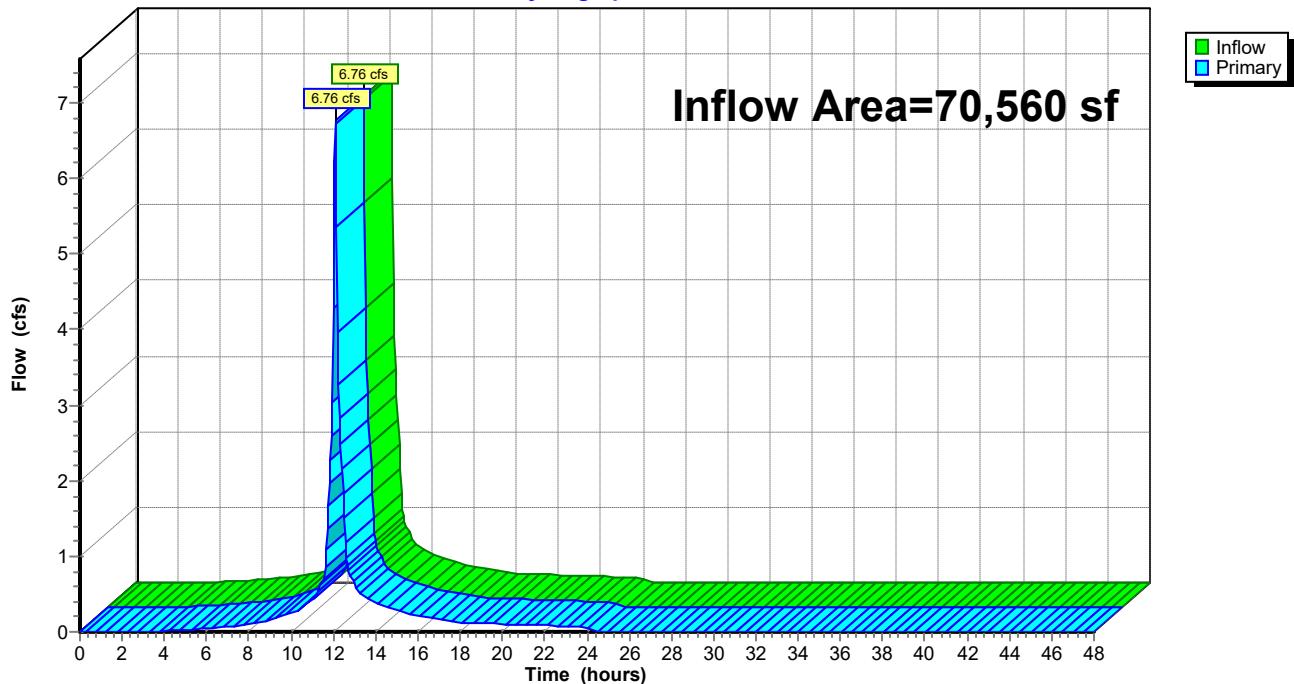Link SITE: Total Site**Hydrograph**

Time span=0.00-48.00 hrs, dt=0.05 hrs, 961 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EXWS-A

Runoff Area=11,475 sf 52.74% Impervious Runoff Depth=3.43"
Flow Length=137' Tc=6.0 min CN=75 Runoff=1.04 cfs 3,277 cf

Subcatchment 2S: EXWS-B

Runoff Area=3,749 sf 0.96% Impervious Runoff Depth=1.70"
Flow Length=68' Slope=0.0250 '/' Tc=6.4 min CN=56 Runoff=0.15 cfs 530 cf

Subcatchment 3S: EXWS-C

Runoff Area=55,336 sf 83.12% Impervious Runoff Depth=5.35"
Flow Length=248' Slope=0.0200 '/' Tc=6.0 min CN=93 Runoff=7.22 cfs 24,673 cf

Link SITE: Total Site

Inflow=8.40 cfs 28,480 cf
Primary=8.40 cfs 28,480 cf

Total Runoff Area = 70,560 sf Runoff Volume = 28,480 cf Average Runoff Depth = 4.84"
26.18% Pervious = 18,475 sf 73.82% Impervious = 52,085 sf


Summary for Subcatchment 1S: EXWS-A


Runoff = 1.04 cfs @ 12.09 hrs, Volume= 3,277 cf, Depth= 3.43"
Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 25-yr Rainfall=6.17"

Area (sf)	CN	Description
5,423	49	50-75% Grass cover, Fair, HSG A
6,052	98	Paved parking, HSG A
11,475	75	Weighted Average
5,423		47.26% Pervious Area
6,052		52.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	54	0.0075	0.85		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
0.3	83	0.0100	4.50	1.57	Pipe Channel, Segment 2 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
1.4	137				Total, Increased to minimum Tc = 6.0 min

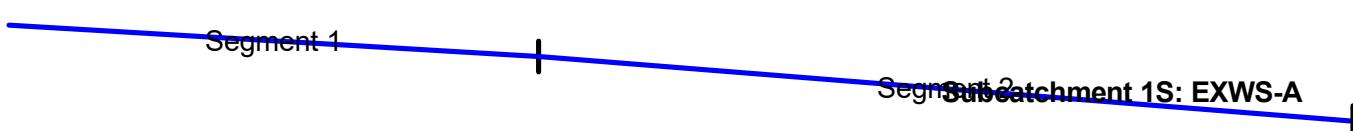

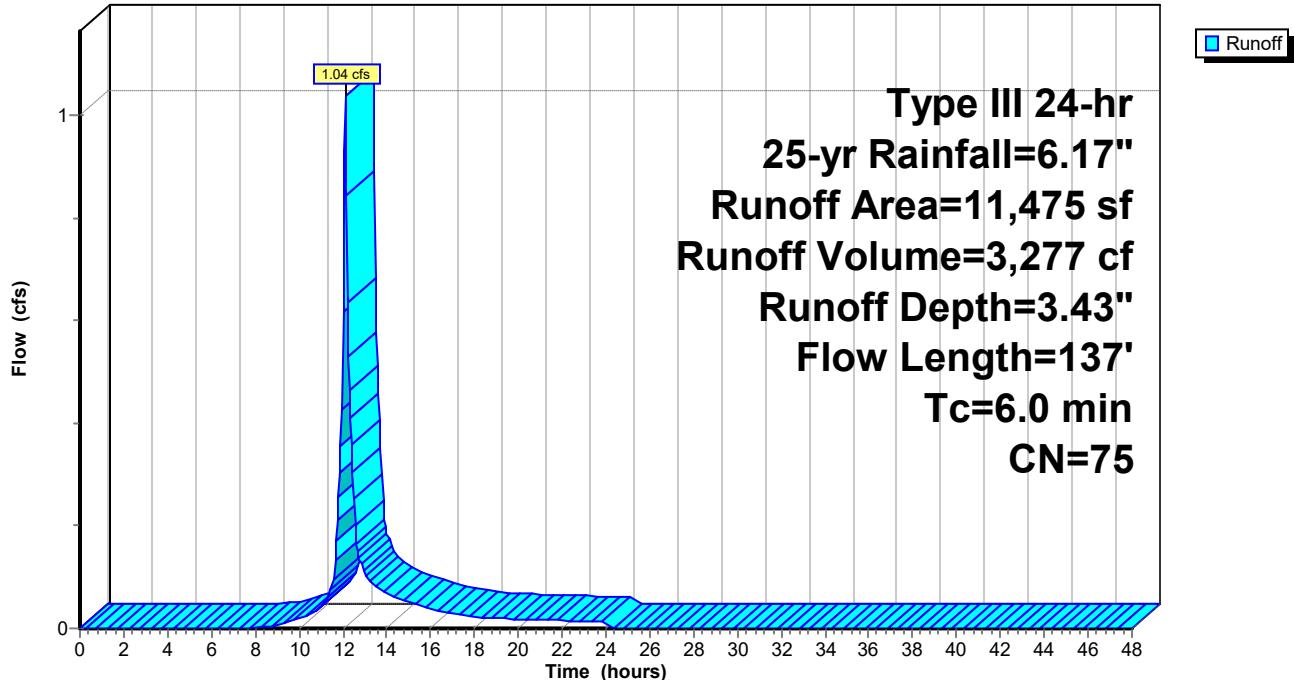Subcatchment 1S: EXWS-A**Hydrograph**

Summary for Subcatchment 2S: EXWS-B

Runoff = 0.15 cfs @ 12.11 hrs, Volume= 530 cf, Depth= 1.70"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25-yr Rainfall=6.17"

Area (sf)	CN	Description
2,844	49	50-75% Grass cover, Fair, HSG A
770	77	Brush, Fair, HSG D
99	84	50-75% Grass cover, Fair, HSG D
36	98	Paved parking, HSG D


3,749	56	Weighted Average
3,713		99.04% Pervious Area
36		0.96% Impervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
6.4	68	0.0250	0.18	Sheet Flow, Segment 1	
				Grass: Short n= 0.150 P2= 3.43"	



Subcatchment 2S: EXWS-B

Hydrograph

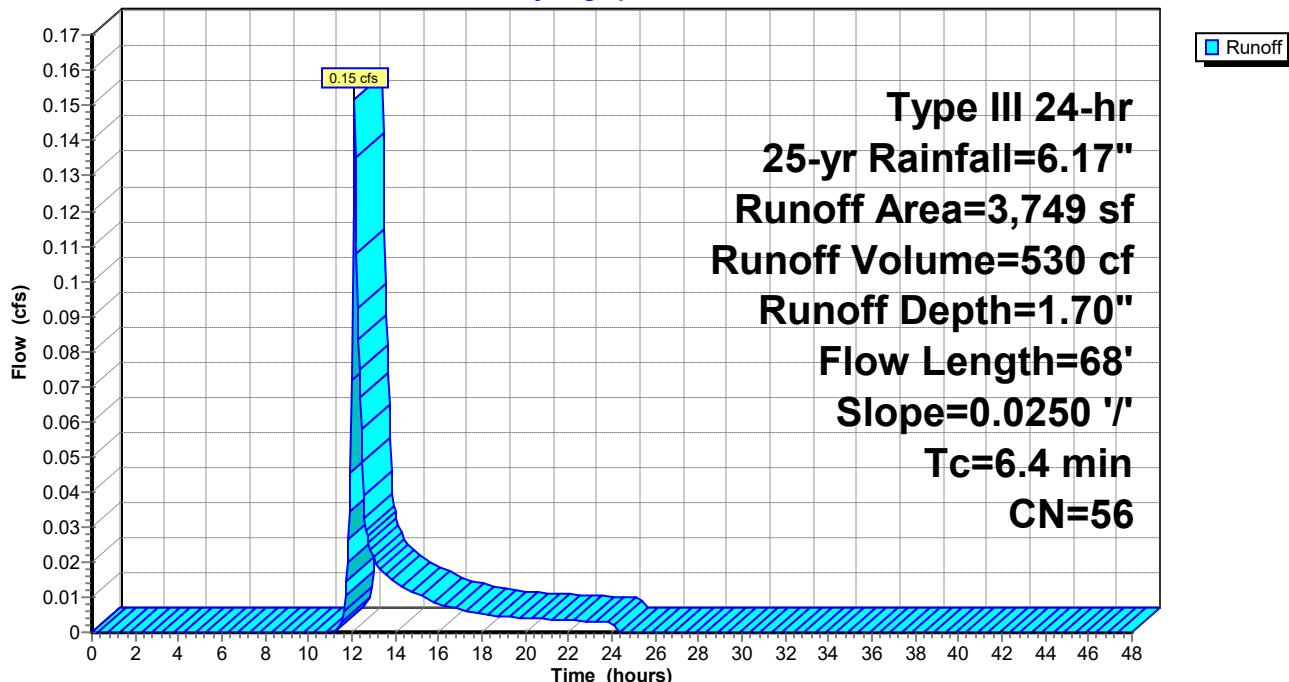

Summary for Subcatchment 3S: EXWS-C

Runoff = 7.22 cfs @ 12.09 hrs, Volume= 24,673 cf, Depth= 5.35"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25-yr Rainfall=6.17"


Area (sf)	CN	Description
4,754	49	50-75% Grass cover, Fair, HSG A
3,923	84	50-75% Grass cover, Fair, HSG D
662	77	Brush, Fair, HSG D
45,997	98	Paved parking, HSG A
55,336	93	Weighted Average
9,339		16.88% Pervious Area
45,997		83.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	150	0.0200	1.54		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
0.5	86	0.0200	2.87		Shallow Concentrated Flow, Segment 2 Paved Kv= 20.3 fps
0.1	12	0.0200	2.12		Shallow Concentrated Flow, Segment 3 Grassed Waterway Kv= 15.0 fps
2.2	248	Total, Increased to minimum Tc = 6.0 min			

Segment 1

Subcatchment 3S: EXWS-C


Segment 2 Segment 3

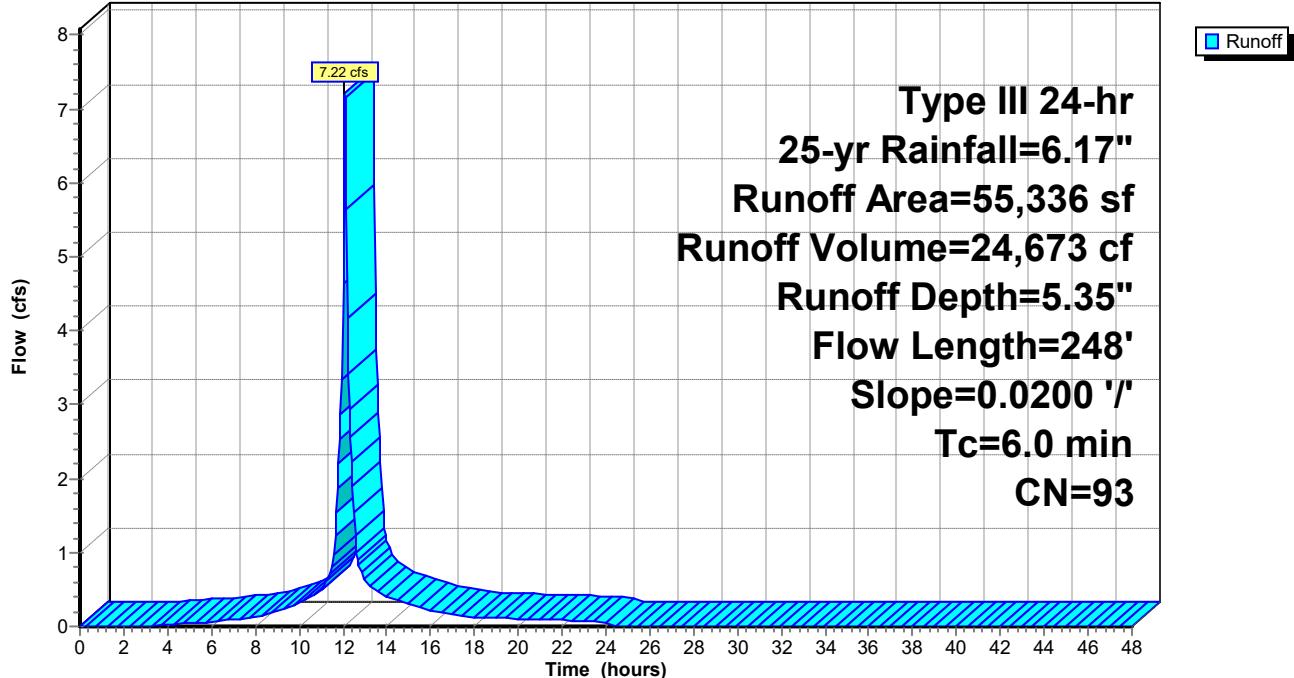Subcatchment 3S: EXWS-C**Hydrograph**

Summary for Link SITE: Total Site

Inflow Area = 70,560 sf, 73.82% Impervious, Inflow Depth = 4.84" for 25-yr event
Inflow = 8.40 cfs @ 12.09 hrs, Volume= 28,480 cf
Primary = 8.40 cfs @ 12.09 hrs, Volume= 28,480 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

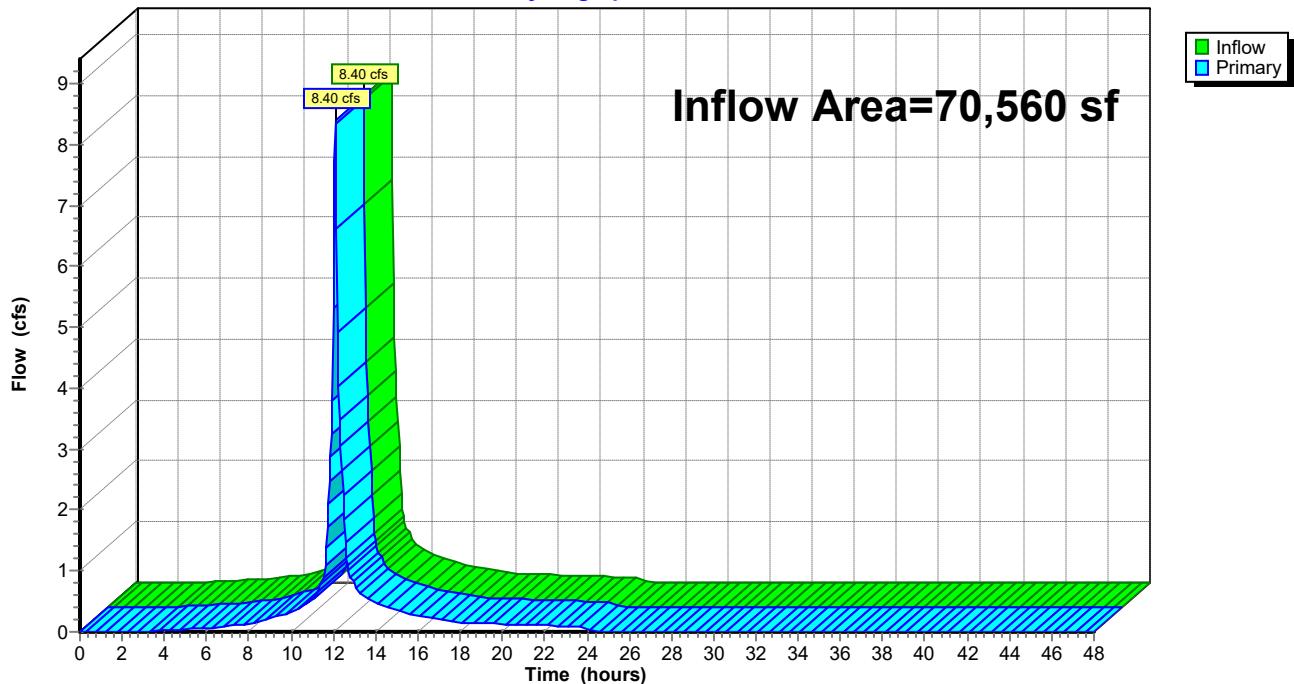Link SITE: Total Site**Hydrograph**

Time span=0.00-48.00 hrs, dt=0.05 hrs, 961 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EXWS-A

Runoff Area=11,475 sf 52.74% Impervious Runoff Depth=4.85"
Flow Length=137' Tc=6.0 min CN=75 Runoff=1.46 cfs 4,640 cf

Subcatchment 2S: EXWS-B

Runoff Area=3,749 sf 0.96% Impervious Runoff Depth=2.75"
Flow Length=68' Slope=0.0250 '/' Tc=6.4 min CN=56 Runoff=0.26 cfs 858 cf

Subcatchment 3S: EXWS-C

Runoff Area=55,336 sf 83.12% Impervious Runoff Depth=6.95"
Flow Length=248' Slope=0.0200 '/' Tc=6.0 min CN=93 Runoff=9.24 cfs 32,069 cf

Link SITE: Total Site

Inflow=10.96 cfs 37,567 cf
Primary=10.96 cfs 37,567 cf

Total Runoff Area = 70,560 sf Runoff Volume = 37,567 cf Average Runoff Depth = 6.39"
26.18% Pervious = 18,475 sf 73.82% Impervious = 52,085 sf


Summary for Subcatchment 1S: EXWS-A


Runoff = 1.46 cfs @ 12.09 hrs, Volume= 4,640 cf, Depth= 4.85"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-yr Rainfall=7.79"

Area (sf)	CN	Description
5,423	49	50-75% Grass cover, Fair, HSG A
6,052	98	Paved parking, HSG A
11,475	75	Weighted Average
5,423		47.26% Pervious Area
6,052		52.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	54	0.0075	0.85		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
0.3	83	0.0100	4.50	1.57	Pipe Channel, Segment 2 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.010
1.4	137				Total, Increased to minimum Tc = 6.0 min

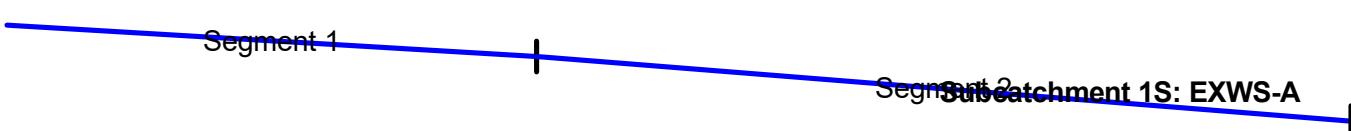

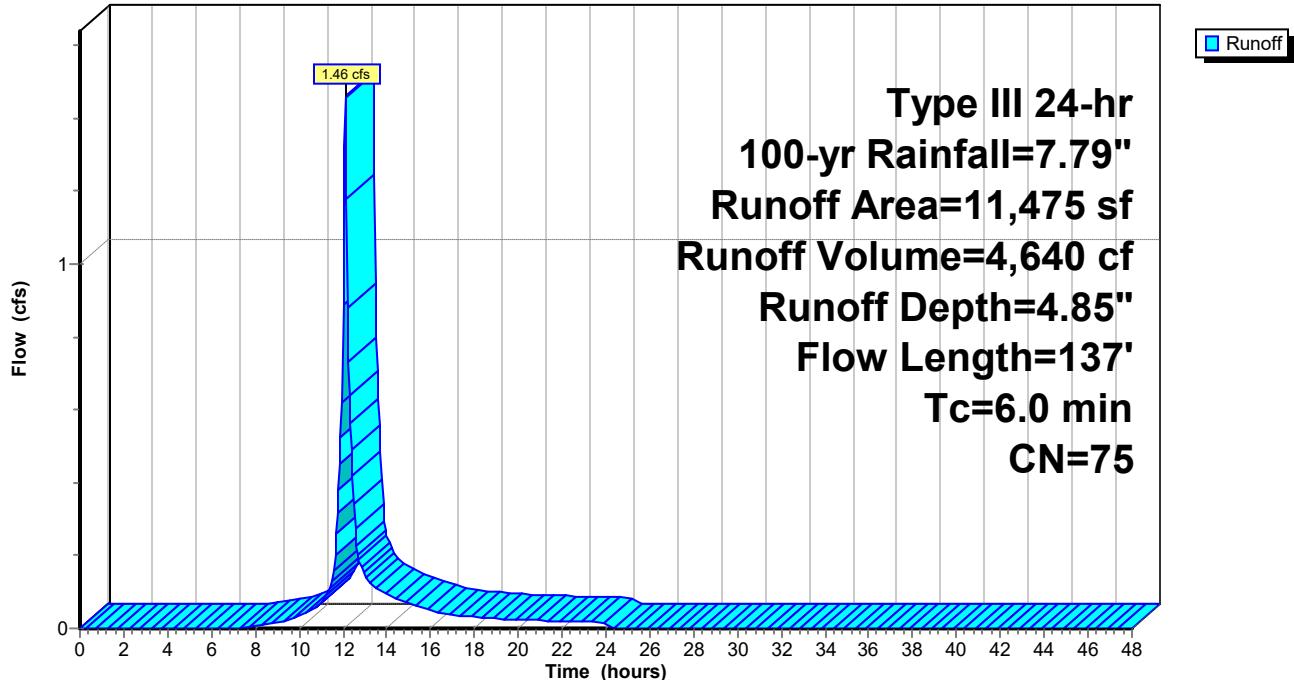Subcatchment 1S: EXWS-A**Hydrograph**

Summary for Subcatchment 2S: EXWS-B


Runoff = 0.26 cfs @ 12.10 hrs, Volume= 858 cf, Depth= 2.75"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-yr Rainfall=7.79"

Area (sf)	CN	Description
2,844	49	50-75% Grass cover, Fair, HSG A
770	77	Brush, Fair, HSG D
99	84	50-75% Grass cover, Fair, HSG D
36	98	Paved parking, HSG D

3,749	56	Weighted Average
3,713		99.04% Pervious Area
36		0.96% Impervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
6.4	68	0.0250	0.18	Sheet Flow, Segment 1	
				Grass: Short n= 0.150 P2= 3.43"	

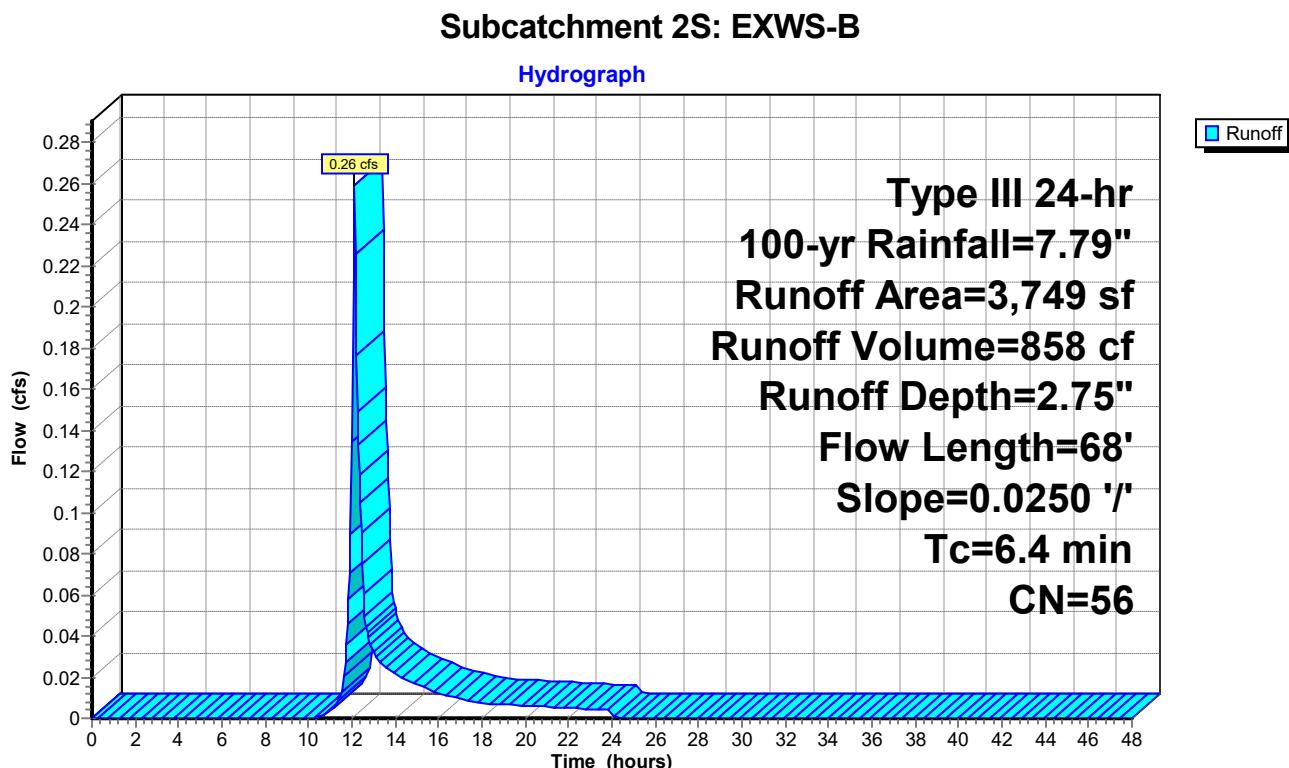

Summary for Subcatchment 3S: EXWS-C

Runoff = 9.24 cfs @ 12.09 hrs, Volume= 32,069 cf, Depth= 6.95"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-yr Rainfall=7.79"


Area (sf)	CN	Description
4,754	49	50-75% Grass cover, Fair, HSG A
3,923	84	50-75% Grass cover, Fair, HSG D
662	77	Brush, Fair, HSG D
45,997	98	Paved parking, HSG A
55,336	93	Weighted Average
9,339		16.88% Pervious Area
45,997		83.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	150	0.0200	1.54		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
0.5	86	0.0200	2.87		Shallow Concentrated Flow, Segment 2 Paved Kv= 20.3 fps
0.1	12	0.0200	2.12		Shallow Concentrated Flow, Segment 3 Grassed Waterway Kv= 15.0 fps
2.2	248	Total, Increased to minimum Tc = 6.0 min			

Segment 1

Subcatchment 3S: EXWS-C

Segment 2 Segment 3

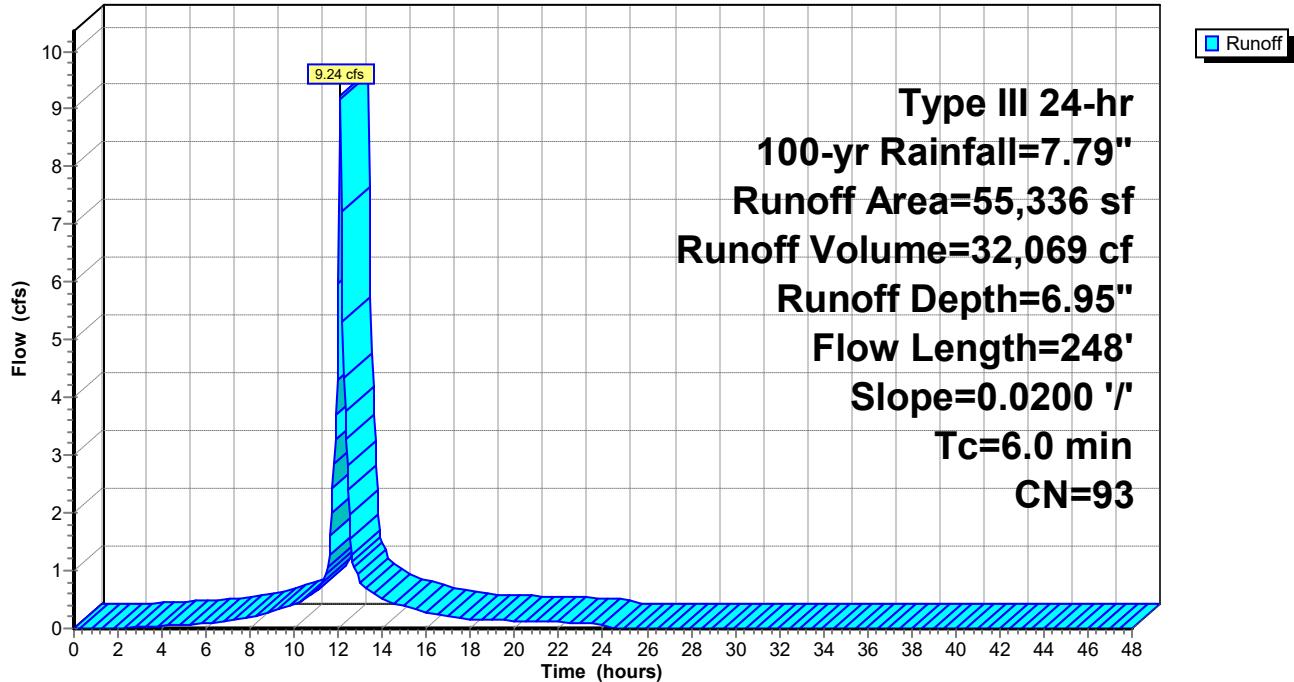Subcatchment 3S: EXWS-C**Hydrograph**


Summary for Link SITE: Total Site

Inflow Area = 70,560 sf, 73.82% Impervious, Inflow Depth = 6.39" for 100-yr event



Inflow = 10.96 cfs @ 12.09 hrs, Volume= 37,567 cf

Primary = 10.96 cfs @ 12.09 hrs, Volume= 37,567 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.05 hrs

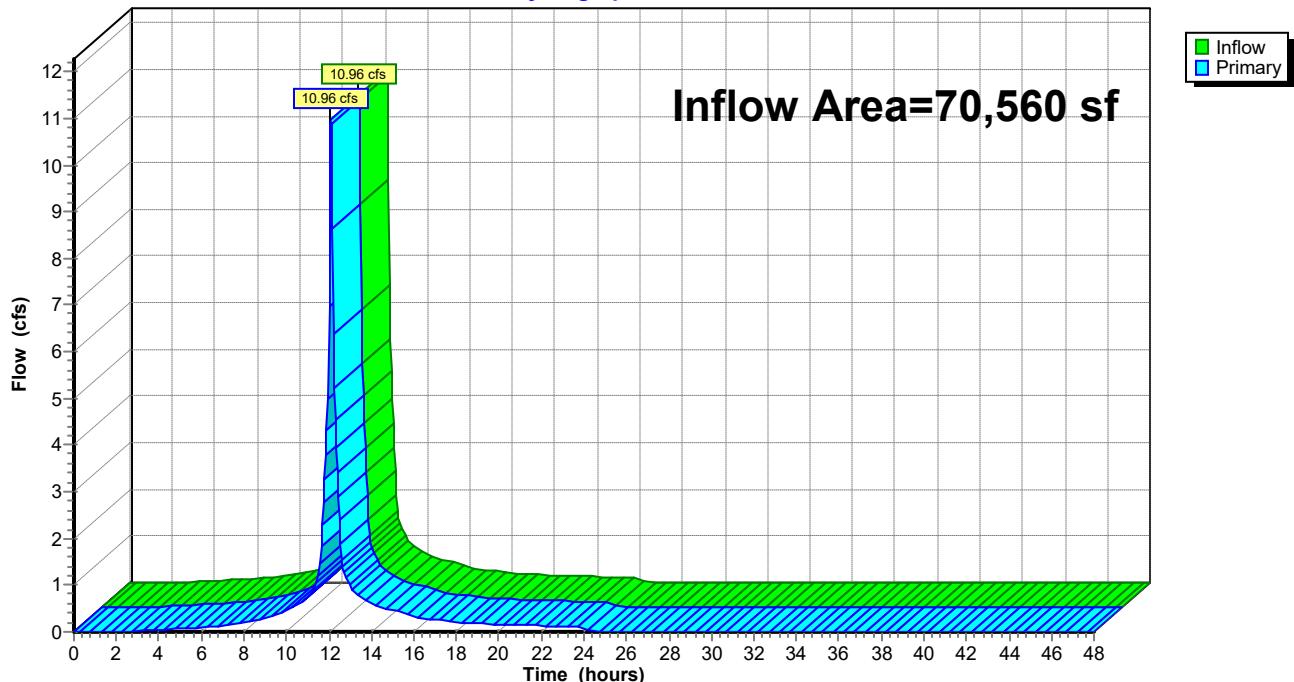Link SITE: Total Site**Hydrograph**

APPENDIX B
Proposed Stormwater Discharge Calculations

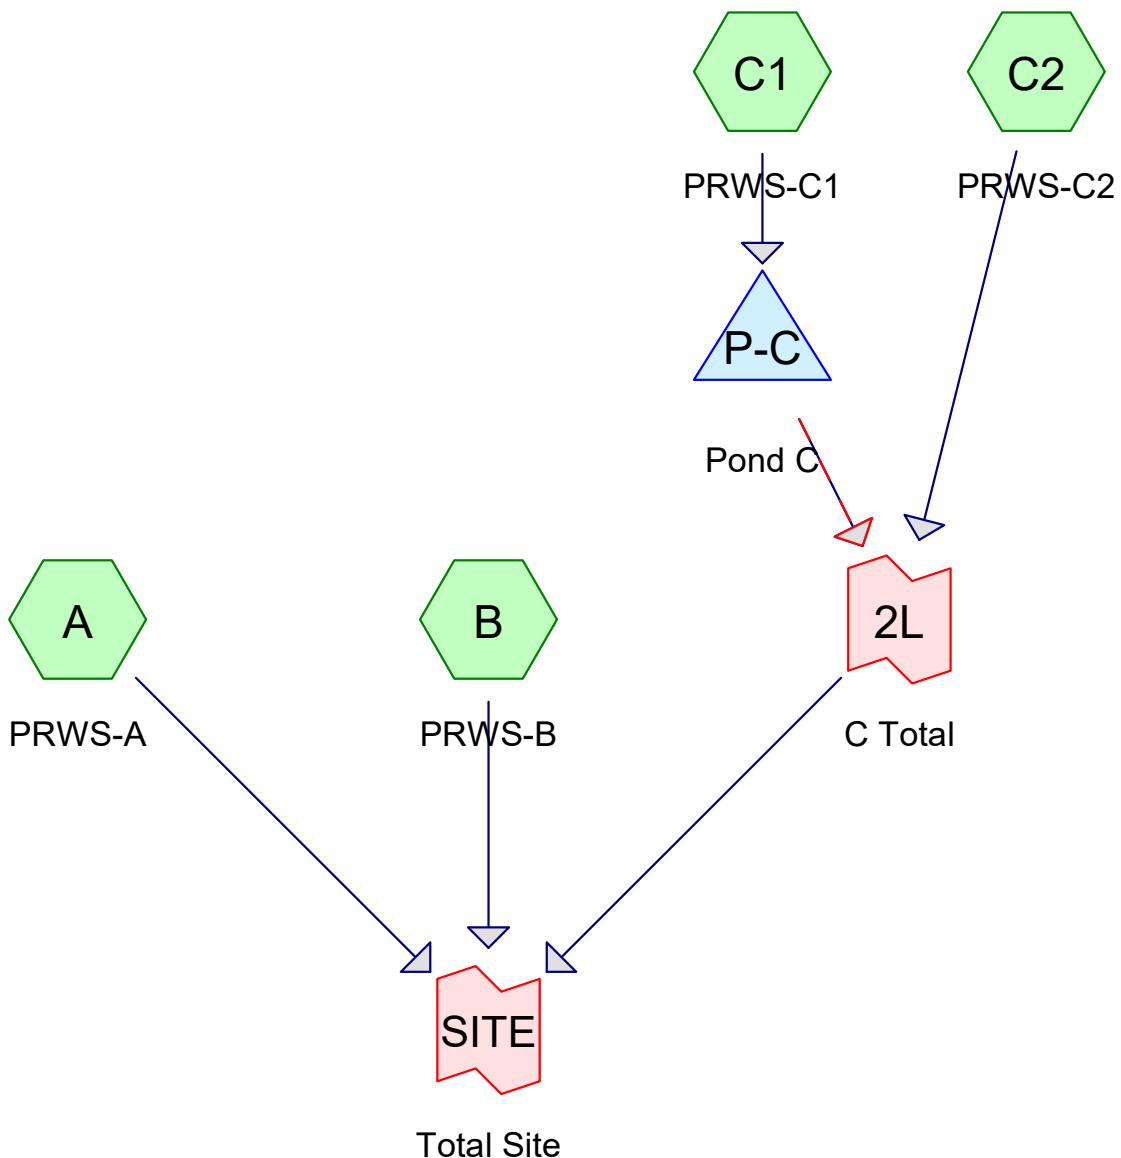

Routing Diagram for PR Hydro
Prepared by Langan Engineering, Printed 1/3/2025
HydroCAD® 10.20-6a s/n 08223 © 2024 HydroCAD Software Solutions LLC

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.652	39	>75% Grass cover, Good, HSG A (A, B, C1, C2)
0.206	80	>75% Grass cover, Good, HSG D (B, C1, C2)
0.018	77	Brush, Fair, HSG D (B)
0.013	73	Brush, Good, HSG D (C2)
0.114	98	Paved parking, HSG A (A, B)
0.617	98	Paved parking, HSG D (C1)
1.620	72	TOTAL AREA

Time span=0.00-48.00 hrs, dt=0.03 hrs, 1601 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment A: PRWS-A

Runoff Area=16,220 sf 29.90% Impervious Runoff Depth=0.40"

Flow Length=68' Slope=0.0440 '/' Tc=6.0 min CN=57 Runoff=0.09 cfs 0.012 af

Subcatchment B: PRWS-B

Runoff Area=3,874 sf 3.02% Impervious Runoff Depth=0.33"

Flow Length=45' Slope=0.0389 '/' Tc=6.0 min CN=55 Runoff=0.01 cfs 0.002 af

Subcatchment C1: PRWS-C1

Runoff Area=45,321 sf 59.33% Impervious Runoff Depth=1.46"

Flow Length=205' Tc=6.8 min CN=78 Runoff=1.70 cfs 0.127 af

Subcatchment C2: PRWS-C2

Runoff Area=5,156 sf 0.00% Impervious Runoff Depth=1.21"

Flow Length=74' Slope=0.0610 '/' Tc=6.0 min CN=74 Runoff=0.16 cfs 0.012 af

Pond P-C: Pond C

Peak Elev=32.09' Storage=2,079 cf Inflow=1.70 cfs 0.127 af

Discarded=0.09 cfs 0.102 af Primary=0.29 cfs 0.025 af Secondary=0.00 cfs 0.000 af Outflow=0.38 cfs 0.127 af

Link 2L: C Total

Inflow=0.32 cfs 0.037 af

Primary=0.32 cfs 0.037 af

Link SITE: Total Site

Inflow=0.38 cfs 0.052 af

Primary=0.38 cfs 0.052 af

Total Runoff Area = 1.620 ac Runoff Volume = 0.153 af Average Runoff Depth = 1.13"
54.86% Pervious = 0.889 ac 45.14% Impervious = 0.731 ac


Summary for Subcatchment A: PRWS-A

Runoff = 0.09 cfs @ 12.14 hrs, Volume= 0.012 af, Depth= 0.40"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 2-yr Rainfall=3.45"

Area (sf)	CN	Description
11,370	39	>75% Grass cover, Good, HSG A
4,850	98	Paved parking, HSG A
16,220	57	Weighted Average
11,370		70.10% Pervious Area
4,850		29.90% Impervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
5.1	68	0.0440	0.22		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
5.1	68				Total, Increased to minimum Tc = 6.0 min

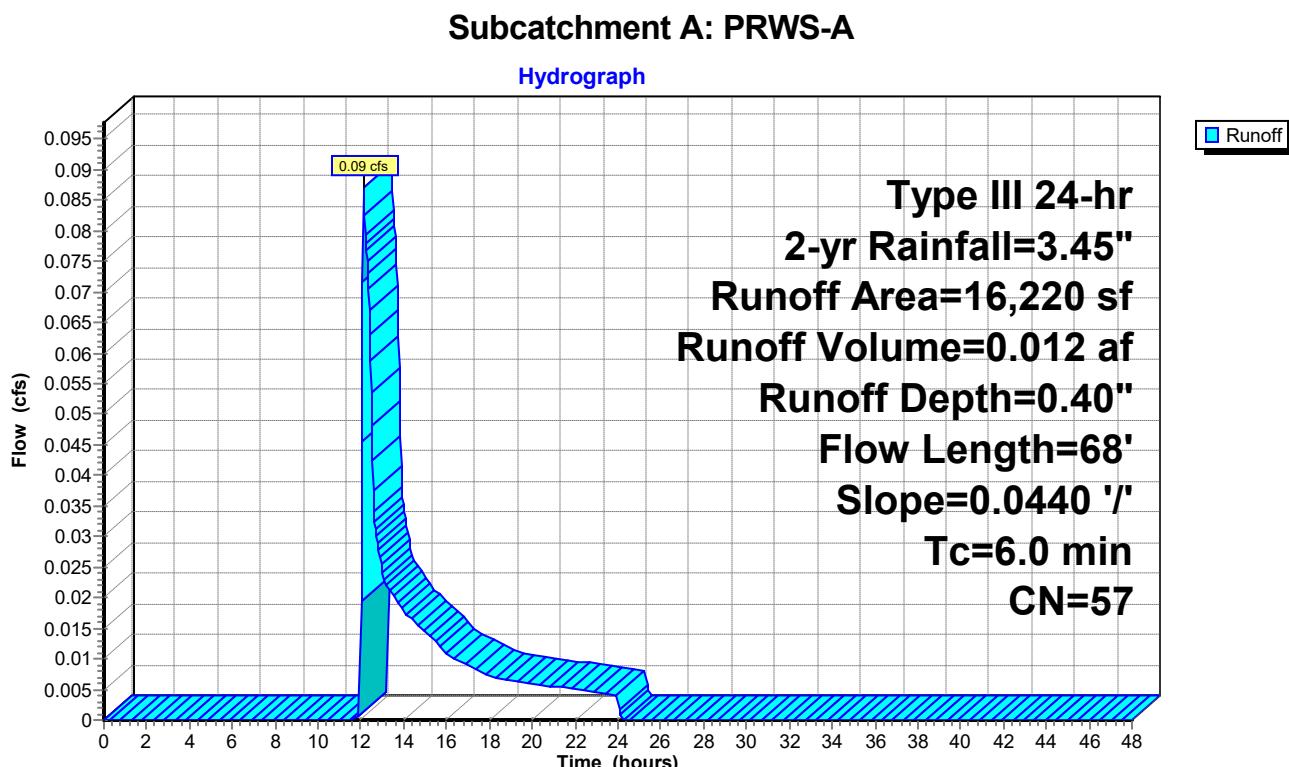

Summary for Subcatchment B: PRWS-B

Runoff = 0.01 cfs @ 12.28 hrs, Volume= 0.002 af, Depth= 0.33"
Routed to Link SITE : Total Site


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
Type III 24-hr 2-yr Rainfall=3.45"

Area (sf)	CN	Description
2,337	39	>75% Grass cover, Good, HSG A
648	80	>75% Grass cover, Good, HSG D
772	77	Brush, Fair, HSG D
117	98	Paved parking, HSG A
3,874	55	Weighted Average
3,757		96.98% Pervious Area
117		3.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.8	45	0.0389	0.20		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
3.8	45	Total, Increased to minimum Tc = 6.0 min			

Segment 1

Subcatchment B: PRWS-B

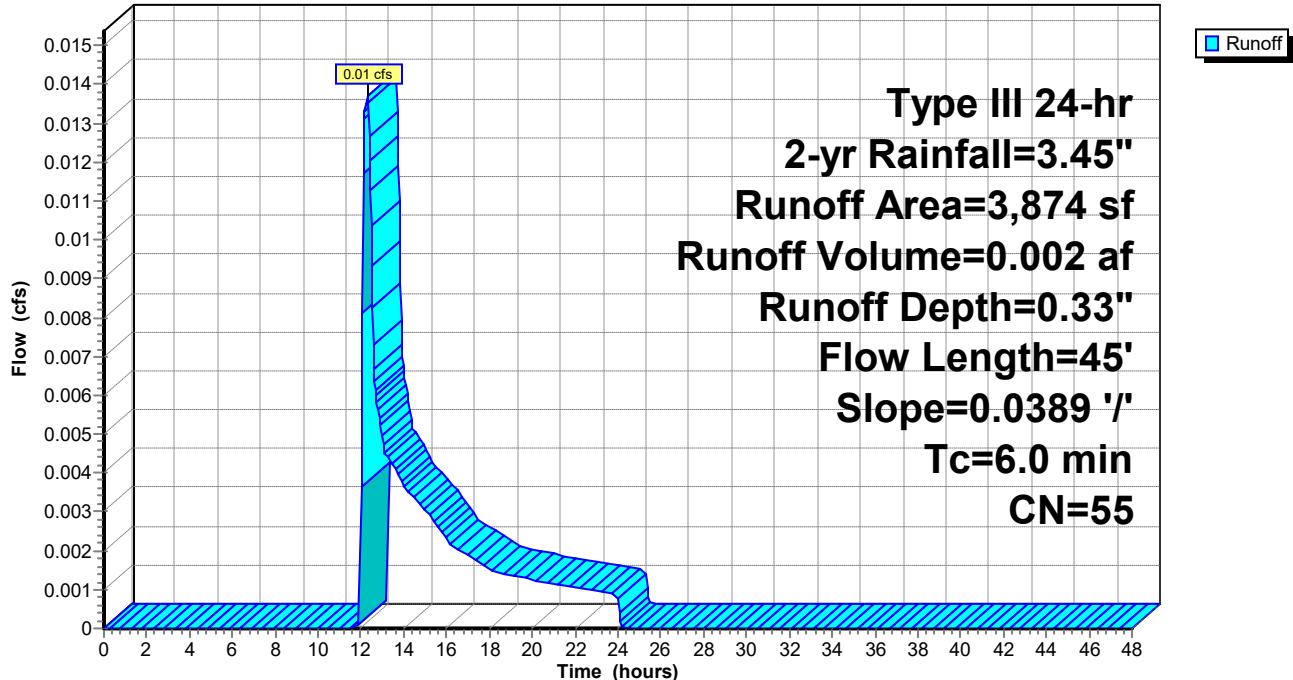Subcatchment B: PRWS-B**Hydrograph**


Summary for Subcatchment C1: PRWS-C1

Runoff = 1.70 cfs @ 12.10 hrs, Volume= 0.127 af, Depth= 1.46"
 Routed to Pond P-C : Pond C

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 2-yr Rainfall=3.45"


Area (sf)	CN	Description
4,355	80	>75% Grass cover, Good, HSG D
14,079	39	>75% Grass cover, Good, HSG A
26,887	98	Paved parking, HSG D
45,321	78	Weighted Average
18,434		40.67% Pervious Area
26,887		59.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	109	0.0250	1.58		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
5.2	41	0.0150	0.13		Sheet Flow, Segment 2 Grass: Short n= 0.150 P2= 3.43"
0.5	55	0.0150	1.84		Shallow Concentrated Flow, Segment 3 Grassed Waterway Kv= 15.0 fps
6.8	205	Total			



Subcatchment C1: PRWS-C1

Hydrograph

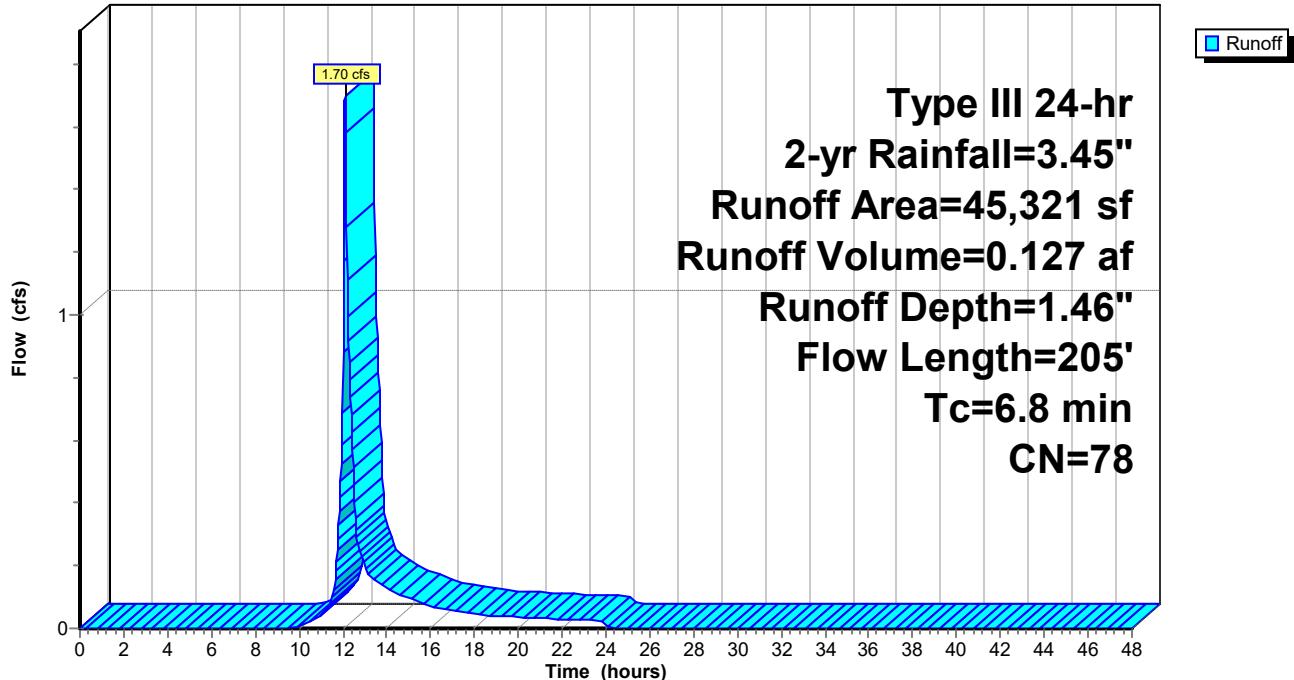

Summary for Subcatchment C2: PRWS-C2

Runoff = 0.16 cfs @ 12.10 hrs, Volume= 0.012 af, Depth= 1.21"
Routed to Link 2L : C Total

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
Type III 24-hr 2-yr Rainfall=3.45"


Area (sf)	CN	Description
557	73	Brush, Good, HSG D
3,991	80	>75% Grass cover, Good, HSG D
608	39	>75% Grass cover, Good, HSG A
5,156	74	Weighted Average
5,156		100.00% Pervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
4.8	74	0.0610	0.26		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
4.8	74				Total, Increased to minimum Tc = 6.0 min



Subcatchment C2: PRWS-C2

Hydrograph

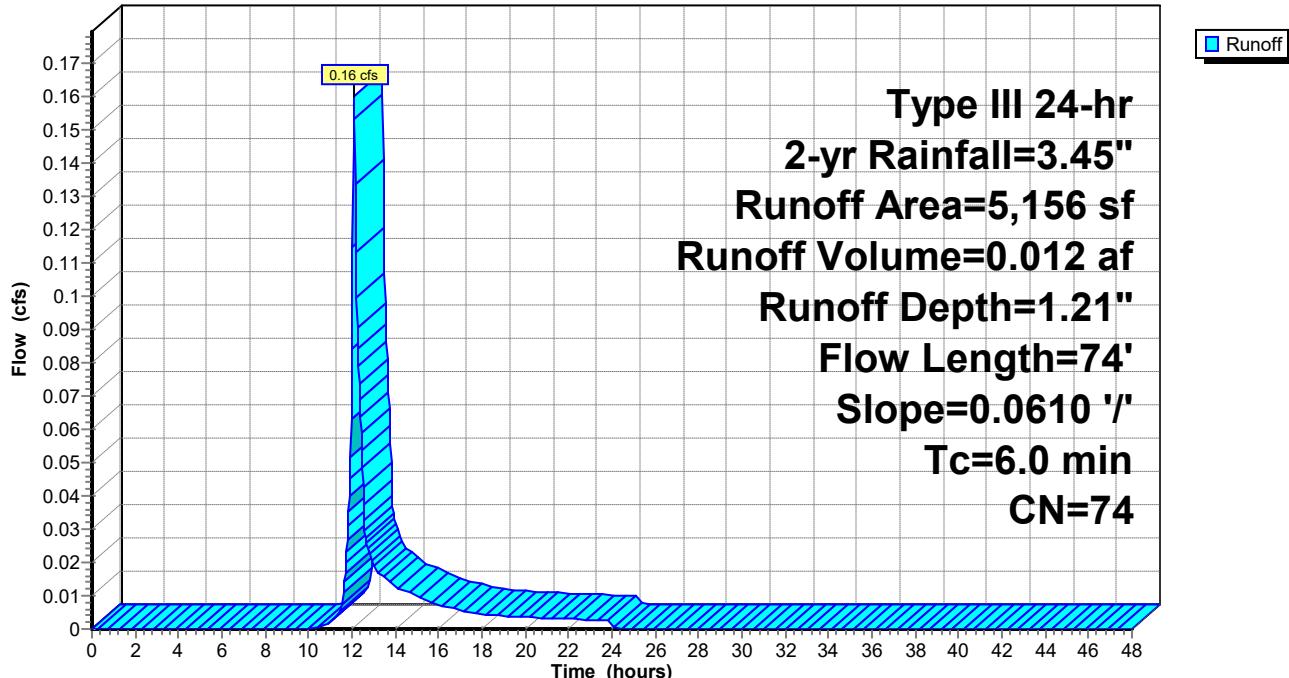

Summary for Pond P-C: Pond C

Inflow Area = 1.040 ac, 59.33% Impervious, Inflow Depth = 1.46" for 2-yr event
 Inflow = 1.70 cfs @ 12.10 hrs, Volume= 0.127 af
 Outflow = 0.38 cfs @ 12.56 hrs, Volume= 0.127 af, Atten= 78%, Lag= 27.2 min
 Discarded = 0.09 cfs @ 12.56 hrs, Volume= 0.102 af
 Primary = 0.29 cfs @ 12.56 hrs, Volume= 0.025 af
 Routed to Link 2L : C Total
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Link 2L : C Total

Routing by Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Peak Elev= 32.09' @ 12.56 hrs Surf.Area= 3,914 sf Storage= 2,079 cf



Plug-Flow detention time= 185.8 min calculated for 0.126 af (100% of inflow)
 Center-of-Mass det. time= 185.7 min (1,031.6 - 845.9)

Volume	Invert	Avail.Storage	Storage Description	
#1	31.50'	6,050 cf	Custom Stage Data (Conic) Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
31.50	3,128	0	0	3,128
32.50	4,507	3,797	3,797	4,524
33.00	4,507	2,254	6,050	4,643
Device	Routing	Invert	Outlet Devices	
#1	Discarded	31.50'	1.000 in/hr Exfiltration over Wetted area	
#2	Primary	30.50'	12.0" Round Culvert L= 30.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 30.50' / 30.20' S= 0.0100 '/' Cc= 0.900 n= 0.010, Flow Area= 0.79 sf	
#3	Device 2	32.00'	12.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads	
#4	Secondary	32.25'	10.0' long x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88	

Discarded OutFlow Max=0.09 cfs @ 12.56 hrs HW=32.09' (Free Discharge)
 ↑ 1=Exfiltration (Exfiltration Controls 0.09 cfs)

Primary OutFlow Max=0.28 cfs @ 12.56 hrs HW=32.09' (Free Discharge)
 ↑ 2=Culvert (Passes 0.28 cfs of 3.12 cfs potential flow)
 ↑ 3=Orifice/Grate (Weir Controls 0.28 cfs @ 0.99 fps)

Secondary OutFlow Max=0.00 cfs @ 0.00 hrs HW=31.50' (Free Discharge)
 ↑ 4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

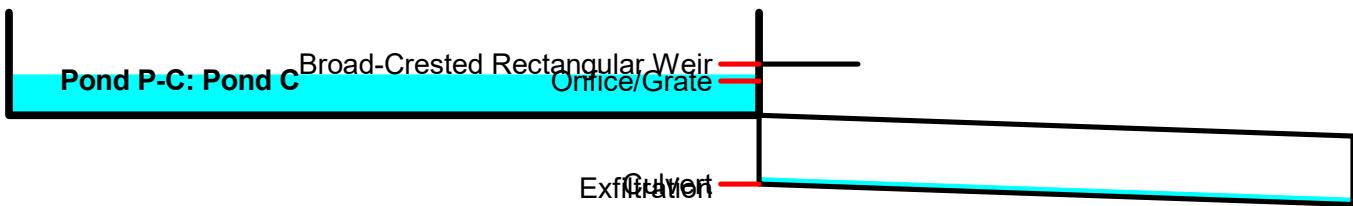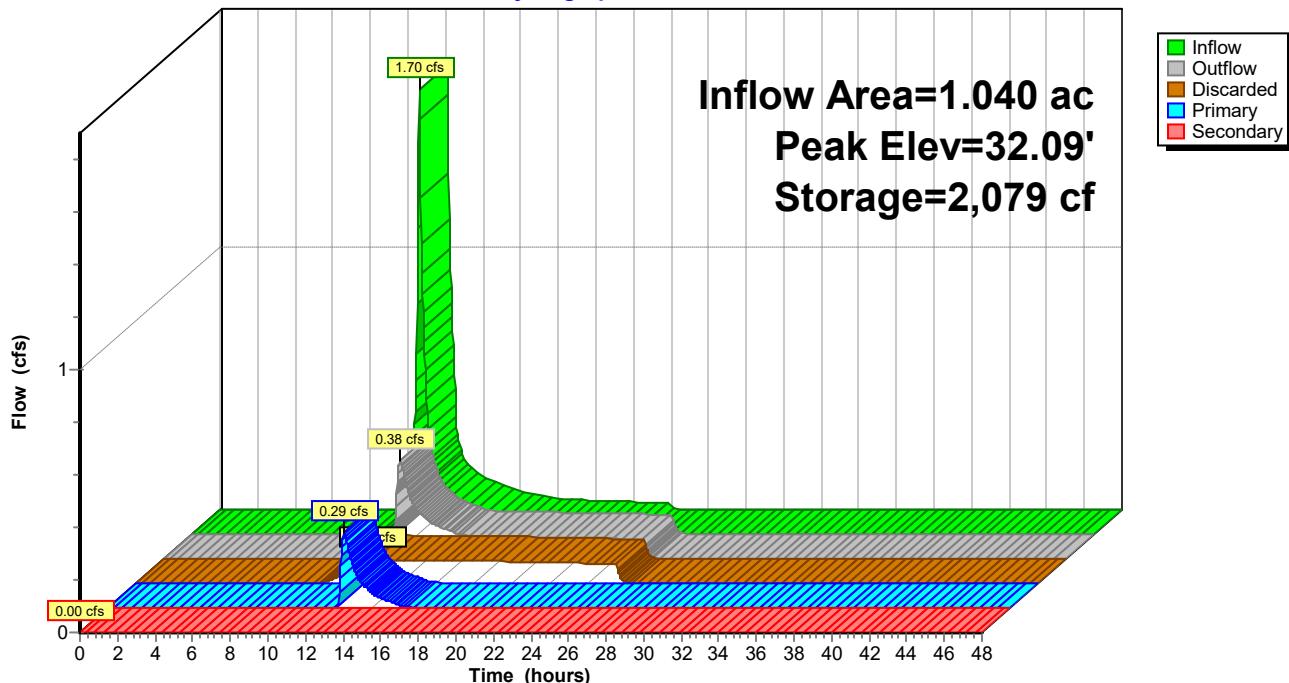**Pond P-C: Pond C****Hydrograph**

Stage-Discharge for Pond P-C: Pond C

Elevation (feet)	Discharge (cfs)	Discarded (cfs)	Primary (cfs)	Secondary (cfs)
31.50	0.00	0.00	0.00	0.00
31.55	0.07	0.07	0.00	0.00
31.60	0.08	0.08	0.00	0.00
31.65	0.08	0.08	0.00	0.00
31.70	0.08	0.08	0.00	0.00
31.75	0.08	0.08	0.00	0.00
31.80	0.08	0.08	0.00	0.00
31.85	0.08	0.08	0.00	0.00
31.90	0.08	0.08	0.00	0.00
31.95	0.09	0.09	0.00	0.00
32.00	0.09	0.09	0.00	0.00
32.05	0.20	0.09	0.11	0.00
32.10	0.42	0.09	0.32	0.00
32.15	0.69	0.09	0.60	0.00
32.20	1.01	0.09	0.92	0.00
32.25	1.38	0.10	1.28	0.00
32.30	2.05	0.10	1.69	0.26
32.35	2.97	0.10	2.13	0.74
32.40	3.85	0.10	2.39	1.36
32.45	4.73	0.10	2.54	2.09
32.50	5.75	0.10	2.67	2.97
32.55	6.89	0.11	2.80	3.98
32.60	8.13	0.11	2.93	5.09
32.65	9.48	0.11	3.05	6.32
32.70	10.97	0.11	3.16	7.70
32.75	12.57	0.11	3.28	9.19
32.80	14.30	0.11	3.38	10.81
32.85	16.14	0.11	3.49	12.55
32.90	17.82	0.11	3.59	14.12
32.95	19.55	0.11	3.69	15.75
33.00	21.33	0.11	3.78	17.44

Stage-Area-Storage for Pond P-C: Pond C

Elevation (feet)	Surface (sq-ft)	Wetted (sq-ft)	Storage (cubic-feet)
31.50	3,128	3,128	0
31.55	3,191	3,192	158
31.60	3,255	3,256	319
31.65	3,319	3,321	483
31.70	3,384	3,387	651
31.75	3,449	3,453	822
31.80	3,515	3,520	996
31.85	3,582	3,588	1,173
31.90	3,649	3,656	1,354
31.95	3,717	3,725	1,538
32.00	3,786	3,794	1,726
32.05	3,855	3,864	1,917
32.10	3,925	3,935	2,111
32.15	3,996	4,007	2,309
32.20	4,067	4,079	2,511
32.25	4,139	4,151	2,716
32.30	4,211	4,225	2,925
32.35	4,284	4,299	3,137
32.40	4,358	4,373	3,353
32.45	4,432	4,448	3,573
32.50	4,507	4,524	3,797
32.55	4,507	4,536	4,022
32.60	4,507	4,548	4,247
32.65	4,507	4,560	4,473
32.70	4,507	4,572	4,698
32.75	4,507	4,584	4,923
32.80	4,507	4,596	5,149
32.85	4,507	4,607	5,374
32.90	4,507	4,619	5,599
32.95	4,507	4,631	5,825
33.00	4,507	4,643	6,050

Summary for Link 2L: C Total


Inflow Area = 1.159 ac, 53.27% Impervious, Inflow Depth = 0.38" for 2-yr event

Inflow = 0.32 cfs @ 12.53 hrs, Volume= 0.037 af

Primary = 0.32 cfs @ 12.53 hrs, Volume= 0.037 af, Atten= 0%, Lag= 0.0 min

Routed to Link SITE : Total Site

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs

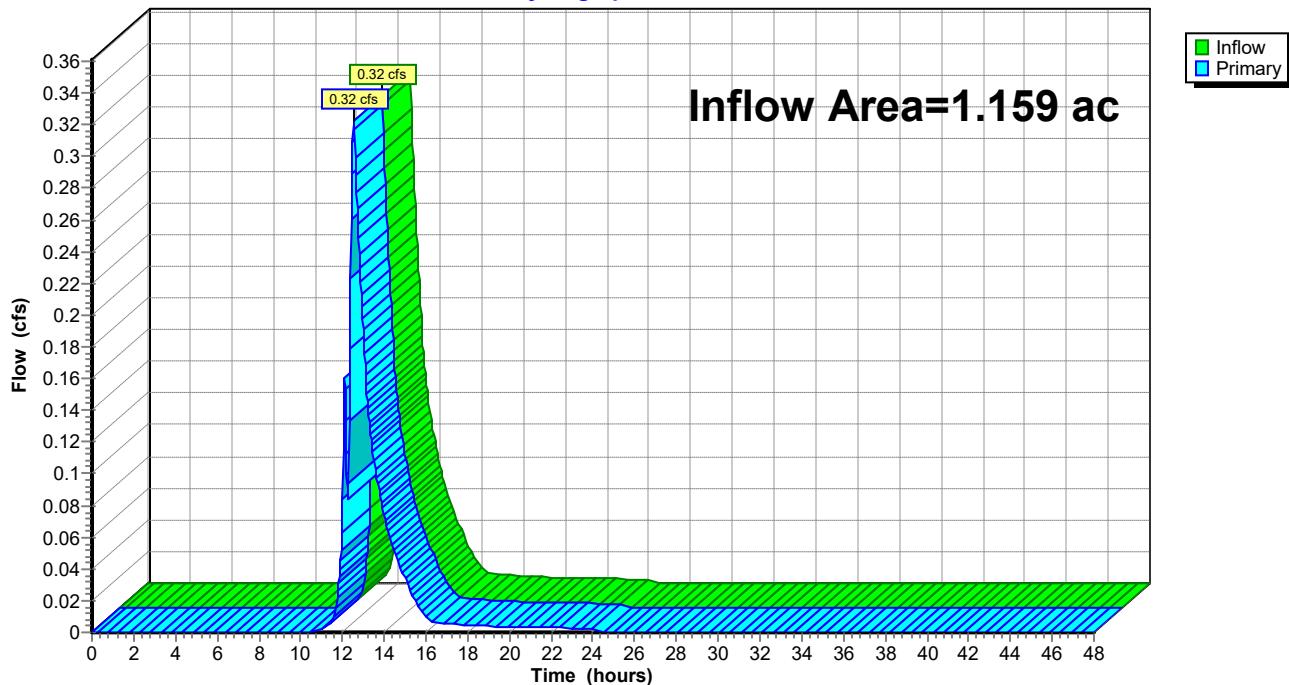Link 2L: C Total**Hydrograph**


Summary for Link SITE: Total Site

Inflow Area = 1.620 ac, 45.14% Impervious, Inflow Depth = 0.38" for 2-yr event

Inflow = 0.38 cfs @ 12.51 hrs, Volume= 0.052 af

Primary = 0.38 cfs @ 12.51 hrs, Volume= 0.052 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs

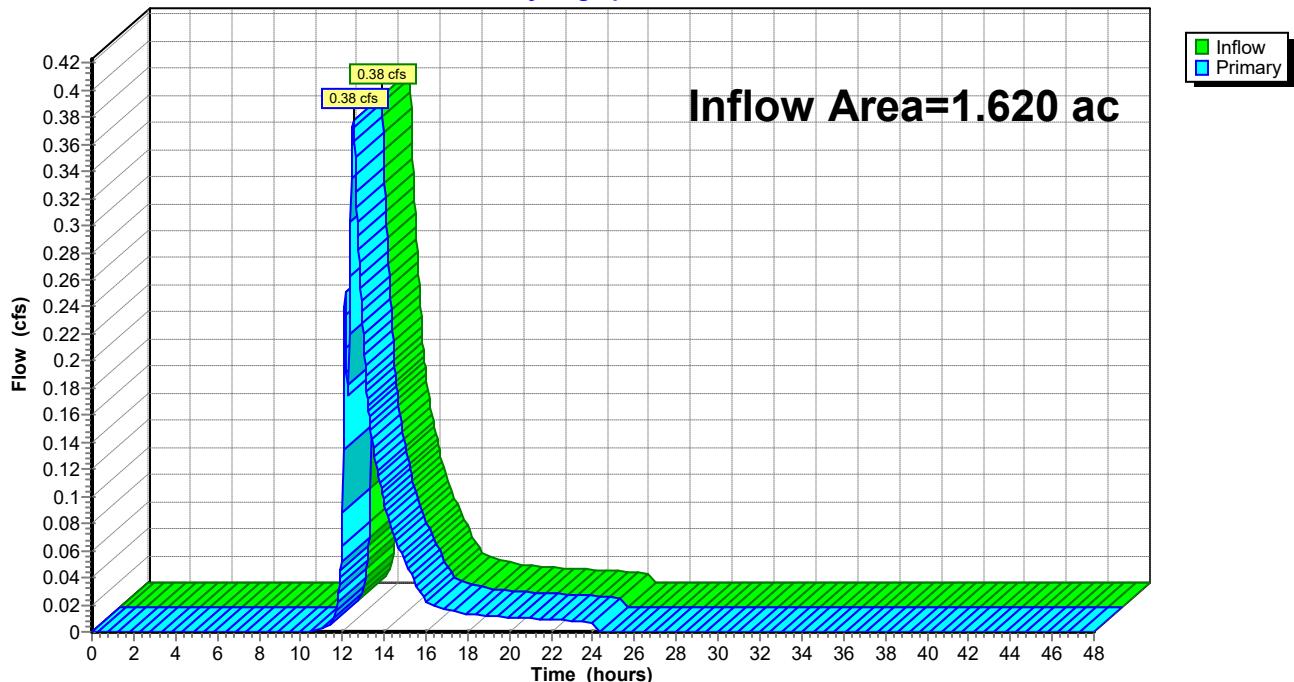Link SITE: Total Site**Hydrograph**

Time span=0.00-48.00 hrs, dt=0.03 hrs, 1601 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment A: PRWS-A

Runoff Area=16,220 sf 29.90% Impervious Runoff Depth=1.17"

Flow Length=68' Slope=0.0440 '/' Tc=6.0 min CN=57 Runoff=0.44 cfs 0.036 af

Subcatchment B: PRWS-B

Runoff Area=3,874 sf 3.02% Impervious Runoff Depth=1.05"

Flow Length=45' Slope=0.0389 '/' Tc=6.0 min CN=55 Runoff=0.09 cfs 0.008 af

Subcatchment C1: PRWS-C1

Runoff Area=45,321 sf 59.33% Impervious Runoff Depth=2.82"

Flow Length=205' Tc=6.8 min CN=78 Runoff=3.33 cfs 0.245 af

Subcatchment C2: PRWS-C2

Runoff Area=5,156 sf 0.00% Impervious Runoff Depth=2.47"

Flow Length=74' Slope=0.0610 '/' Tc=6.0 min CN=74 Runoff=0.34 cfs 0.024 af

Pond P-C: Pond C

Peak Elev=32.29' Storage=2,897 cf Inflow=3.33 cfs 0.245 af

Discarded=0.10 cfs 0.127 af Primary=1.63 cfs 0.115 af Secondary=0.21 cfs 0.003 af Outflow=1.94 cfs 0.245 af

Link 2L: C Total

Inflow=2.04 cfs 0.142 af

Primary=2.04 cfs 0.142 af

Link SITE: Total Site

Inflow=2.39 cfs 0.186 af

Primary=2.39 cfs 0.186 af

Total Runoff Area = 1.620 ac Runoff Volume = 0.313 af Average Runoff Depth = 2.32"
54.86% Pervious = 0.889 ac 45.14% Impervious = 0.731 ac


Summary for Subcatchment A: PRWS-A

Runoff = 0.44 cfs @ 12.10 hrs, Volume= 0.036 af, Depth= 1.17"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 10-yr Rainfall=5.13"

Area (sf)	CN	Description
11,370	39	>75% Grass cover, Good, HSG A
4,850	98	Paved parking, HSG A
16,220	57	Weighted Average
11,370		70.10% Pervious Area
4,850		29.90% Impervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
5.1	68	0.0440	0.22		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
5.1	68				Total, Increased to minimum Tc = 6.0 min

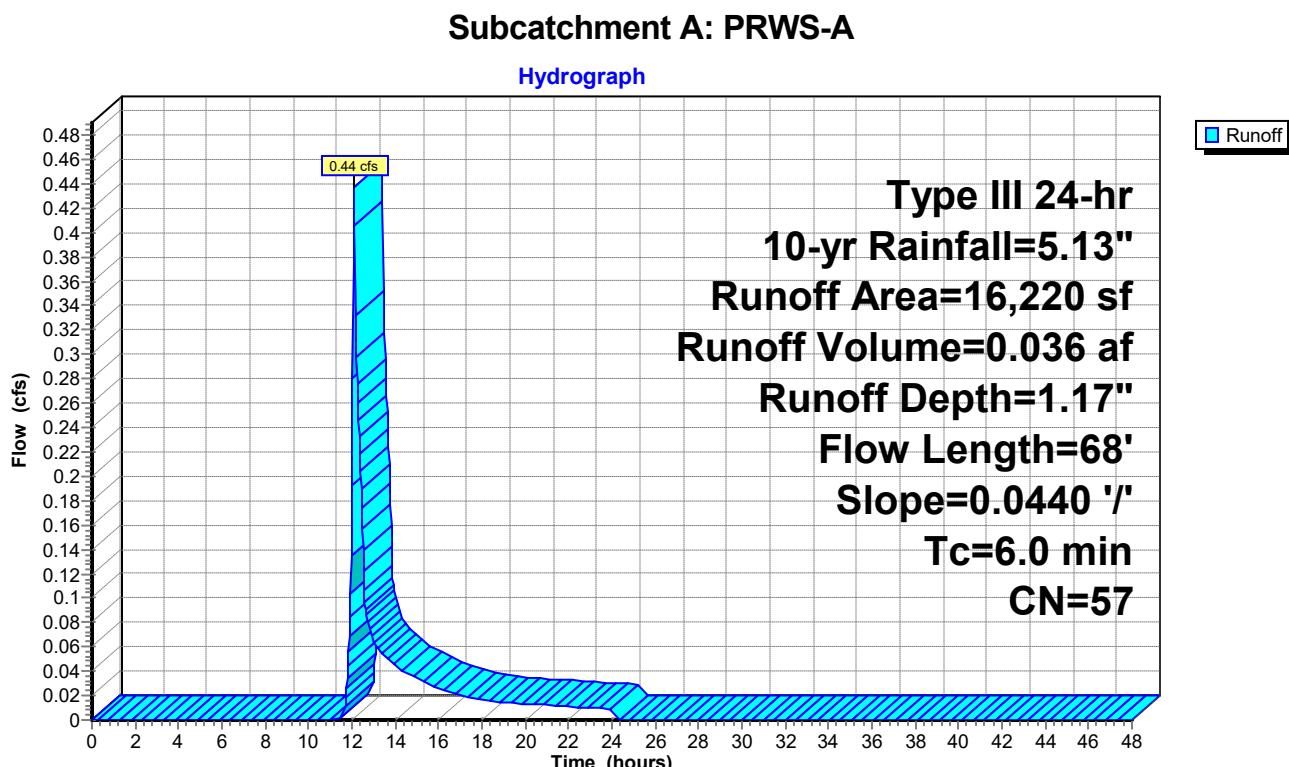

Summary for Subcatchment B: PRWS-B

Runoff = 0.09 cfs @ 12.11 hrs, Volume= 0.008 af, Depth= 1.05"
Routed to Link SITE : Total Site


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
Type III 24-hr 10-yr Rainfall=5.13"

Area (sf)	CN	Description
2,337	39	>75% Grass cover, Good, HSG A
648	80	>75% Grass cover, Good, HSG D
772	77	Brush, Fair, HSG D
117	98	Paved parking, HSG A
3,874	55	Weighted Average
3,757		96.98% Pervious Area
117		3.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.8	45	0.0389	0.20		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
3.8	45	Total, Increased to minimum Tc = 6.0 min			

Segment 1

Subcatchment B: PRWS-B

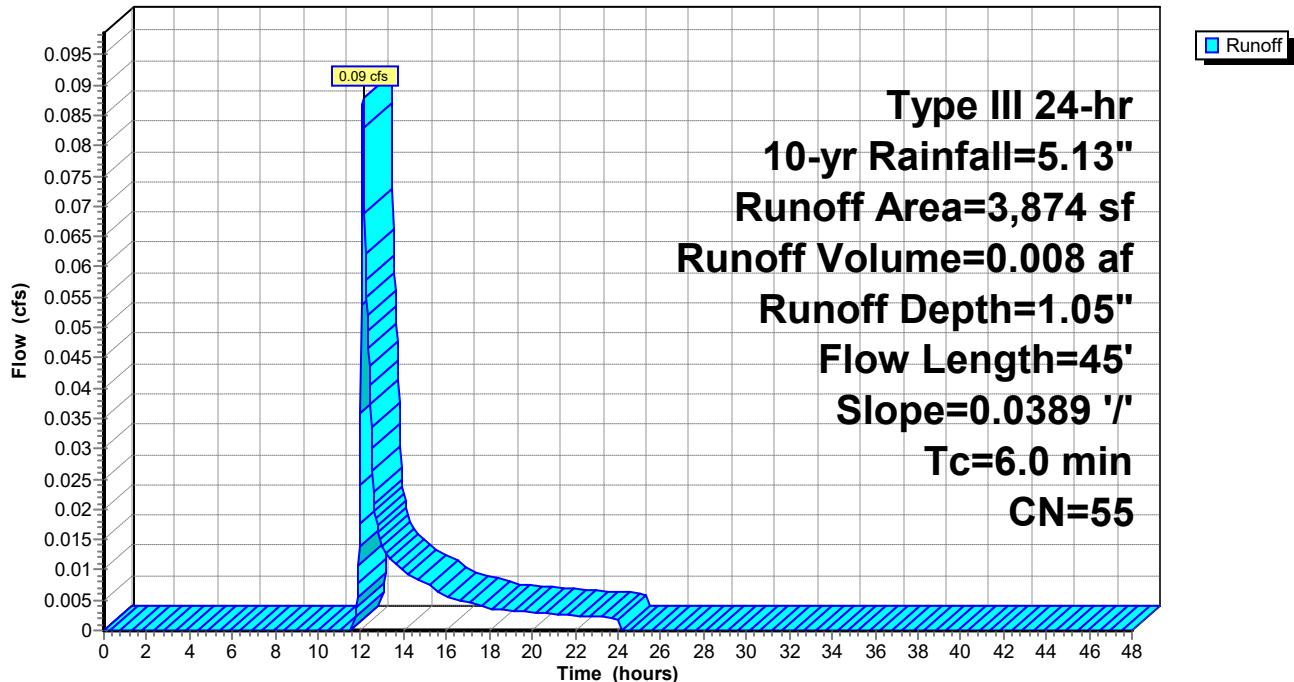Subcatchment B: PRWS-B**Hydrograph**


Summary for Subcatchment C1: PRWS-C1

Runoff = 3.33 cfs @ 12.10 hrs, Volume= 0.245 af, Depth= 2.82"
 Routed to Pond P-C : Pond C

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 10-yr Rainfall=5.13"


Area (sf)	CN	Description
4,355	80	>75% Grass cover, Good, HSG D
14,079	39	>75% Grass cover, Good, HSG A
26,887	98	Paved parking, HSG D
45,321	78	Weighted Average
18,434		40.67% Pervious Area
26,887		59.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	109	0.0250	1.58		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
5.2	41	0.0150	0.13		Sheet Flow, Segment 2 Grass: Short n= 0.150 P2= 3.43"
0.5	55	0.0150	1.84		Shallow Concentrated Flow, Segment 3 Grassed Waterway Kv= 15.0 fps
6.8	205	Total			



Subcatchment C1: PRWS-C1

Hydrograph

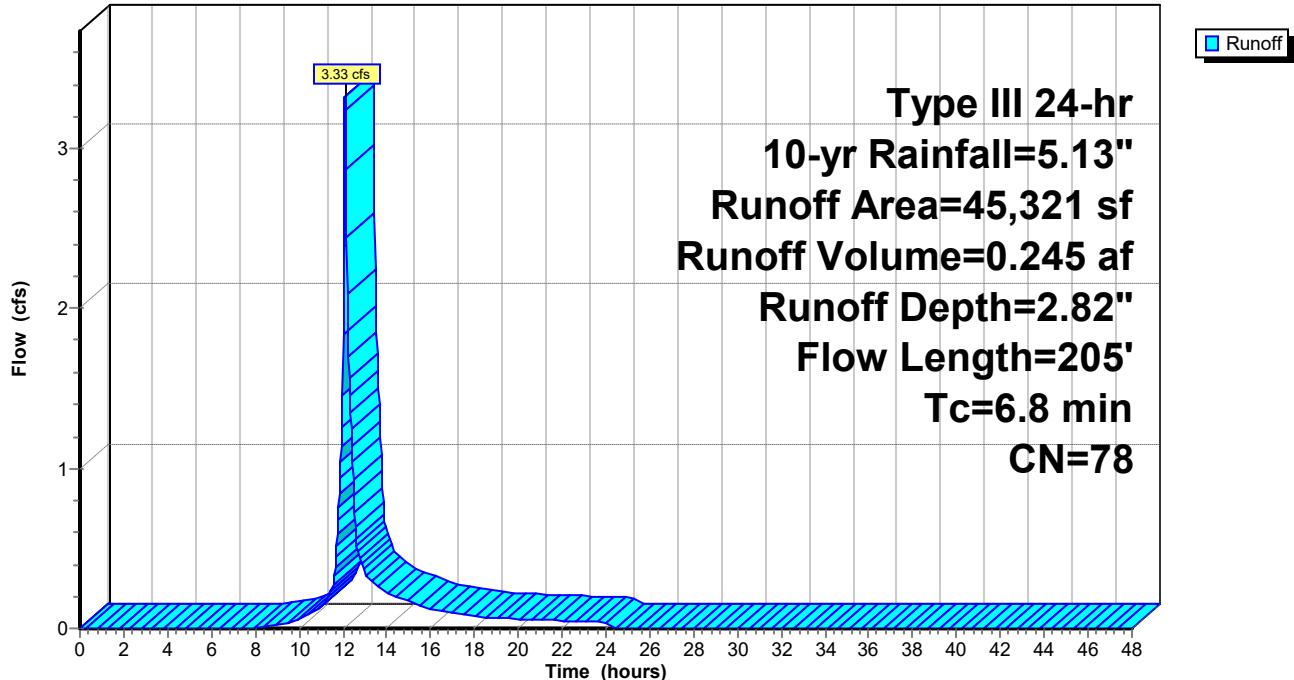

Summary for Subcatchment C2: PRWS-C2

Runoff = 0.34 cfs @ 12.09 hrs, Volume= 0.024 af, Depth= 2.47"
 Routed to Link 2L : C Total

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 10-yr Rainfall=5.13"


Area (sf)	CN	Description
557	73	Brush, Good, HSG D
3,991	80	>75% Grass cover, Good, HSG D
608	39	>75% Grass cover, Good, HSG A
5,156	74	Weighted Average
5,156		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	74	0.0610	0.26		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
4.8	74				Total, Increased to minimum Tc = 6.0 min



Subcatchment C2: PRWS-C2

Hydrograph

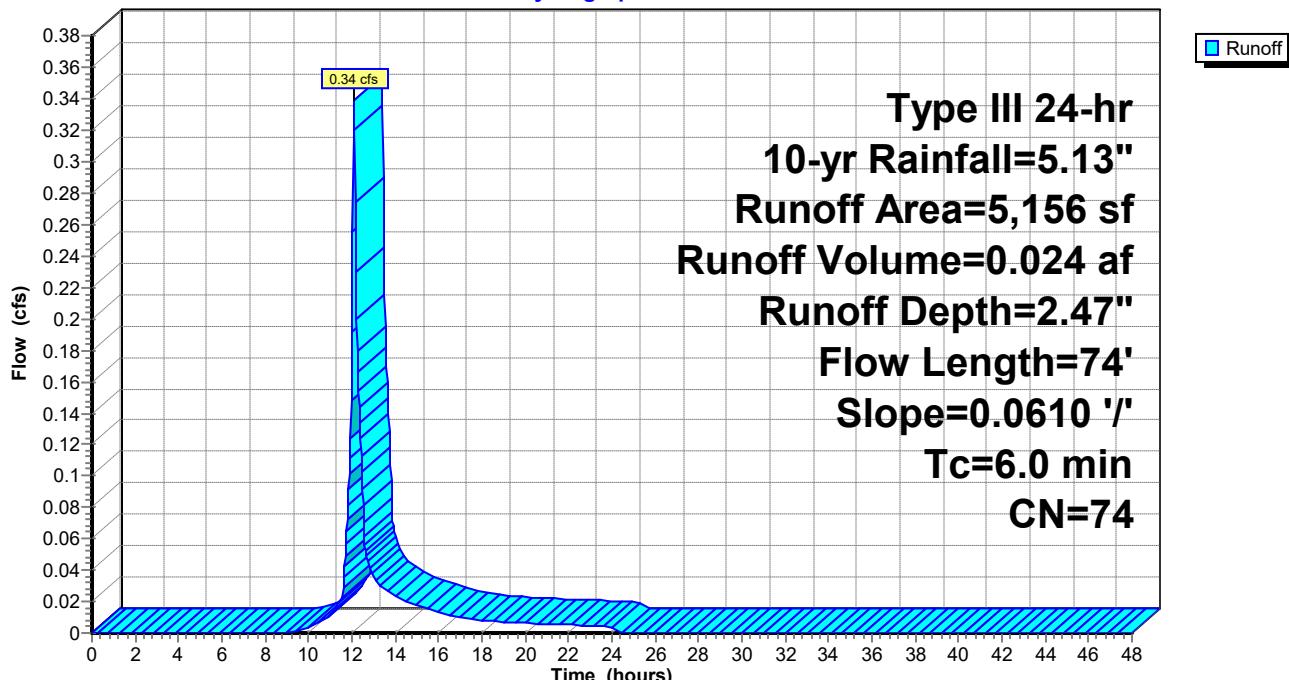

Summary for Pond P-C: Pond C

Inflow Area = 1.040 ac, 59.33% Impervious, Inflow Depth = 2.82" for 10-yr event
 Inflow = 3.33 cfs @ 12.10 hrs, Volume= 0.245 af
 Outflow = 1.94 cfs @ 12.23 hrs, Volume= 0.245 af, Atten= 42%, Lag= 8.0 min
 Discarded = 0.10 cfs @ 12.23 hrs, Volume= 0.127 af
 Primary = 1.63 cfs @ 12.23 hrs, Volume= 0.115 af
 Routed to Link 2L : C Total
 Secondary = 0.21 cfs @ 12.23 hrs, Volume= 0.003 af
 Routed to Link 2L : C Total

Routing by Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Peak Elev= 32.29' @ 12.23 hrs Surf.Area= 4,201 sf Storage= 2,897 cf


Plug-Flow detention time= 131.0 min calculated for 0.245 af (100% of inflow)
 Center-of-Mass det. time= 130.9 min (957.6 - 826.7)

Volume	Invert	Avail.Storage	Storage Description	
#1	31.50'	6,050 cf	Custom Stage Data (Conic)	Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
31.50	3,128	0	0	3,128
32.50	4,507	3,797	3,797	4,524
33.00	4,507	2,254	6,050	4,643
Device	Routing	Invert	Outlet Devices	
#1	Discarded	31.50'	1.000 in/hr Exfiltration over Wetted area	
#2	Primary	30.50'	12.0" Round Culvert L= 30.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 30.50' / 30.20' S= 0.0100 '/' Cc= 0.900 n= 0.010, Flow Area= 0.79 sf	
#3	Device 2	32.00'	12.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads	
#4	Secondary	32.25'	10.0' long x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88	


Discarded OutFlow Max=0.10 cfs @ 12.23 hrs HW=32.29' (Free Discharge)
 ↑ 1=Exfiltration (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=1.63 cfs @ 12.23 hrs HW=32.29' (Free Discharge)
 ↑ 2=Culvert (Passes 1.63 cfs of 3.39 cfs potential flow)
 ↑ 3=Orifice/Grate (Weir Controls 1.63 cfs @ 1.77 fps)

Secondary OutFlow Max=0.21 cfs @ 12.23 hrs HW=32.29' (Free Discharge)
 ↑ 4=Broad-Crested Rectangular Weir (Weir Controls 0.21 cfs @ 0.48 fps)

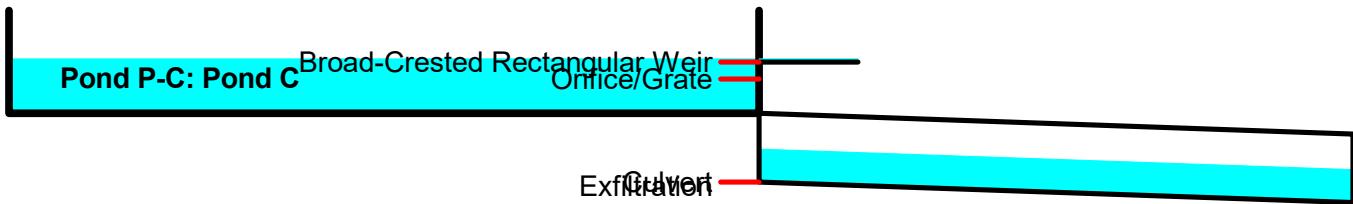**Pond P-C: Pond C**

Hydrograph

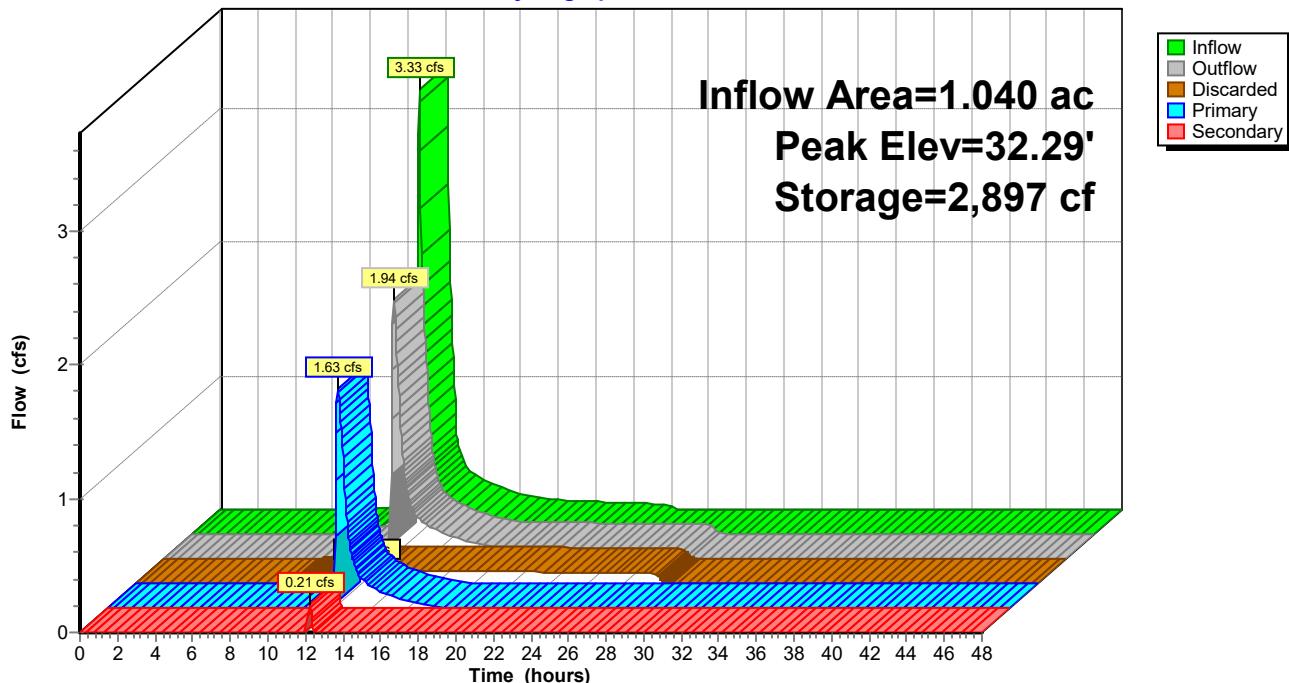

Stage-Discharge for Pond P-C: Pond C

Elevation (feet)	Discharge (cfs)	Discarded (cfs)	Primary (cfs)	Secondary (cfs)
31.50	0.00	0.00	0.00	0.00
31.55	0.07	0.07	0.00	0.00
31.60	0.08	0.08	0.00	0.00
31.65	0.08	0.08	0.00	0.00
31.70	0.08	0.08	0.00	0.00
31.75	0.08	0.08	0.00	0.00
31.80	0.08	0.08	0.00	0.00
31.85	0.08	0.08	0.00	0.00
31.90	0.08	0.08	0.00	0.00
31.95	0.09	0.09	0.00	0.00
32.00	0.09	0.09	0.00	0.00
32.05	0.20	0.09	0.11	0.00
32.10	0.42	0.09	0.32	0.00
32.15	0.69	0.09	0.60	0.00
32.20	1.01	0.09	0.92	0.00
32.25	1.38	0.10	1.28	0.00
32.30	2.05	0.10	1.69	0.26
32.35	2.97	0.10	2.13	0.74
32.40	3.85	0.10	2.39	1.36
32.45	4.73	0.10	2.54	2.09
32.50	5.75	0.10	2.67	2.97
32.55	6.89	0.11	2.80	3.98
32.60	8.13	0.11	2.93	5.09
32.65	9.48	0.11	3.05	6.32
32.70	10.97	0.11	3.16	7.70
32.75	12.57	0.11	3.28	9.19
32.80	14.30	0.11	3.38	10.81
32.85	16.14	0.11	3.49	12.55
32.90	17.82	0.11	3.59	14.12
32.95	19.55	0.11	3.69	15.75
33.00	21.33	0.11	3.78	17.44

Stage-Area-Storage for Pond P-C: Pond C

Elevation (feet)	Surface (sq-ft)	Wetted (sq-ft)	Storage (cubic-feet)
31.50	3,128	3,128	0
31.55	3,191	3,192	158
31.60	3,255	3,256	319
31.65	3,319	3,321	483
31.70	3,384	3,387	651
31.75	3,449	3,453	822
31.80	3,515	3,520	996
31.85	3,582	3,588	1,173
31.90	3,649	3,656	1,354
31.95	3,717	3,725	1,538
32.00	3,786	3,794	1,726
32.05	3,855	3,864	1,917
32.10	3,925	3,935	2,111
32.15	3,996	4,007	2,309
32.20	4,067	4,079	2,511
32.25	4,139	4,151	2,716
32.30	4,211	4,225	2,925
32.35	4,284	4,299	3,137
32.40	4,358	4,373	3,353
32.45	4,432	4,448	3,573
32.50	4,507	4,524	3,797
32.55	4,507	4,536	4,022
32.60	4,507	4,548	4,247
32.65	4,507	4,560	4,473
32.70	4,507	4,572	4,698
32.75	4,507	4,584	4,923
32.80	4,507	4,596	5,149
32.85	4,507	4,607	5,374
32.90	4,507	4,619	5,599
32.95	4,507	4,631	5,825
33.00	4,507	4,643	6,050

Summary for Link 2L: C Total

Inflow Area = 1.159 ac, 53.27% Impervious, Inflow Depth = 1.47" for 10-yr event

Inflow = 2.04 cfs @ 12.22 hrs, Volume= 0.142 af


Primary = 2.04 cfs @ 12.22 hrs, Volume= 0.142 af, Atten= 0%, Lag= 0.0 min

Routed to Link SITE : Total Site

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs

Link 2L: C Total

Hydrograph

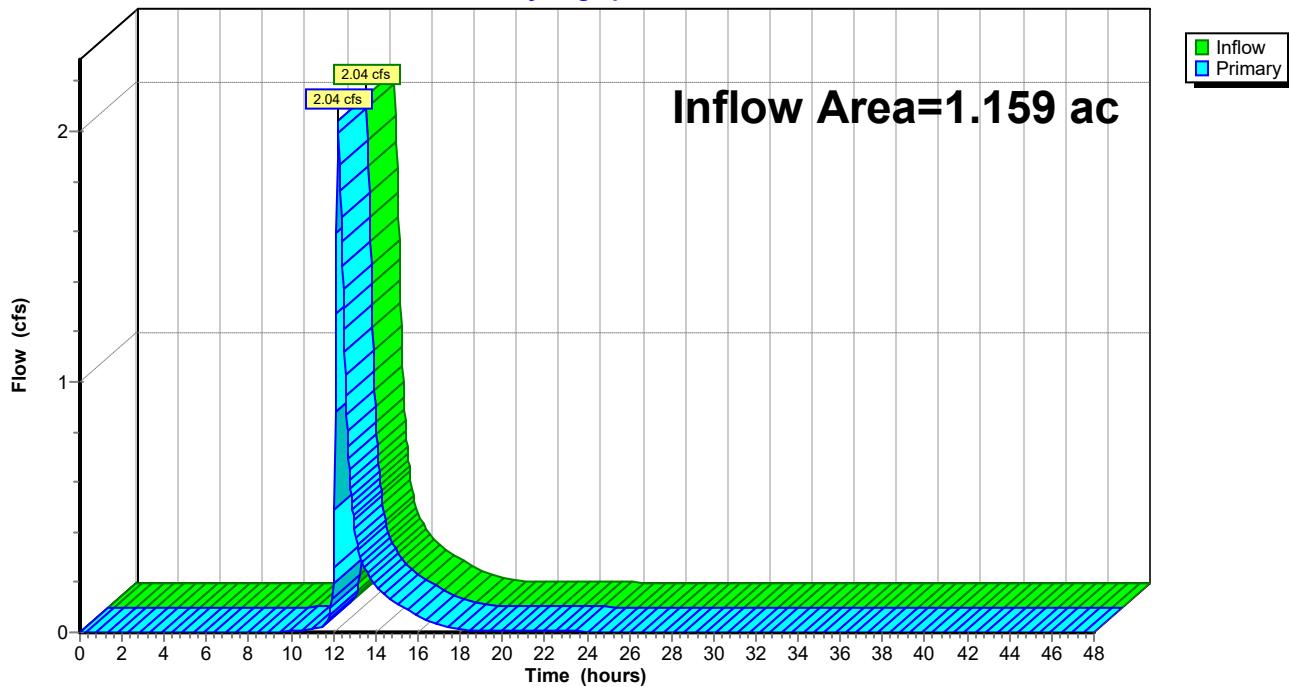


Summary for Link SITE: Total Site

Inflow Area = 1.620 ac, 45.14% Impervious, Inflow Depth = 1.38" for 10-yr event

Inflow = 2.39 cfs @ 12.22 hrs, Volume= 0.186 af

Primary = 2.39 cfs @ 12.22 hrs, Volume= 0.186 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs

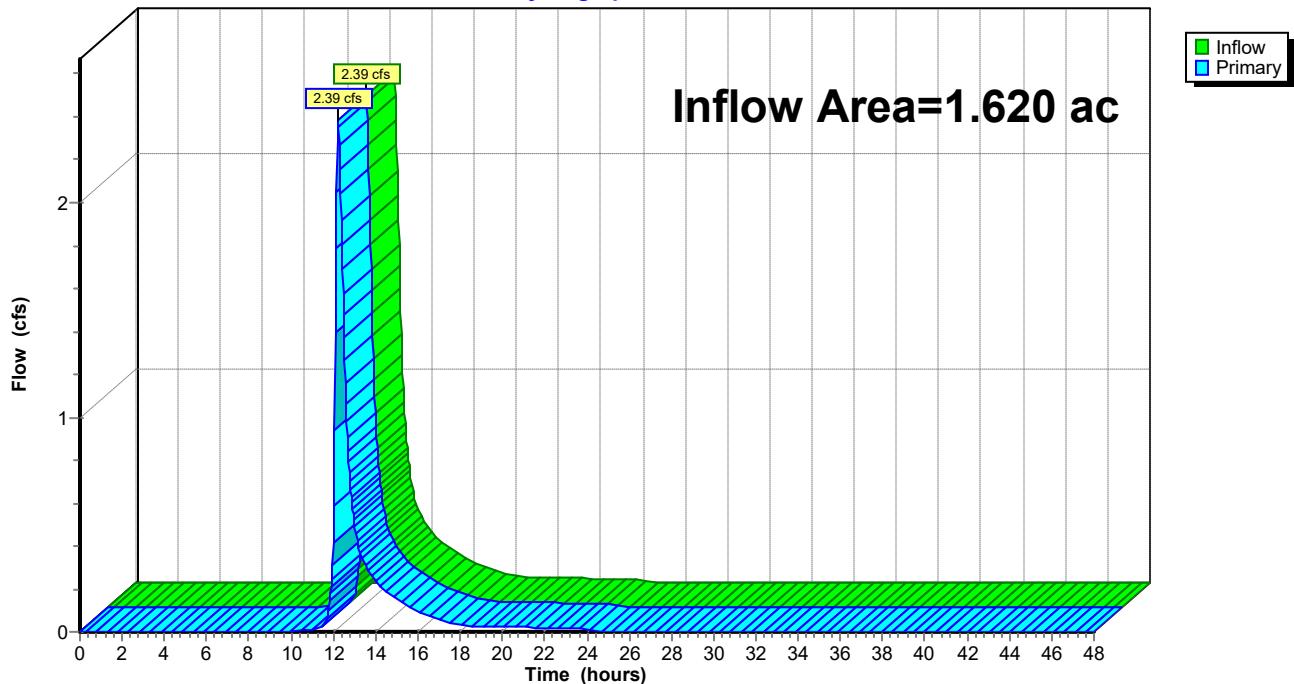Link SITE: Total Site**Hydrograph**

Time span=0.00-48.00 hrs, dt=0.03 hrs, 1601 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment A: PRWS-A

Runoff Area=16,220 sf 29.90% Impervious Runoff Depth=1.78"

Flow Length=68' Slope=0.0440 '/' Tc=6.0 min CN=57 Runoff=0.71 cfs 0.055 af

Subcatchment B: PRWS-B

Runoff Area=3,874 sf 3.02% Impervious Runoff Depth=1.62"

Flow Length=45' Slope=0.0389 '/' Tc=6.0 min CN=55 Runoff=0.15 cfs 0.012 af

Subcatchment C1: PRWS-C1

Runoff Area=45,321 sf 59.33% Impervious Runoff Depth=3.73"

Flow Length=205' Tc=6.8 min CN=78 Runoff=4.40 cfs 0.323 af

Subcatchment C2: PRWS-C2

Runoff Area=5,156 sf 0.00% Impervious Runoff Depth=3.33"

Flow Length=74' Slope=0.0610 '/' Tc=6.0 min CN=74 Runoff=0.46 cfs 0.033 af

Pond P-C: Pond C

Peak Elev=32.38' Storage=3,249 cf Inflow=4.40 cfs 0.323 af

Discarded=0.10 cfs 0.139 af Primary=2.32 cfs 0.166 af Secondary=1.05 cfs 0.018 af Outflow=3.47 cfs 0.323 af

Link 2L: C Total

Inflow=3.73 cfs 0.217 af

Primary=3.73 cfs 0.217 af

Link SITE: Total Site

Inflow=4.44 cfs 0.284 af

Primary=4.44 cfs 0.284 af

Total Runoff Area = 1.620 ac Runoff Volume = 0.423 af Average Runoff Depth = 3.14"
54.86% Pervious = 0.889 ac 45.14% Impervious = 0.731 ac


Summary for Subcatchment A: PRWS-A

Runoff = 0.71 cfs @ 12.10 hrs, Volume= 0.055 af, Depth= 1.78"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 25-yr Rainfall=6.17"

Area (sf)	CN	Description
11,370	39	>75% Grass cover, Good, HSG A
4,850	98	Paved parking, HSG A
16,220	57	Weighted Average
11,370		70.10% Pervious Area
4,850		29.90% Impervious Area

Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
5.1	68	0.0440	0.22		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
5.1	68				Total, Increased to minimum Tc = 6.0 min

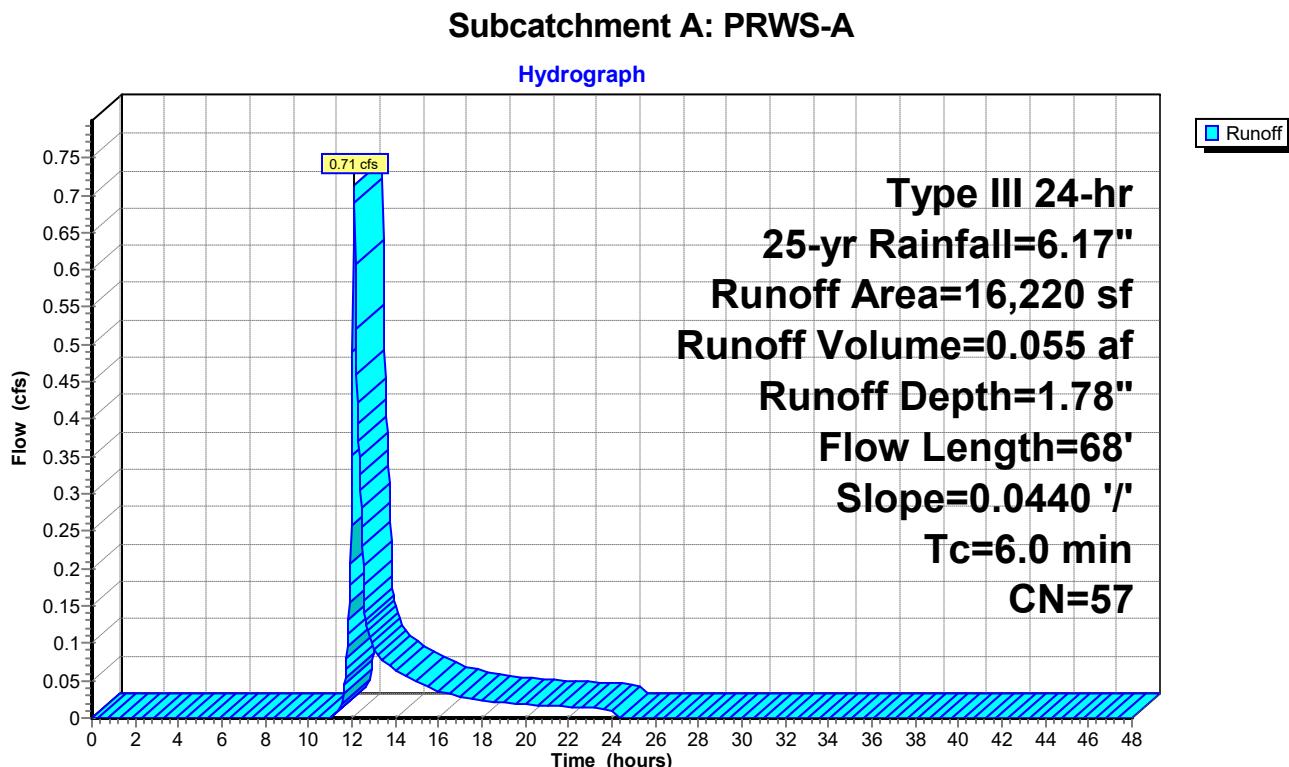

Summary for Subcatchment B: PRWS-B

Runoff = 0.15 cfs @ 12.10 hrs, Volume= 0.012 af, Depth= 1.62"
Routed to Link SITE : Total Site


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
Type III 24-hr 25-yr Rainfall=6.17"

Area (sf)	CN	Description
2,337	39	>75% Grass cover, Good, HSG A
648	80	>75% Grass cover, Good, HSG D
772	77	Brush, Fair, HSG D
117	98	Paved parking, HSG A
3,874	55	Weighted Average
3,757		96.98% Pervious Area
117		3.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.8	45	0.0389	0.20		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
3.8	45	Total, Increased to minimum Tc = 6.0 min			

Segment 1

Subcatchment B: PRWS-B

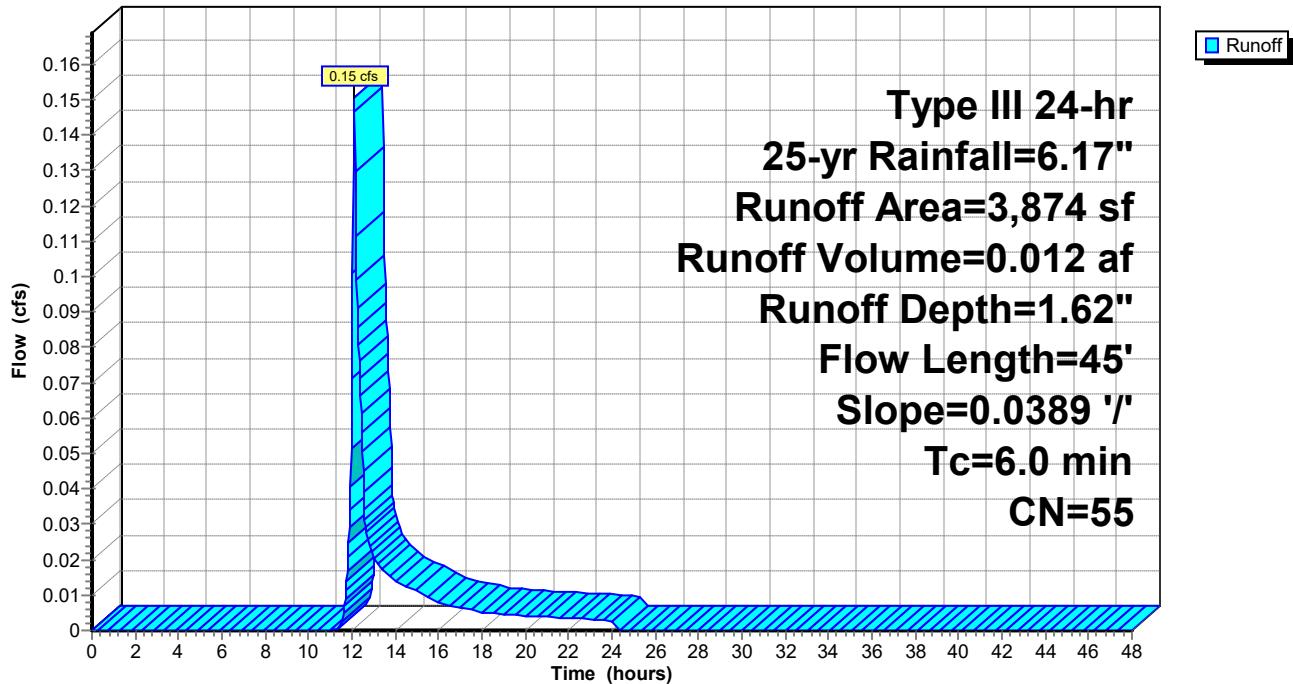Subcatchment B: PRWS-B**Hydrograph**


Summary for Subcatchment C1: PRWS-C1

Runoff = 4.40 cfs @ 12.10 hrs, Volume= 0.323 af, Depth= 3.73"
 Routed to Pond P-C : Pond C

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 25-yr Rainfall=6.17"


Area (sf)	CN	Description
4,355	80	>75% Grass cover, Good, HSG D
14,079	39	>75% Grass cover, Good, HSG A
26,887	98	Paved parking, HSG D
45,321	78	Weighted Average
18,434		40.67% Pervious Area
26,887		59.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	109	0.0250	1.58		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
5.2	41	0.0150	0.13		Sheet Flow, Segment 2 Grass: Short n= 0.150 P2= 3.43"
0.5	55	0.0150	1.84		Shallow Concentrated Flow, Segment 3 Grassed Waterway Kv= 15.0 fps
6.8	205	Total			



Subcatchment C1: PRWS-C1

Hydrograph

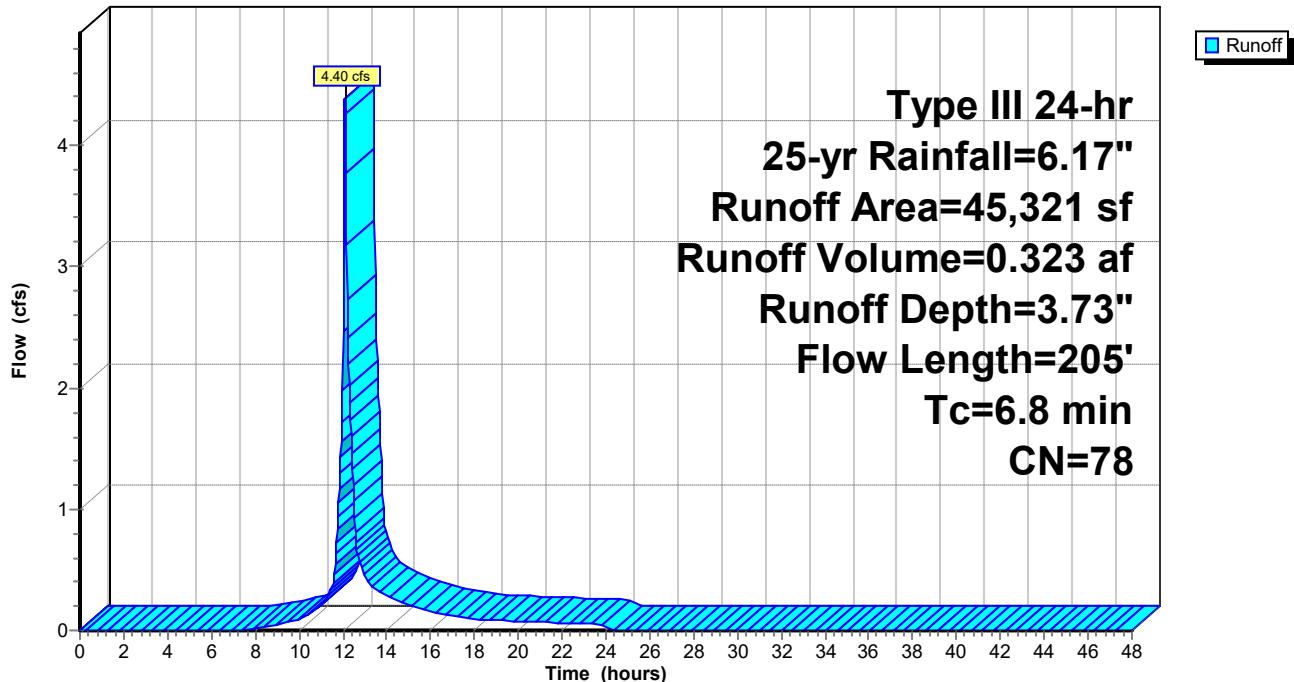

Summary for Subcatchment C2: PRWS-C2

Runoff = 0.46 cfs @ 12.09 hrs, Volume= 0.033 af, Depth= 3.33"
Routed to Link 2L : C Total

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
Type III 24-hr 25-yr Rainfall=6.17"

Area (sf)	CN	Description
557	73	Brush, Good, HSG D
3,991	80	>75% Grass cover, Good, HSG D
608	39	>75% Grass cover, Good, HSG A
5,156	74	Weighted Average
5,156		100.00% Pervious Area


Tc	Length	Slope	Velocity	Capacity	Description
(min)	(feet)	(ft/ft)	(ft/sec)	(cfs)	
4.8	74	0.0610	0.26		Sheet Flow, Segment 1
					Grass: Short n= 0.150 P2= 3.43"

4.8 74 Total, Increased to minimum Tc = 6.0 min



Subcatchment C2: PRWS-C2

Hydrograph

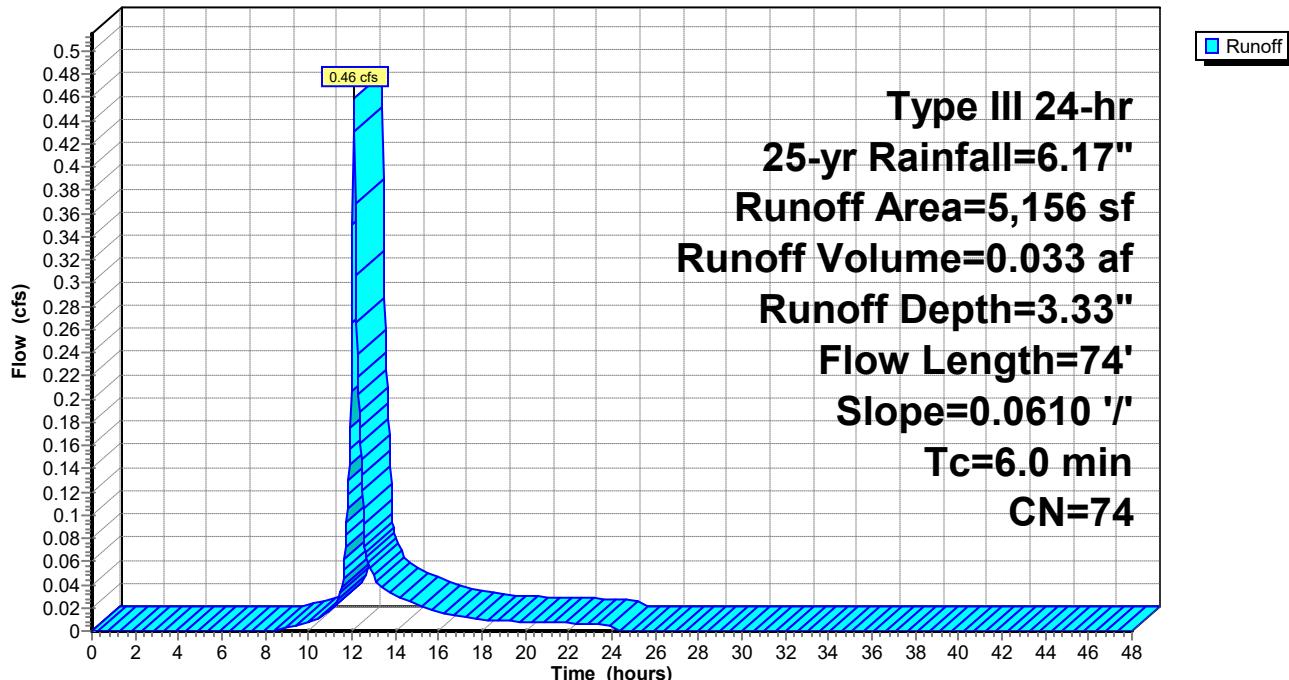

Summary for Pond P-C: Pond C

Inflow Area = 1.040 ac, 59.33% Impervious, Inflow Depth = 3.73" for 25-yr event
 Inflow = 4.40 cfs @ 12.10 hrs, Volume= 0.323 af
 Outflow = 3.47 cfs @ 12.17 hrs, Volume= 0.323 af, Atten= 21%, Lag= 4.1 min
 Discarded = 0.10 cfs @ 12.17 hrs, Volume= 0.139 af
 Primary = 2.32 cfs @ 12.17 hrs, Volume= 0.166 af
 Routed to Link 2L : C Total
 Secondary = 1.05 cfs @ 12.17 hrs, Volume= 0.018 af
 Routed to Link 2L : C Total

Routing by Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Peak Elev= 32.38' @ 12.17 hrs Surf.Area= 4,322 sf Storage= 3,249 cf


Plug-Flow detention time= 112.2 min calculated for 0.323 af (100% of inflow)
 Center-of-Mass det. time= 112.3 min (931.1 - 818.7)

Volume	Invert	Avail.Storage	Storage Description
#1	31.50'	6,050 cf	Custom Stage Data (Conic) Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
31.50	3,128	0	0
32.50	4,507	3,797	3,797
33.00	4,507	2,254	6,050
			Wet.Area (sq-ft)
			3,128
			4,524
			4,643
Device	Routing	Invert	Outlet Devices
#1	Discarded	31.50'	1.000 in/hr Exfiltration over Wetted area
#2	Primary	30.50'	12.0" Round Culvert L= 30.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 30.50' / 30.20' S= 0.0100 '/' Cc= 0.900 n= 0.010, Flow Area= 0.79 sf
#3	Device 2	32.00'	12.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#4	Secondary	32.25'	10.0' long x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.66 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88


Discarded OutFlow Max=0.10 cfs @ 12.17 hrs HW=32.37' (Free Discharge)
 ↑ 1=Exfiltration (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=2.31 cfs @ 12.17 hrs HW=32.37' (Free Discharge)
 ↑ 2=Culvert (Passes 2.31 cfs of 3.50 cfs potential flow)
 ↑ 3=Orifice/Grate (Orifice Controls 2.31 cfs @ 2.95 fps)

Secondary OutFlow Max=1.03 cfs @ 12.17 hrs HW=32.37' (Free Discharge)
 ↑ 4=Broad-Crested Rectangular Weir (Weir Controls 1.03 cfs @ 0.83 fps)

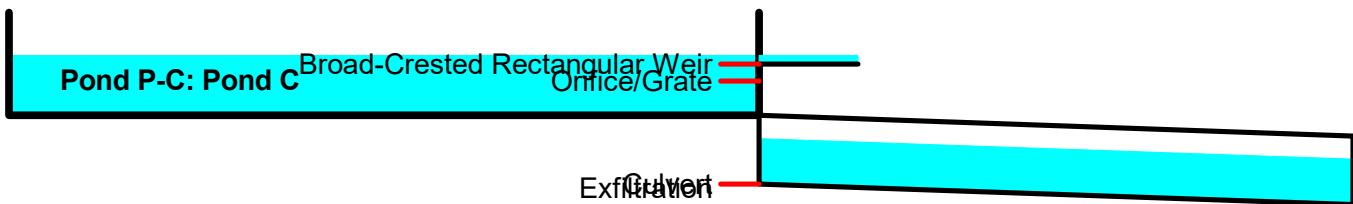**Pond P-C: Pond C**

Hydrograph

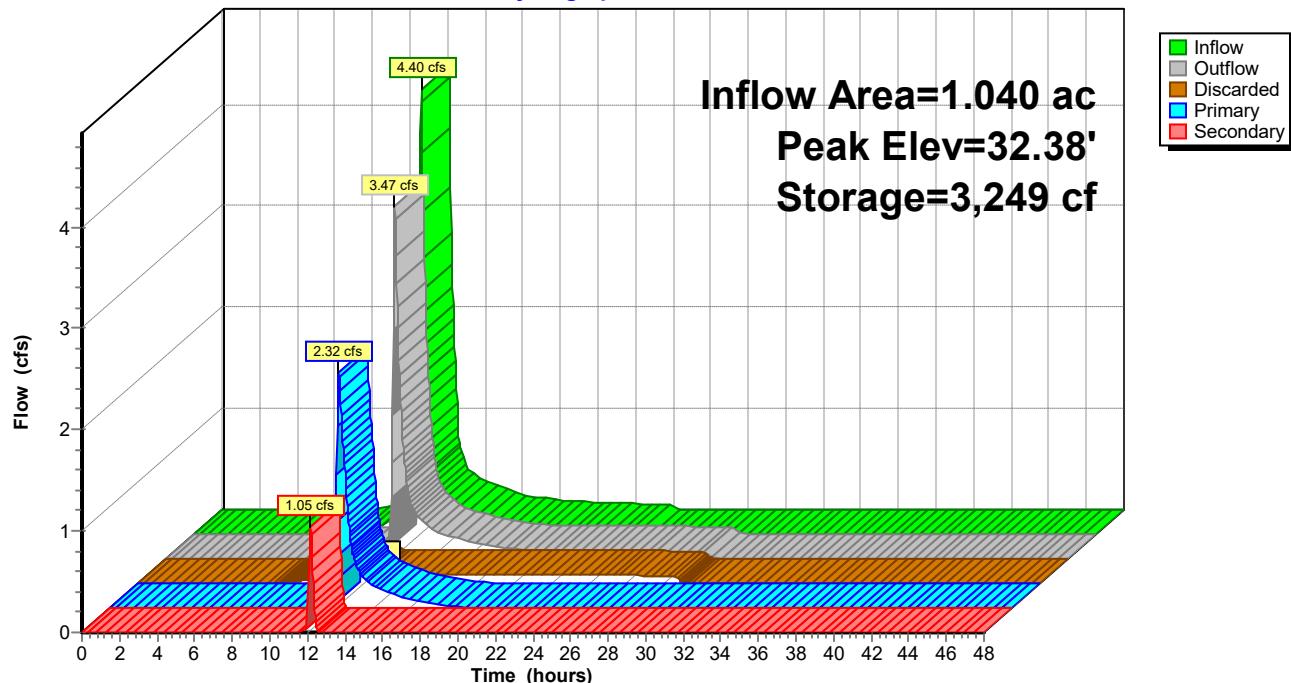

Stage-Discharge for Pond P-C: Pond C

Elevation (feet)	Discharge (cfs)	Discarded (cfs)	Primary (cfs)	Secondary (cfs)
31.50	0.00	0.00	0.00	0.00
31.55	0.07	0.07	0.00	0.00
31.60	0.08	0.08	0.00	0.00
31.65	0.08	0.08	0.00	0.00
31.70	0.08	0.08	0.00	0.00
31.75	0.08	0.08	0.00	0.00
31.80	0.08	0.08	0.00	0.00
31.85	0.08	0.08	0.00	0.00
31.90	0.08	0.08	0.00	0.00
31.95	0.09	0.09	0.00	0.00
32.00	0.09	0.09	0.00	0.00
32.05	0.20	0.09	0.11	0.00
32.10	0.42	0.09	0.32	0.00
32.15	0.69	0.09	0.60	0.00
32.20	1.01	0.09	0.92	0.00
32.25	1.38	0.10	1.28	0.00
32.30	2.05	0.10	1.69	0.26
32.35	2.97	0.10	2.13	0.74
32.40	3.85	0.10	2.39	1.36
32.45	4.73	0.10	2.54	2.09
32.50	5.75	0.10	2.67	2.97
32.55	6.89	0.11	2.80	3.98
32.60	8.13	0.11	2.93	5.09
32.65	9.48	0.11	3.05	6.32
32.70	10.97	0.11	3.16	7.70
32.75	12.57	0.11	3.28	9.19
32.80	14.30	0.11	3.38	10.81
32.85	16.14	0.11	3.49	12.55
32.90	17.82	0.11	3.59	14.12
32.95	19.55	0.11	3.69	15.75
33.00	21.33	0.11	3.78	17.44

Stage-Area-Storage for Pond P-C: Pond C

Elevation (feet)	Surface (sq-ft)	Wetted (sq-ft)	Storage (cubic-feet)
31.50	3,128	3,128	0
31.55	3,191	3,192	158
31.60	3,255	3,256	319
31.65	3,319	3,321	483
31.70	3,384	3,387	651
31.75	3,449	3,453	822
31.80	3,515	3,520	996
31.85	3,582	3,588	1,173
31.90	3,649	3,656	1,354
31.95	3,717	3,725	1,538
32.00	3,786	3,794	1,726
32.05	3,855	3,864	1,917
32.10	3,925	3,935	2,111
32.15	3,996	4,007	2,309
32.20	4,067	4,079	2,511
32.25	4,139	4,151	2,716
32.30	4,211	4,225	2,925
32.35	4,284	4,299	3,137
32.40	4,358	4,373	3,353
32.45	4,432	4,448	3,573
32.50	4,507	4,524	3,797
32.55	4,507	4,536	4,022
32.60	4,507	4,548	4,247
32.65	4,507	4,560	4,473
32.70	4,507	4,572	4,698
32.75	4,507	4,584	4,923
32.80	4,507	4,596	5,149
32.85	4,507	4,607	5,374
32.90	4,507	4,619	5,599
32.95	4,507	4,631	5,825
33.00	4,507	4,643	6,050

Summary for Link 2L: C Total

Inflow Area = 1.159 ac, 53.27% Impervious, Inflow Depth = 2.25" for 25-yr event

Inflow = 3.73 cfs @ 12.16 hrs, Volume= 0.217 af


Primary = 3.73 cfs @ 12.16 hrs, Volume= 0.217 af, Atten= 0%, Lag= 0.0 min

Routed to Link SITE : Total Site

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs

Link 2L: C Total

Hydrograph

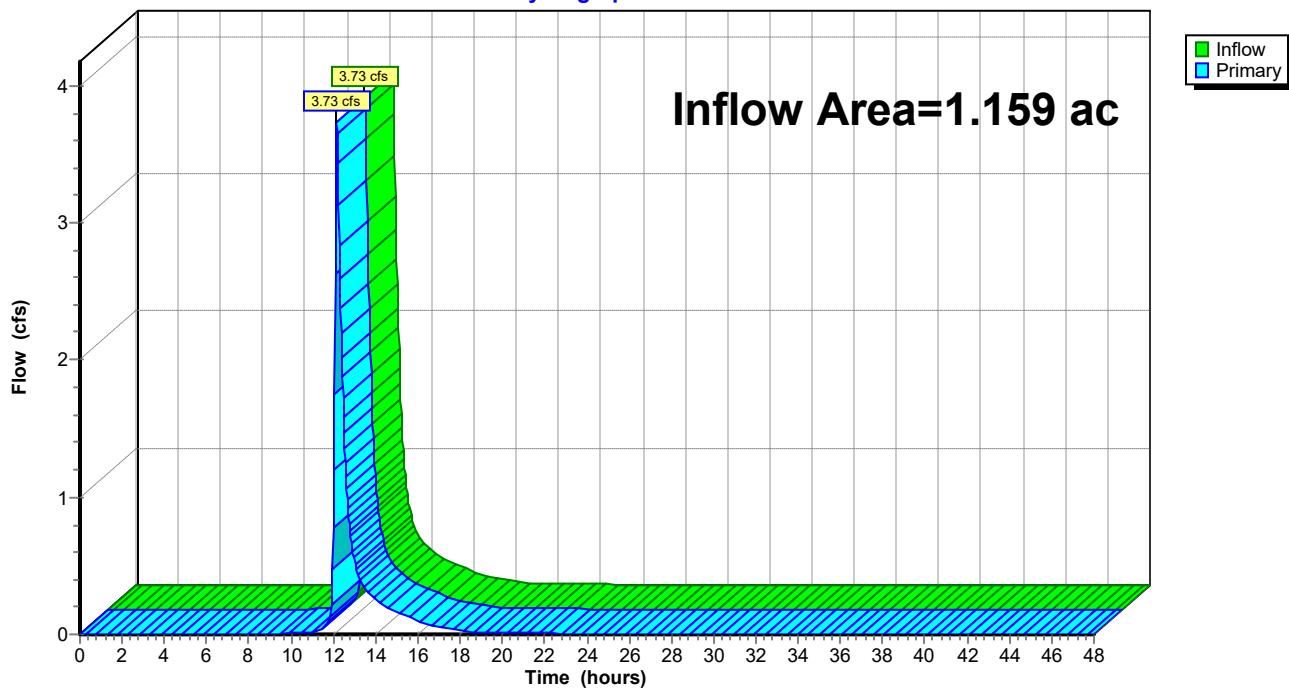

Summary for Link SITE: Total Site

Inflow Area = 1.620 ac, 45.14% Impervious, Inflow Depth = 2.10" for 25-yr event


Inflow = 4.44 cfs @ 12.15 hrs, Volume= 0.284 af

Primary = 4.44 cfs @ 12.15 hrs, Volume= 0.284 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs

Link SITE: Total Site

Hydrograph

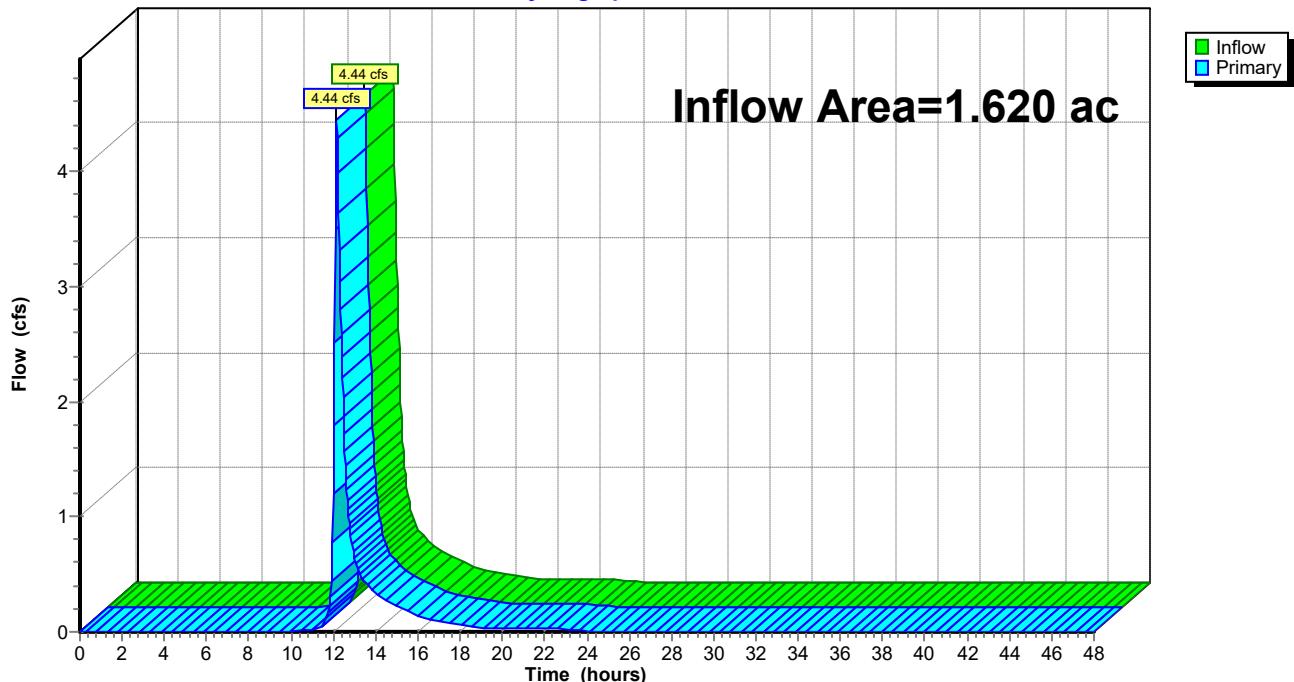

Time span=0.00-48.00 hrs, dt=0.03 hrs, 1601 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment A: PRWS-A

Runoff Area=16,220 sf 29.90% Impervious Runoff Depth=2.85"

Flow Length=68' Slope=0.0440 '/' Tc=6.0 min CN=57 Runoff=1.20 cfs 0.089 af

Subcatchment B: PRWS-B

Runoff Area=3,874 sf 3.02% Impervious Runoff Depth=2.64"

Flow Length=45' Slope=0.0389 '/' Tc=6.0 min CN=55 Runoff=0.26 cfs 0.020 af

Subcatchment C1: PRWS-C1

Runoff Area=45,321 sf 59.33% Impervious Runoff Depth=5.20"

Flow Length=205' Tc=6.8 min CN=78 Runoff=6.08 cfs 0.451 af

Subcatchment C2: PRWS-C2

Runoff Area=5,156 sf 0.00% Impervious Runoff Depth=4.74"

Flow Length=74' Slope=0.0610 '/' Tc=6.0 min CN=74 Runoff=0.65 cfs 0.047 af

Pond P-C: Pond C

Peak Elev=32.47' Storage=3,678 cf Inflow=6.08 cfs 0.451 af

Discarded=0.10 cfs 0.153 af Primary=2.60 cfs 0.246 af Secondary=2.49 cfs 0.052 af Outflow=5.20 cfs 0.451 af

Link 2L: C Total

Inflow=5.62 cfs 0.345 af

Primary=5.62 cfs 0.345 af

Link SITE: Total Site

Inflow=6.93 cfs 0.453 af

Primary=6.93 cfs 0.453 af

Total Runoff Area = 1.620 ac Runoff Volume = 0.605 af Average Runoff Depth = 4.48"
54.86% Pervious = 0.889 ac 45.14% Impervious = 0.731 ac

Summary for Subcatchment A: PRWS-A

Runoff = 1.20 cfs @ 12.09 hrs, Volume= 0.089 af, Depth= 2.85"
 Routed to Link SITE : Total Site

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 100-yr Rainfall=7.79"


Area (sf)	CN	Description
11,370	39	>75% Grass cover, Good, HSG A
4,850	98	Paved parking, HSG A
16,220	57	Weighted Average
11,370		70.10% Pervious Area
4,850		29.90% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.1	68	0.0440	0.22		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
5.1	68				Total, Increased to minimum Tc = 6.0 min



Subcatchment A: PRWS-A

Hydrograph

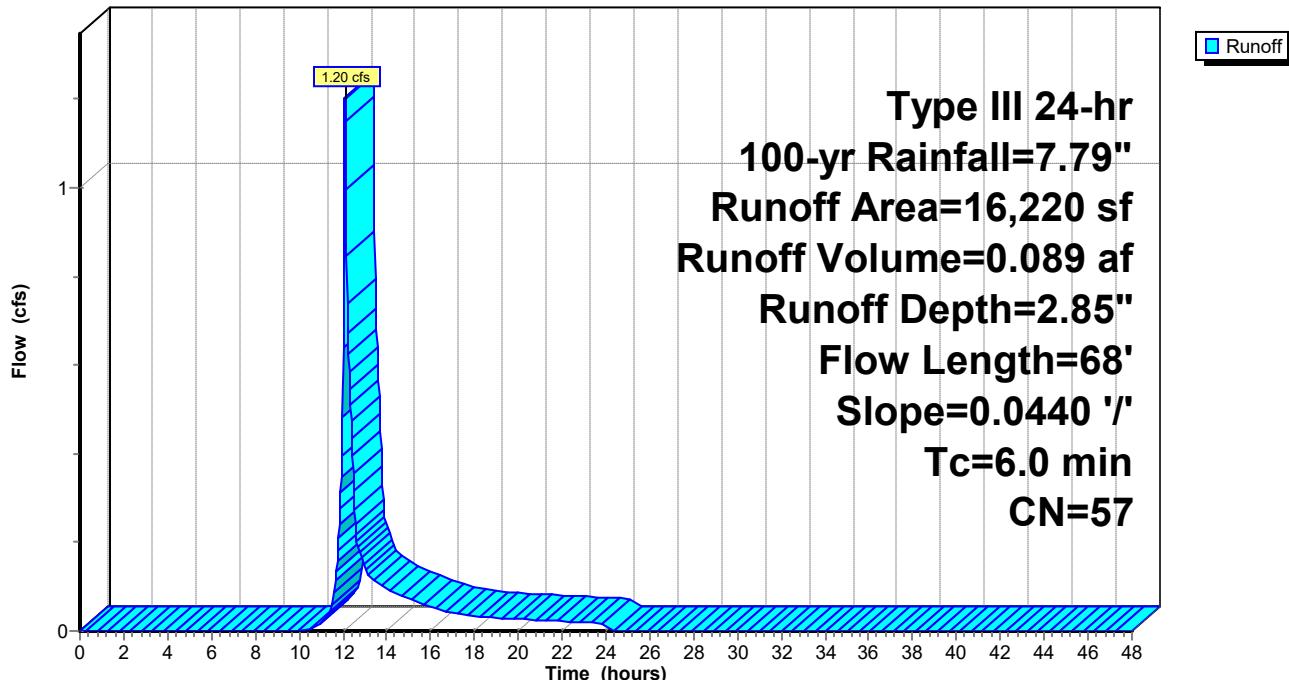

Summary for Subcatchment B: PRWS-B

Runoff = 0.26 cfs @ 12.10 hrs, Volume= 0.020 af, Depth= 2.64"
Routed to Link SITE : Total Site


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
Type III 24-hr 100-yr Rainfall=7.79"

Area (sf)	CN	Description
2,337	39	>75% Grass cover, Good, HSG A
648	80	>75% Grass cover, Good, HSG D
772	77	Brush, Fair, HSG D
117	98	Paved parking, HSG A
3,874	55	Weighted Average
3,757		96.98% Pervious Area
117		3.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.8	45	0.0389	0.20		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
3.8	45	Total, Increased to minimum Tc = 6.0 min			

Segment 1

Subcatchment B: PRWS-B

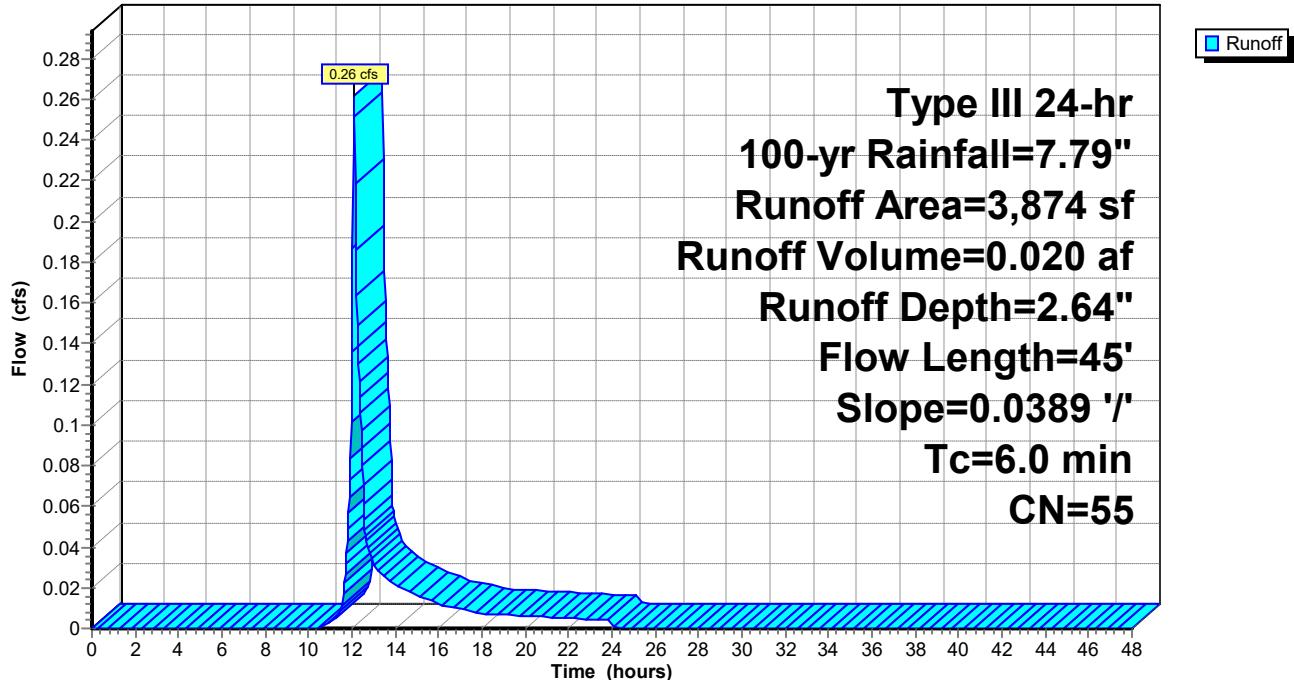Subcatchment B: PRWS-B**Hydrograph**


Summary for Subcatchment C1: PRWS-C1

Runoff = 6.08 cfs @ 12.10 hrs, Volume= 0.451 af, Depth= 5.20"
 Routed to Pond P-C : Pond C

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 100-yr Rainfall=7.79"


Area (sf)	CN	Description
4,355	80	>75% Grass cover, Good, HSG D
14,079	39	>75% Grass cover, Good, HSG A
26,887	98	Paved parking, HSG D
45,321	78	Weighted Average
18,434		40.67% Pervious Area
26,887		59.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	109	0.0250	1.58		Sheet Flow, Segment 1 Smooth surfaces n= 0.011 P2= 3.43"
5.2	41	0.0150	0.13		Sheet Flow, Segment 2 Grass: Short n= 0.150 P2= 3.43"
0.5	55	0.0150	1.84		Shallow Concentrated Flow, Segment 3 Grassed Waterway Kv= 15.0 fps
6.8	205	Total			



Subcatchment C1: PRWS-C1

Hydrograph

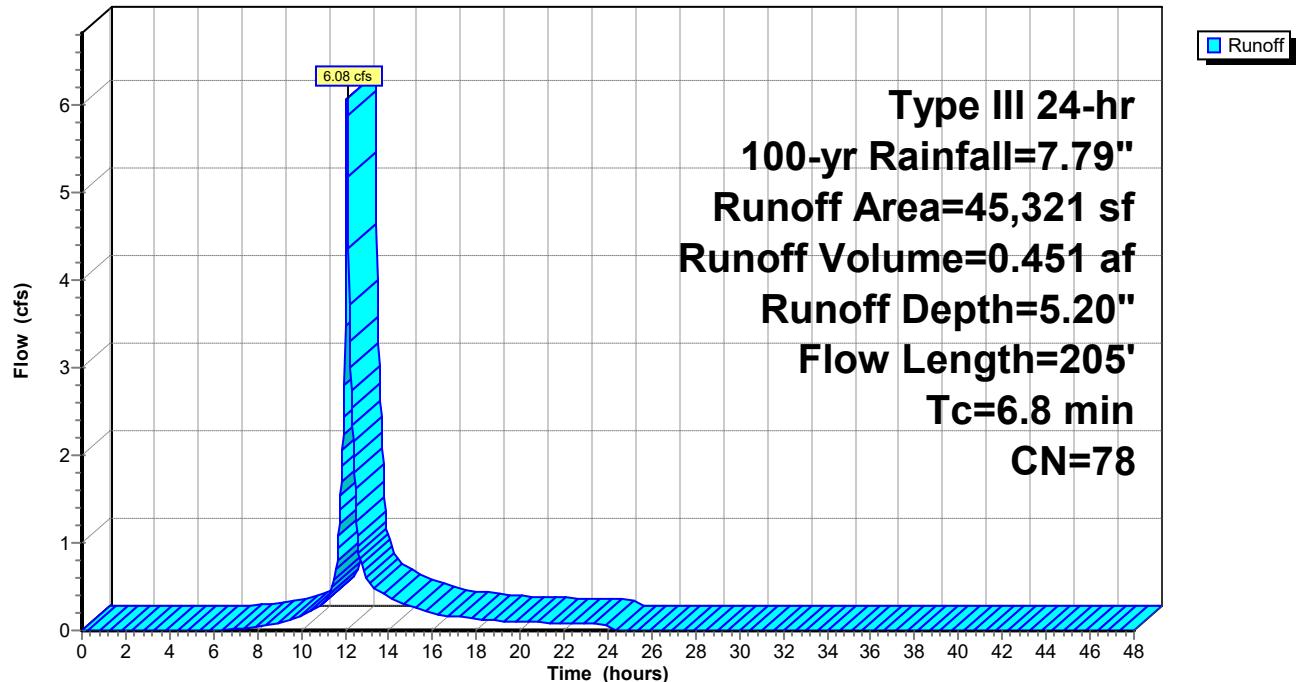

Summary for Subcatchment C2: PRWS-C2

Runoff = 0.65 cfs @ 12.09 hrs, Volume= 0.047 af, Depth= 4.74"
 Routed to Link 2L : C Total

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Type III 24-hr 100-yr Rainfall=7.79"


Area (sf)	CN	Description
557	73	Brush, Good, HSG D
3,991	80	>75% Grass cover, Good, HSG D
608	39	>75% Grass cover, Good, HSG A
5,156	74	Weighted Average
5,156		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	74	0.0610	0.26		Sheet Flow, Segment 1 Grass: Short n= 0.150 P2= 3.43"
4.8	74				Total, Increased to minimum Tc = 6.0 min



Subcatchment C2: PRWS-C2

Hydrograph

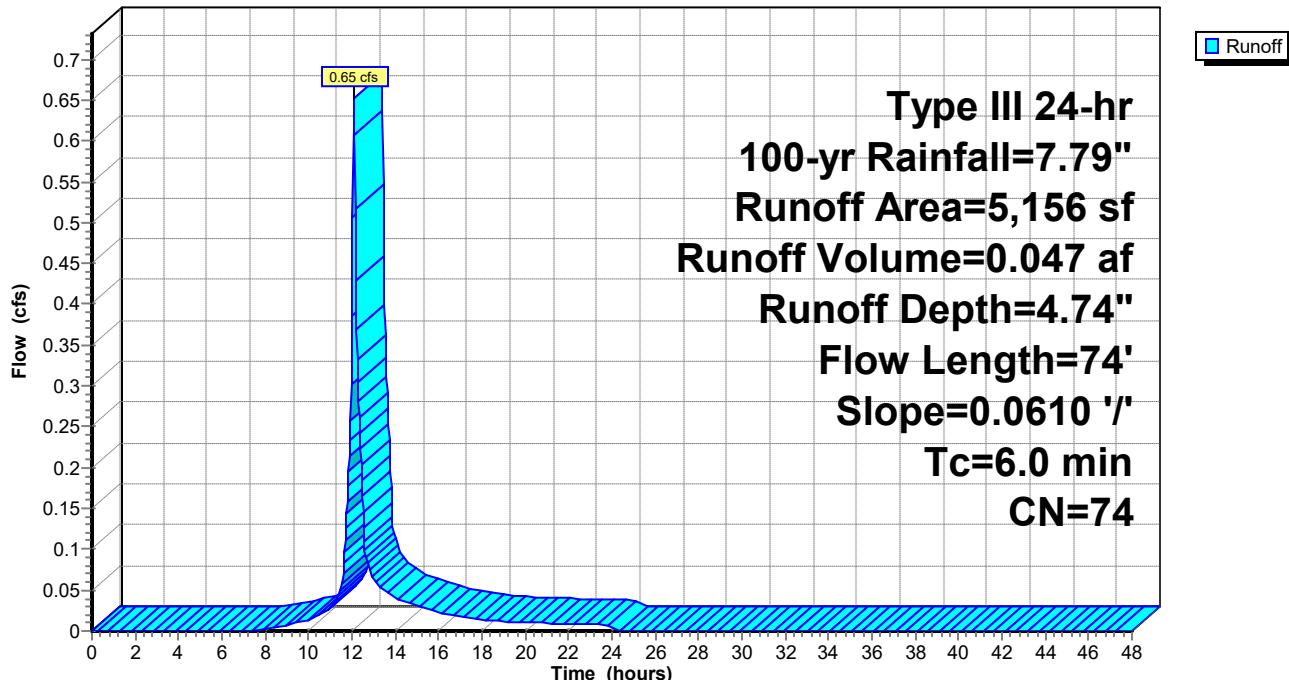

Summary for Pond P-C: Pond C

Inflow Area = 1.040 ac, 59.33% Impervious, Inflow Depth = 5.20" for 100-yr event
 Inflow = 6.08 cfs @ 12.10 hrs, Volume= 0.451 af
 Outflow = 5.20 cfs @ 12.15 hrs, Volume= 0.451 af, Atten= 15%, Lag= 3.2 min
 Discarded = 0.10 cfs @ 12.15 hrs, Volume= 0.153 af
 Primary = 2.60 cfs @ 12.15 hrs, Volume= 0.246 af
 Routed to Link 2L : C Total
 Secondary = 2.49 cfs @ 12.15 hrs, Volume= 0.052 af
 Routed to Link 2L : C Total

Routing by Stor-Ind method, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs
 Peak Elev= 32.47' @ 12.15 hrs Surf.Area= 4,467 sf Storage= 3,678 cf


Plug-Flow detention time= 92.1 min calculated for 0.450 af (100% of inflow)
 Center-of-Mass det. time= 92.3 min (901.5 - 809.3)

Volume	Invert	Avail.Storage	Storage Description	
#1	31.50'	6,050 cf	Custom Stage Data (Conic)	Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
31.50	3,128	0	0	3,128
32.50	4,507	3,797	3,797	4,524
33.00	4,507	2,254	6,050	4,643
Device	Routing	Invert	Outlet Devices	
#1	Discarded	31.50'	1.000 in/hr Exfiltration over Wetted area	
#2	Primary	30.50'	12.0" Round Culvert L= 30.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 30.50' / 30.20' S= 0.0100 '/' Cc= 0.900 n= 0.010, Flow Area= 0.79 sf	
#3	Device 2	32.00'	12.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads	
#4	Secondary	32.25'	10.0' long x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88	

Discarded OutFlow Max=0.10 cfs @ 12.15 hrs HW=32.47' (Free Discharge)
 ↑ 1=Exfiltration (Exfiltration Controls 0.10 cfs)


Primary OutFlow Max=2.60 cfs @ 12.15 hrs HW=32.47' (Free Discharge)
 ↑ 2=Culvert (Passes 2.60 cfs of 3.62 cfs potential flow)
 ↑ 3=Orifice/Grate (Orifice Controls 2.60 cfs @ 3.31 fps)

Secondary OutFlow Max=2.49 cfs @ 12.15 hrs HW=32.47' (Free Discharge)
 ↑ 4=Broad-Crested Rectangular Weir (Weir Controls 2.49 cfs @ 1.11 fps)

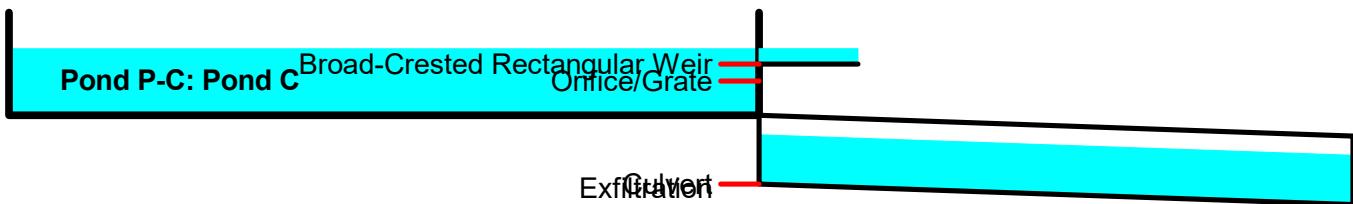

Pond P-C: Pond C

Hydrograph

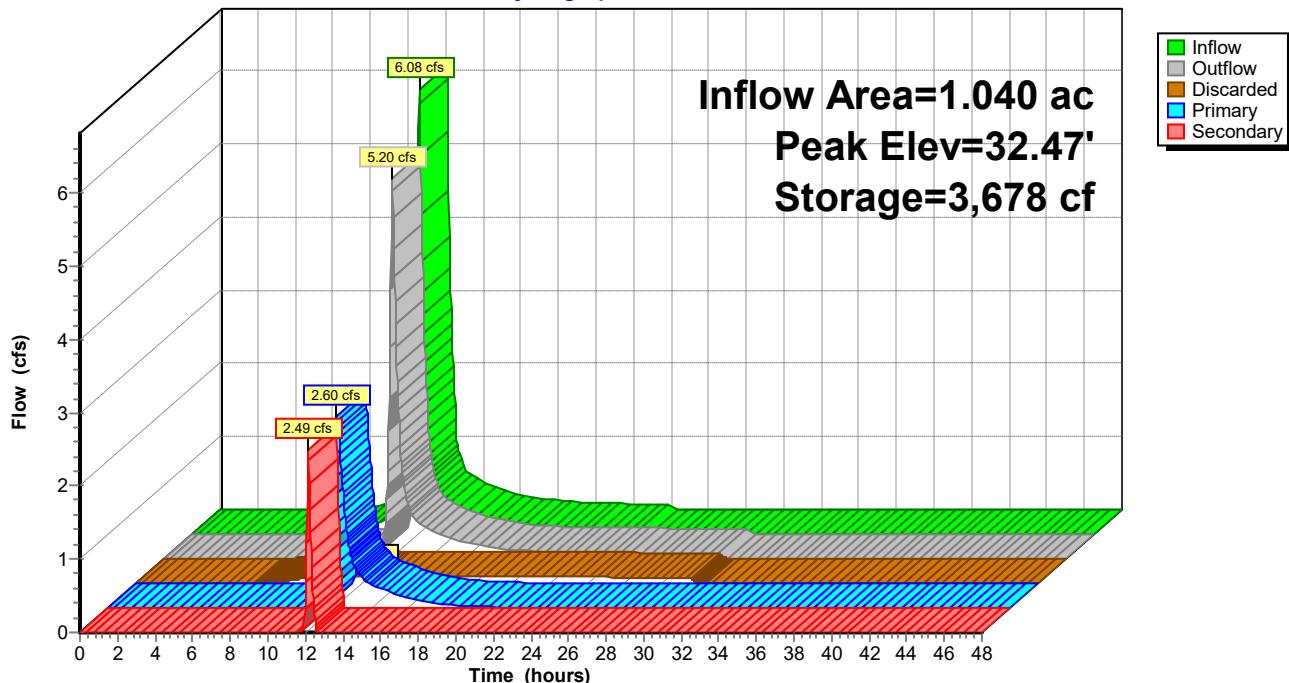

Stage-Discharge for Pond P-C: Pond C

Elevation (feet)	Discharge (cfs)	Discarded (cfs)	Primary (cfs)	Secondary (cfs)
31.50	0.00	0.00	0.00	0.00
31.55	0.07	0.07	0.00	0.00
31.60	0.08	0.08	0.00	0.00
31.65	0.08	0.08	0.00	0.00
31.70	0.08	0.08	0.00	0.00
31.75	0.08	0.08	0.00	0.00
31.80	0.08	0.08	0.00	0.00
31.85	0.08	0.08	0.00	0.00
31.90	0.08	0.08	0.00	0.00
31.95	0.09	0.09	0.00	0.00
32.00	0.09	0.09	0.00	0.00
32.05	0.20	0.09	0.11	0.00
32.10	0.42	0.09	0.32	0.00
32.15	0.69	0.09	0.60	0.00
32.20	1.01	0.09	0.92	0.00
32.25	1.38	0.10	1.28	0.00
32.30	2.05	0.10	1.69	0.26
32.35	2.97	0.10	2.13	0.74
32.40	3.85	0.10	2.39	1.36
32.45	4.73	0.10	2.54	2.09
32.50	5.75	0.10	2.67	2.97
32.55	6.89	0.11	2.80	3.98
32.60	8.13	0.11	2.93	5.09
32.65	9.48	0.11	3.05	6.32
32.70	10.97	0.11	3.16	7.70
32.75	12.57	0.11	3.28	9.19
32.80	14.30	0.11	3.38	10.81
32.85	16.14	0.11	3.49	12.55
32.90	17.82	0.11	3.59	14.12
32.95	19.55	0.11	3.69	15.75
33.00	21.33	0.11	3.78	17.44

Stage-Area-Storage for Pond P-C: Pond C

Elevation (feet)	Surface (sq-ft)	Wetted (sq-ft)	Storage (cubic-feet)
31.50	3,128	3,128	0
31.55	3,191	3,192	158
31.60	3,255	3,256	319
31.65	3,319	3,321	483
31.70	3,384	3,387	651
31.75	3,449	3,453	822
31.80	3,515	3,520	996
31.85	3,582	3,588	1,173
31.90	3,649	3,656	1,354
31.95	3,717	3,725	1,538
32.00	3,786	3,794	1,726
32.05	3,855	3,864	1,917
32.10	3,925	3,935	2,111
32.15	3,996	4,007	2,309
32.20	4,067	4,079	2,511
32.25	4,139	4,151	2,716
32.30	4,211	4,225	2,925
32.35	4,284	4,299	3,137
32.40	4,358	4,373	3,353
32.45	4,432	4,448	3,573
32.50	4,507	4,524	3,797
32.55	4,507	4,536	4,022
32.60	4,507	4,548	4,247
32.65	4,507	4,560	4,473
32.70	4,507	4,572	4,698
32.75	4,507	4,584	4,923
32.80	4,507	4,596	5,149
32.85	4,507	4,607	5,374
32.90	4,507	4,619	5,599
32.95	4,507	4,631	5,825
33.00	4,507	4,643	6,050


Summary for Link 2L: C Total

Inflow Area = 1.159 ac, 53.27% Impervious, Inflow Depth = 3.57" for 100-yr event
Inflow = 5.62 cfs @ 12.14 hrs, Volume= 0.345 af
Primary = 5.62 cfs @ 12.14 hrs, Volume= 0.345 af, Atten= 0%, Lag= 0.0 min
Routed to Link SITE : Total Site

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs

Link 2L: C Total


Hydrograph

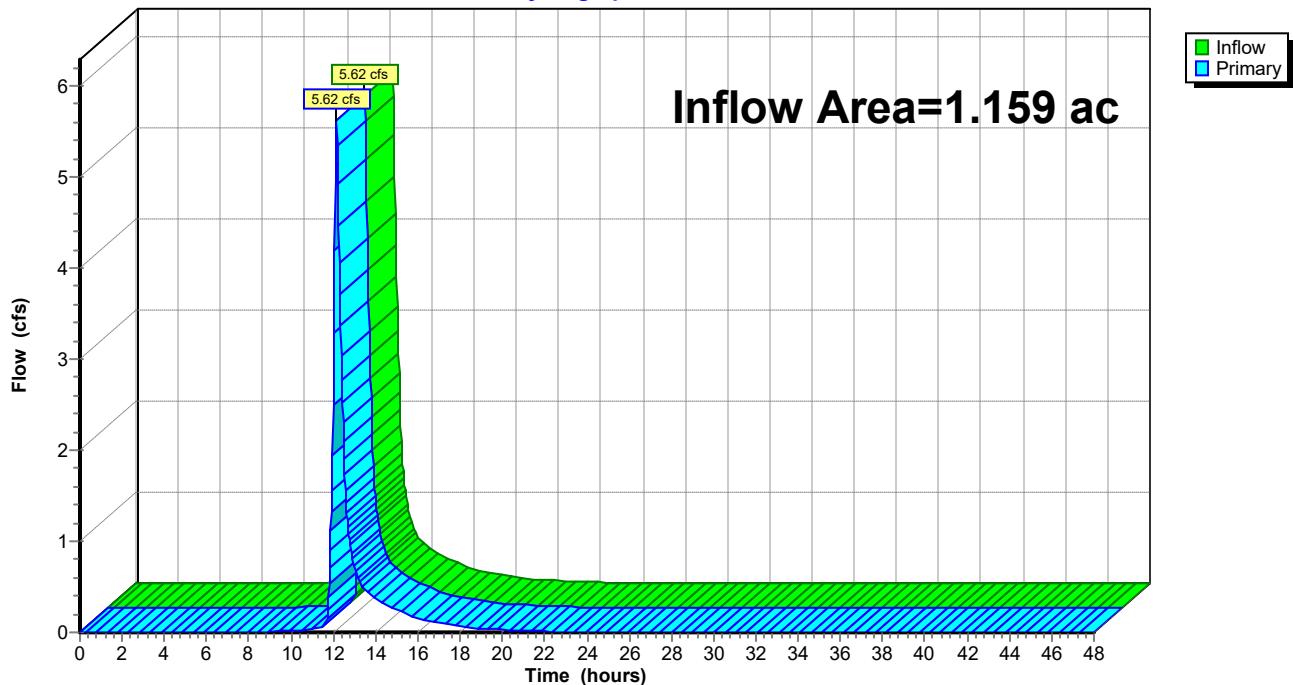

Summary for Link SITE: Total Site

Inflow Area = 1.620 ac, 45.14% Impervious, Inflow Depth = 3.35" for 100-yr event
Inflow = 6.93 cfs @ 12.13 hrs, Volume= 0.453 af
Primary = 6.93 cfs @ 12.13 hrs, Volume= 0.453 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-48.00 hrs, dt= 0.03 hrs

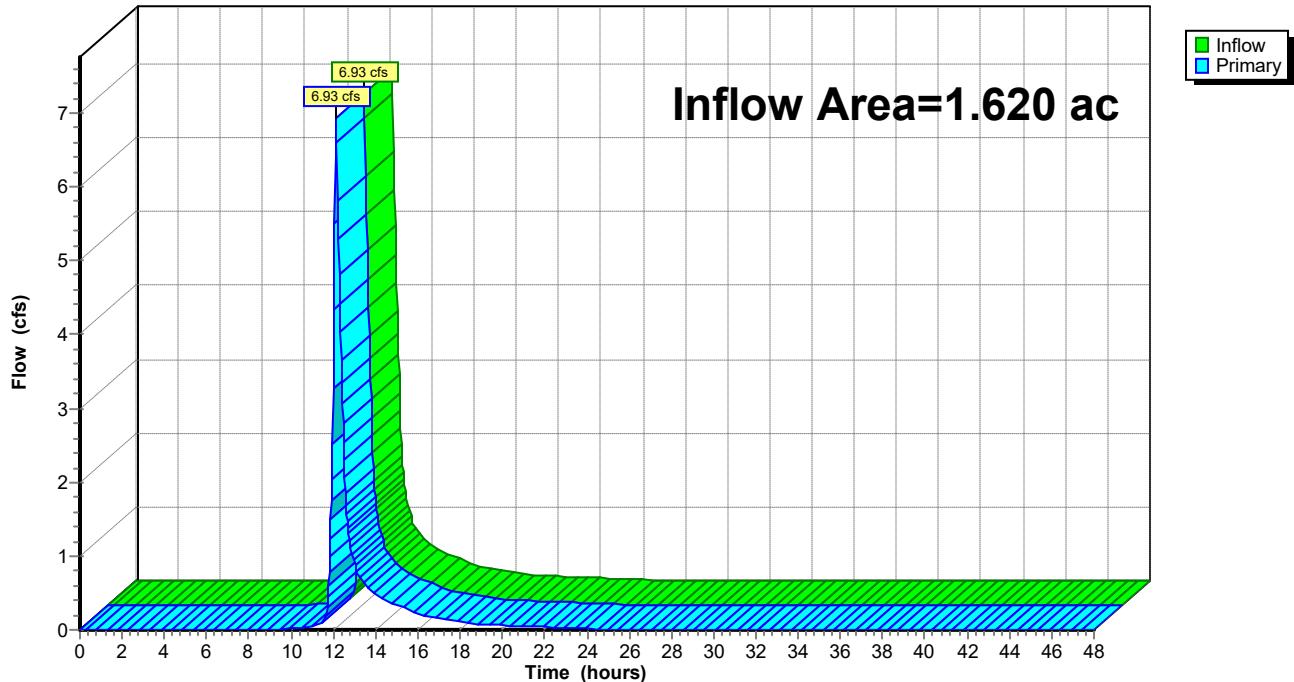Link SITE: Total Site**Hydrograph**

APPENDIX C
NOAA Rainfall Data

NOAA Atlas 14, Volume 10, Version 3 LAKE

KONOMOC

Station ID: 06-3989



Location name: Waterford, Connecticut, USA*

Latitude: 41.4°, Longitude: -72.1833°

Elevation:

Elevation (station metadata): 180 ft**

* source: ESRI Maps

** source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Sandra Pavlovic, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Orlan Wilhite

NOAA, National Weather Service, Silver Spring, Maryland

[PF tabular](#) | [PF graphical](#) | [Maps & aerials](#)

PF tabular

Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.337 (0.263-0.419)	0.403 (0.315-0.501)	0.511 (0.397-0.637)	0.601 (0.464-0.752)	0.724 (0.542-0.943)	0.816 (0.599-1.08)	0.914 (0.652-1.25)	1.03 (0.692-1.43)	1.19 (0.771-1.71)	1.32 (0.838-1.93)
10-min	0.478 (0.373-0.593)	0.571 (0.446-0.710)	0.724 (0.563-0.903)	0.851 (0.658-1.07)	1.03 (0.768-1.34)	1.16 (0.848-1.53)	1.30 (0.924-1.78)	1.45 (0.979-2.02)	1.68 (1.09-2.41)	1.88 (1.19-2.74)
15-min	0.562 (0.439-0.698)	0.672 (0.524-0.835)	0.852 (0.662-1.06)	1.00 (0.774-1.25)	1.21 (0.904-1.57)	1.36 (0.999-1.81)	1.52 (1.09-2.09)	1.71 (1.15-2.38)	1.98 (1.28-2.84)	2.21 (1.40-3.22)
30-min	0.795 (0.620-0.986)	0.950 (0.741-1.18)	1.20 (0.936-1.50)	1.42 (1.09-1.77)	1.70 (1.28-2.22)	1.92 (1.41-2.55)	2.15 (1.53-2.95)	2.41 (1.63-3.36)	2.79 (1.81-4.00)	3.11 (1.97-4.53)
60-min	1.03 (0.802-1.27)	1.23 (0.957-1.52)	1.56 (1.21-1.94)	1.83 (1.41-2.29)	2.20 (1.65-2.87)	2.48 (1.82-3.29)	2.78 (1.98-3.81)	3.12 (2.10-4.34)	3.60 (2.34-5.17)	4.01 (2.54-5.85)
2-hr	1.35 (1.06-1.67)	1.61 (1.27-1.99)	2.04 (1.60-2.53)	2.40 (1.87-2.98)	2.89 (2.18-3.73)	3.25 (2.41-4.29)	3.64 (2.62-4.96)	4.10 (2.77-5.65)	4.76 (3.10-6.77)	5.32 (3.38-7.69)
3-hr	1.57 (1.24-1.93)	1.87 (1.48-2.30)	2.37 (1.86-2.92)	2.78 (2.17-3.44)	3.34 (2.53-4.30)	3.76 (2.80-4.94)	4.21 (3.04-5.72)	4.74 (3.22-6.50)	5.52 (3.60-7.80)	6.18 (3.94-8.87)
6-hr	2.00 (1.59-2.44)	2.38 (1.89-2.90)	2.99 (2.38-3.66)	3.51 (2.76-4.31)	4.21 (3.22-5.38)	4.74 (3.54-6.16)	5.30 (3.85-7.12)	5.96 (4.07-8.09)	6.93 (4.54-9.68)	7.75 (4.96-11.0)
12-hr	2.47 (1.99-2.99)	2.93 (2.35-3.56)	3.69 (2.95-4.48)	4.31 (3.43-5.27)	5.18 (3.98-6.56)	5.82 (4.38-7.50)	6.51 (4.75-8.65)	7.30 (5.01-9.82)	8.46 (5.58-11.7)	9.44 (6.06-13.3)
24-hr	2.89 (2.35-3.48)	3.45 (2.80-4.16)	4.37 (3.52-5.28)	5.13 (4.11-6.22)	6.17 (4.78-7.76)	6.95 (5.27-8.90)	7.79 (5.72-10.3)	8.76 (6.04-11.7)	10.2 (6.74-13.9)	11.4 (7.35-15.8)
2-day	3.24 (2.65-3.87)	3.91 (3.19-4.67)	5.00 (4.07-5.99)	5.90 (4.77-7.11)	7.15 (5.59-8.94)	8.08 (6.18-10.3)	9.08 (6.74-11.9)	10.3 (7.12-13.6)	12.1 (8.02-16.4)	13.6 (8.82-18.7)
3-day	3.51 (2.89-4.18)	4.24 (3.48-5.05)	5.42 (4.43-6.47)	6.40 (5.20-7.67)	7.75 (6.08-9.64)	8.75 (6.72-11.1)	9.83 (7.33-12.9)	11.1 (7.74-14.6)	13.1 (8.72-17.6)	14.8 (9.59-20.2)
4-day	3.77 (3.11-4.48)	4.53 (3.73-5.38)	5.77 (4.73-6.87)	6.80 (5.54-8.12)	8.21 (6.47-10.2)	9.26 (7.14-11.7)	10.4 (7.77-13.5)	11.8 (8.20-15.4)	13.8 (9.22-18.5)	15.6 (10.1-21.2)
7-day	4.50 (3.73-5.31)	5.32 (4.41-6.29)	6.67 (5.51-7.90)	7.79 (6.39-9.26)	9.34 (7.39-11.5)	10.5 (8.11-13.1)	11.7 (8.77-15.1)	13.2 (9.22-17.1)	15.3 (10.3-20.4)	17.2 (11.2-23.1)
10-day	5.21 (4.34-6.13)	6.07 (5.06-7.15)	7.48 (6.21-8.83)	8.66 (7.13-10.3)	10.3 (8.15-12.6)	11.5 (8.90-14.2)	12.8 (9.56-16.3)	14.2 (10.0-18.3)	16.4 (11.0-21.6)	18.2 (11.9-24.3)
20-day	7.40 (6.23-8.65)	8.33 (7.00-9.73)	9.83 (8.23-11.5)	11.1 (9.21-13.0)	12.8 (10.2-15.4)	14.1 (11.0-17.2)	15.5 (11.6-19.3)	16.9 (11.9-21.5)	18.8 (12.7-24.5)	20.3 (13.3-26.9)
30-day	9.24 (7.81-10.7)	10.2 (8.61-11.9)	11.8 (9.89-13.7)	13.1 (10.9-15.3)	14.8 (11.9-17.8)	16.2 (12.7-19.6)	17.6 (13.1-21.7)	18.9 (13.5-24.0)	20.7 (14.0-26.8)	22.0 (14.4-28.8)
45-day	11.5 (9.78-13.3)	12.5 (10.6-14.5)	14.2 (12.0-16.4)	15.5 (13.0-18.1)	17.4 (14.0-20.7)	18.9 (14.8-22.7)	20.3 (15.2-24.8)	21.6 (15.4-27.1)	23.1 (15.8-29.7)	24.2 (15.9-31.5)
60-day	13.4 (11.4-15.5)	14.4 (12.3-16.7)	16.2 (13.7-18.7)	17.6 (14.8-20.5)	19.6 (15.8-23.1)	21.2 (16.6-25.3)	22.6 (16.9-27.4)	23.9 (17.1-29.8)	25.3 (17.3-32.4)	26.2 (17.4-34.1)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).

Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values.

Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical



NOAA Atlas 14, Volume 10, Version 3
Location name: Waterford, Connecticut, USA*
Latitude: 41.4°, Longitude: -72.1833°

Elevation: 254 ft**

* source: ESRI Maps

** source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Sandra Pavlovic, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Orlan Wilhite

NOAA, National Weather Service, Silver Spring, Maryland

[PF tabular](#) | [PF graphical](#) | [Maps & aerials](#)

PF tabular

Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	4.04 (3.16-5.03)	4.84 (3.78-6.01)	6.13 (4.76-7.64)	7.21 (5.57-9.02)	8.69 (6.50-11.3)	9.79 (7.19-13.0)	11.0 (7.82-15.0)	12.3 (8.30-17.1)	14.3 (9.25-20.5)	15.9 (10.1-23.2)
10-min	2.87 (2.24-3.56)	3.43 (2.68-4.26)	4.34 (3.38-5.42)	5.11 (3.95-6.40)	6.16 (4.61-8.01)	6.94 (5.09-9.20)	7.77 (5.54-10.7)	8.72 (5.87-12.1)	10.1 (6.55-14.5)	11.2 (7.12-16.4)
15-min	2.25 (1.76-2.79)	2.69 (2.10-3.34)	3.41 (2.65-4.25)	4.00 (3.10-5.01)	4.83 (3.62-6.28)	5.44 (4.00-7.22)	6.10 (4.35-8.36)	6.84 (4.61-9.52)	7.92 (5.14-11.4)	8.82 (5.58-12.9)
30-min	1.59 (1.24-1.97)	1.90 (1.48-2.36)	2.41 (1.87-3.00)	2.83 (2.19-3.54)	3.41 (2.55-4.44)	3.85 (2.82-5.10)	4.30 (3.07-5.90)	4.83 (3.25-6.72)	5.59 (3.62-8.01)	6.21 (3.93-9.07)
60-min	1.03 (0.802-1.27)	1.23 (0.957-1.52)	1.56 (1.21-1.94)	1.83 (1.41-2.29)	2.20 (1.65-2.87)	2.48 (1.82-3.29)	2.78 (1.98-3.81)	3.12 (2.10-4.34)	3.60 (2.34-5.17)	4.01 (2.54-5.85)
2-hr	0.675 (0.532-0.833)	0.807 (0.634-0.995)	1.02 (0.800-1.26)	1.20 (0.934-1.49)	1.44 (1.09-1.87)	1.63 (1.20-2.14)	1.82 (1.31-2.48)	2.05 (1.39-2.82)	2.38 (1.55-3.38)	2.66 (1.69-3.84)
3-hr	0.523 (0.413-0.642)	0.623 (0.492-0.766)	0.788 (0.620-0.971)	0.925 (0.723-1.14)	1.11 (0.843-1.43)	1.25 (0.930-1.64)	1.40 (1.01-1.90)	1.58 (1.07-2.16)	1.84 (1.20-2.60)	2.06 (1.31-2.95)
6-hr	0.333 (0.265-0.406)	0.396 (0.315-0.484)	0.499 (0.396-0.612)	0.585 (0.461-0.719)	0.703 (0.536-0.898)	0.791 (0.591-1.03)	0.885 (0.642-1.19)	0.994 (0.679-1.35)	1.16 (0.759-1.62)	1.29 (0.827-1.84)
12-hr	0.205 (0.164-0.248)	0.243 (0.195-0.295)	0.306 (0.244-0.372)	0.358 (0.284-0.437)	0.429 (0.330-0.544)	0.483 (0.363-0.622)	0.540 (0.394-0.718)	0.605 (0.415-0.814)	0.702 (0.462-0.971)	0.783 (0.502-1.10)
24-hr	0.120 (0.097-0.145)	0.143 (0.116-0.173)	0.182 (0.146-0.219)	0.213 (0.171-0.259)	0.257 (0.199-0.323)	0.289 (0.219-0.370)	0.324 (0.238-0.428)	0.364 (0.251-0.486)	0.424 (0.280-0.580)	0.474 (0.306-0.659)
2-day	0.067 (0.055-0.080)	0.081 (0.066-0.097)	0.104 (0.084-0.124)	0.123 (0.099-0.148)	0.148 (0.116-0.186)	0.168 (0.128-0.214)	0.189 (0.140-0.248)	0.214 (0.148-0.282)	0.251 (0.167-0.340)	0.283 (0.183-0.389)
3-day	0.048 (0.040-0.058)	0.058 (0.048-0.070)	0.075 (0.061-0.089)	0.088 (0.072-0.106)	0.107 (0.084-0.133)	0.121 (0.093-0.153)	0.136 (0.101-0.178)	0.154 (0.107-0.202)	0.181 (0.121-0.244)	0.205 (0.133-0.280)
4-day	0.039 (0.032-0.046)	0.047 (0.038-0.056)	0.060 (0.049-0.071)	0.070 (0.057-0.084)	0.085 (0.067-0.106)	0.096 (0.074-0.121)	0.108 (0.080-0.141)	0.122 (0.085-0.160)	0.143 (0.096-0.192)	0.162 (0.105-0.220)
7-day	0.026 (0.022-0.031)	0.031 (0.026-0.037)	0.039 (0.032-0.047)	0.046 (0.038-0.055)	0.055 (0.043-0.068)	0.062 (0.048-0.077)	0.069 (0.052-0.089)	0.078 (0.054-0.101)	0.091 (0.061-0.121)	0.102 (0.066-0.137)
10-day	0.021 (0.018-0.025)	0.025 (0.021-0.029)	0.031 (0.025-0.036)	0.036 (0.029-0.042)	0.042 (0.033-0.052)	0.047 (0.037-0.059)	0.053 (0.039-0.067)	0.059 (0.041-0.076)	0.068 (0.045-0.090)	0.075 (0.049-0.101)
20-day	0.015 (0.012-0.018)	0.017 (0.014-0.020)	0.020 (0.017-0.023)	0.023 (0.019-0.027)	0.026 (0.021-0.032)	0.029 (0.022-0.035)	0.032 (0.024-0.040)	0.035 (0.024-0.044)	0.039 (0.026-0.051)	0.042 (0.027-0.055)
30-day	0.012 (0.010-0.014)	0.014 (0.011-0.016)	0.016 (0.013-0.019)	0.018 (0.015-0.021)	0.020 (0.016-0.024)	0.022 (0.017-0.027)	0.024 (0.018-0.030)	0.026 (0.018-0.033)	0.028 (0.019-0.037)	0.030 (0.020-0.040)
45-day	0.010 (0.009-0.012)	0.011 (0.009-0.013)	0.013 (0.011-0.015)	0.014 (0.012-0.016)	0.016 (0.012-0.019)	0.017 (0.013-0.020)	0.018 (0.014-0.022)	0.019 (0.014-0.025)	0.021 (0.014-0.027)	0.022 (0.014-0.029)
60-day	0.009 (0.007-0.010)	0.010 (0.008-0.011)	0.011 (0.009-0.013)	0.012 (0.010-0.014)	0.013 (0.010-0.016)	0.014 (0.011-0.017)	0.015 (0.011-0.019)	0.016 (0.011-0.020)	0.017 (0.012-0.022)	0.018 (0.012-0.023)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).

Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values.


Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical

APPENDIX D
Stormwater Collection System Calculations

Hydraflow Storm Sewers Extension for Autodesk® Civil 3D® Plan

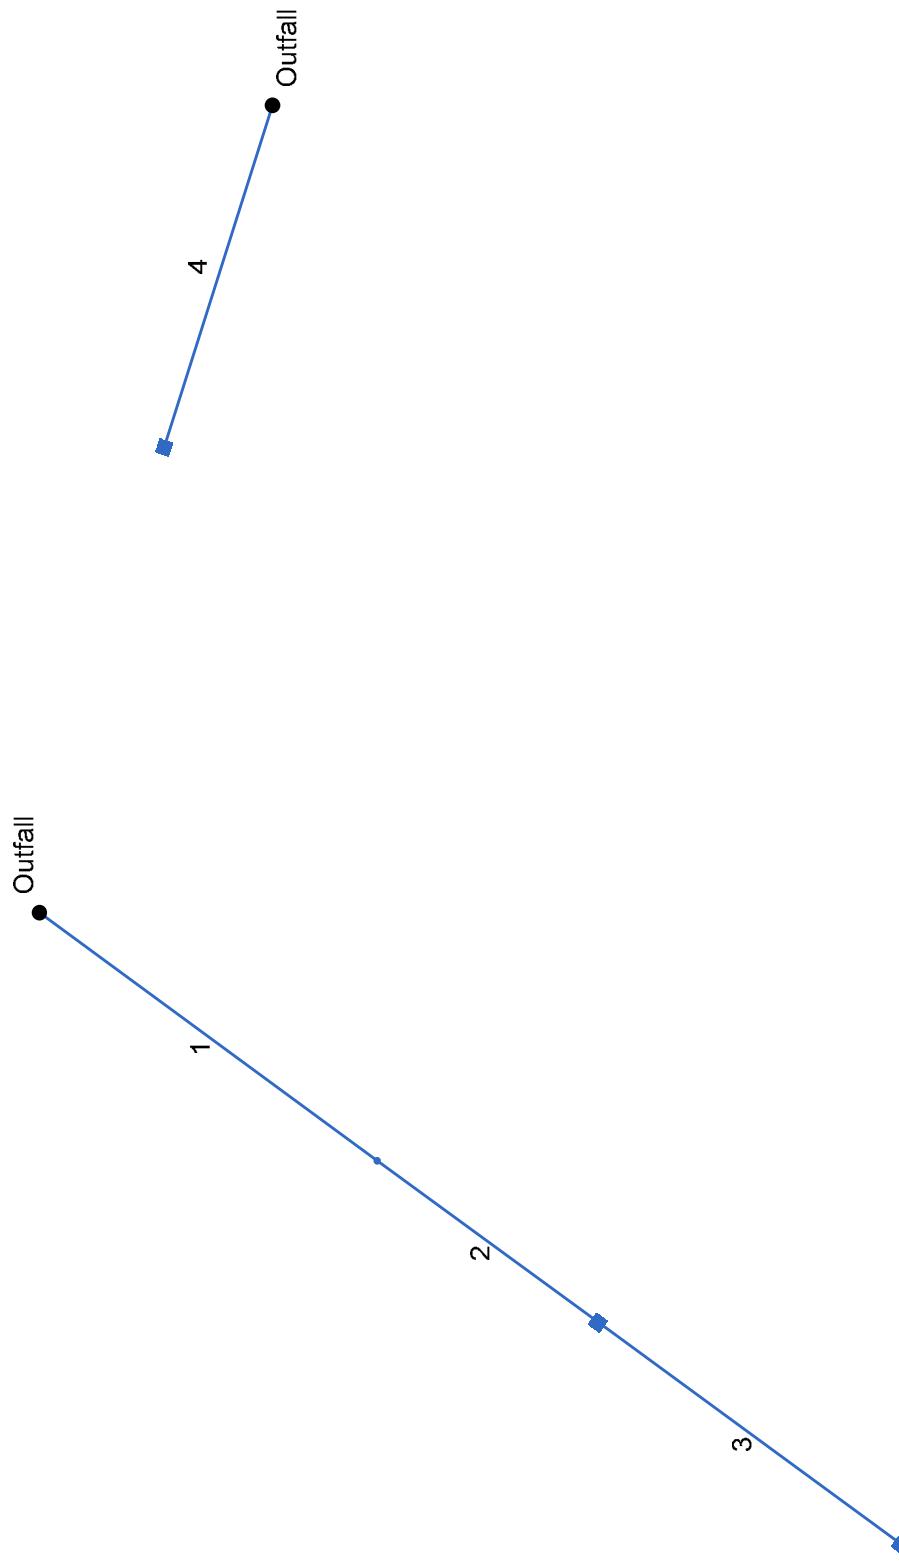

Project File: 2025-01-03 Stormsewers.stm

Number of lines: 4

Date: 1/5/2025

Storm Sewers v2024.00

Storm Sewer Tabulation

Station	Len	Drgn Area	Rnoff Area x C		Tc	Rain (I)	Total flow	Cap full	Vel	Pipe	Invert Elev		HGL Elev		Grnd / Rim Elev	Line ID						
Line	To Line	Incr	Total	Incr	Total	Inlet	Syst	Size	Slope (%)	Dn	Up	Dn	Up	Dn	Up (ft)							
1	End	60.389	0.00	0.34	0.00	0.00	0.24	0.0	6.5	6.5	1.56	4.83	8	1.46	31.50	32.38	32.08	32.96	32.64	35.52	CO-RG	
2	1	39.504	0.16	0.34	0.73	0.12	0.24	6.0	6.4	6.6	1.57	0.91	4.51	8	0.48	32.38	32.57	33.05	33.62	33.52	34.93	YD202-CO
3	2	54.194	0.18	0.18	0.68	0.12	0.12	6.0	6.0	6.8	0.83	0.92	2.37	8	0.50	32.57	32.84	33.78	33.99	34.93	34.94	YD203-YD202
4	End	51.616	0.00	0.00	0.00	0.00	0.00	0.0	0.0	0.0	2.32	0.93	6.68	8	0.50	30.24	30.50	30.88	32.42	30.81	32.50	BH201-OUTFALL
																Number of lines: 4		Run Date: 1/5/2025				

Project File: 2025-01-03 Stormsewers.stm

NOTES:Intensity = 29.47 / (Inlet time + 3.10) ^ 0.67; Return period =Yrs. 10 ; c = cir e = ellip b = box

APPENDIX E
Supporting Calculations

$$WQV = \frac{(P)(R)(A)}{12}$$

where:

WQV = water quality volume (cubic feet)

P = 1.3 inches (90th percentile rainfall event)

R = volumetric runoff coefficient = 0.05+0.009(*I*)

I = post- development impervious area (percent) after application of non-structural LID site planning and design strategies and before application of structural stormwater BMPs

A = post-development total drainage area of site or design point (square feet)

Project	140286501 - Oswegatchie Fire Station	Date	12/27/2024
Location	Waterford, CT	By	APF

PRWS-C

Area (SF) 45,321

Impervious (SF) 26,887

I 0.59

R 0.5839

WQV (CF) **2,867**

Project Oswegatchie Fire Station By APF Date 1/7/2024
 Location Waterford, CT Checked BP Date 1/7/2024
 Circle one: Present Developed Job No. 140281101

1. Rational 'C' Runoff Coefficient & Area Calculations

Catchment Area	Total Area		Impervious (C=.9)		Pervious (C=0.3)		Percent Impervious	C
	SF	AC	SF	AC	SF	AC		
YD-202	6,880	0.16	4,967	0.11	1,913	0.04	72%	0.73
YD-203	7,666	0.18	4,869	0.11	2,797	0.06	64%	0.68

APPENDIX F
Boring Logs (by others)

BORING LOGS

Barton & Loguidice, LLC

41 Sequin Drive

Glastonbury, CT 06033

Tel. (860) 633-8770 Fax (860) 633-5971

Project #: 3261,053,091 Sheet #: 1 of 1

Project: Osweagatchie Fire House
Phase: B-1
Location: Waterford CT

Boring #: B-1

B&L Personnel: PJM, CED	Drilling Rig: AMS 9520	Date Started: 6/20/24	Surface Elevation:
Drilling Contractor: Ground 1420	Auger/Core Diameter:	Date Completed:	Groundwater Depth at 0 Hours:
On-Site Drillers: Mark Lacoste	Hammer Wt. & Fall:	Sampling Method:	Groundwater Depth at _____ Hours:

Depth	Sample #	# of Blow Counts	Penetration/ Recovery	Sample Description	Sample Number
0			5/34"	0-17" SAND, fine, trace med sand trace coarse sand trace gravel, trace organics, brown no staining no odor	
				17"-34" SAND fine, trace silt, trace clay, trace med sand trace coarse sand, trace gravel, light brown no staining	
5			5/43"	init PID=0.0 Hspace PID=0.0 no odor	D-S 08488
				0-43" SAND medium fine sand trace coarse sand trace gravel, trace cobble light brown, no staining no odor	
10			5/5'	init PID=0.0 Hspace PID=0.0	
				D-S' SAND, fine, trace silt, trace med sand trace coarse sand trace gravel, trace cobble, light brown, w/ some orange and black mottling no staining no odor saturated @ ~13' BGS	
15				init PID=0.0 Hspace PID=0.0	
				end of boring	
20					
25					
30					

REMARKS-

located near generator UST

Proportions Used	Cohesionless Density		Cohesive Consistency
Trace	0 to 10%	0 - 10	0 - 4 Soft
Little	10 to 20%	10 - 30	Mod. Stiff
Some	20 to 35%	30 - 50	8 - 15 Stiff
And	35 to 50%	50+	15 - 30 Very Stiff

NOTES:Water Readings Represent Direct Observations at the Times Noted Above.
Samples will be Retained for 90 Days Unless Otherwise Requested.

Barton & Loguidice, LLC
 41 Sequin Drive
 Glastonbury, CT 06033
 Tel. (860) 633-8770 Fax (860) 633-5971

Project #: 3261,053,001 Sheet #: 10F1
 Project: Oswegatchie Fire House Boring #: B-2
 Location: Waterford CT

B&L Personnel:	PJM CED	Drilling Rig:	AMS 9520	Date Started:	6/29/24	Surface Elevation:
Drilling Contractor:	Ground H2O	Auger/Core Diameter:		Date Completed:		Groundwater Depth at 0 Hours:
On-Site Drillers:	ML	Hammer Wt. & Fall:		Sampling Method:		Groundwater Depth at _____ Hours:

Depth	Sample #	# of Blow Counts	Penetration/ Recovery	Sample Description	Sample Number
0		5/43'		0-43" SAND, fine, trace medium, trace coarse, trace gravel/ trace cobble, light brown no staining no odor	Sample 9-5, @0934
5		5/5'		init PID=0.0 Hspce PID=0.0 0-5' SAND fine some medium, trace coarse sand, + trace gravel, trace cobble light brown no staining no odor	
10		5/5'		init PID=0.0 Hspce PID=0.0 0-5' SAND fine, trace med sand, trace silt, trace coarse sand trace gravel, trace cobble, light brown, little orange mottling no staining no odor water @ ~ 13' BGS	
15				init PID=0.0 Hspce PID=0.0 end of boring	
20					
25					
30					

REMARKS: Moved over ~ 3' from
 initial boring due to defiller
 hitting steel & bailing down gradient
 of generator VS

Proportions Used	Cohesionless Density	Cohesive Consistency
Trace	0 to 10%	0 - 10 Loose
Little	10 to 20%	10 - 30 Med. Dense
Some	20 to 35%	30 - 50 Dense
And	35 to 50%	50+ Very Dense

NOTES:

Water Readings Represent Direct Observations at the Times Noted Above.
 Samples will be Retained for 90 Days Unless Otherwise Requested.

Barton & Loguidice, LLC

41 Sequin Drive

Glastonbury, CT 06033

Tel. (860) 633-8770 Fax (860) 633-5971

Project #: 3261,053,001

Sheet #:

1 of 1

Project: Osweagatchie Fire House

Phase II

Location: Waterford CT

Boring #:

B-3

B&L Personnel: PJM CED	Drilling Rig: AMS Q520	Date Started: 6/20/24	Surface Elevation:
Drilling Contractor: Ground H2O	Auger/Core Diameter:	Date Completed:	Groundwater Depth at 0 Hours:
On-Site Drillers: Munk Laramie	Hammer Wt. & Fall:	Sampling Method:	Groundwater Depth at _____ Hours:

Depth	Sample #	# of Blow Counts	Penetration/ Recovery	Sample Description	Sample Number
0			5'/32"	0-6" SAND fine trace med sand trace coarse sand trace organics dark brown 6"-2'6" GRAVEL, little fine sand trace med sand trace coarse sand trace gravel light brown no staining no odor init PID=0.0 Hspace PID=0.0	sample 0-5' collected @ 1007
5			5'/54"	0-32" SAND, medium, trace fine sand, trace coarse sand, trace gravel, trace cobble, light brown some orange mottling 32"-54" SAND, fine, trace medium sand trace coarse sand, trace gravel light brown no staining no odor init PID=0.0 Hspace PID=0.0	
10			5'/42"	0-8" SAND, fine trace med sand trace coarse sand light brown 8"-42" SAND, medium, some coarse sand, trace fine, trace gravel trace cobble light brown no staining no odor init PID=0.0 Hspace PID=0.0	
15				init PID=0.0 Hspace PID=0.0 water @ ~13' BGS end of boring	
20					
25					
30					

REMARKS-

Northern corner of site
off edge of driveway

Proportions Used	Cohesionless Density	Cohesive Consistency
Trace	0 to 10%	0 - 10 Loose
Little	10 to 20%	10 - 30 Med. Dense
Some	20 to 35%	30 - 50 Dense
And	35 to 50%	50+ Very Dense

NOTES:

Water Readings Represent Direct Observations at the Times Noted Above.
Samples will be Retained for 90 Days Unless Otherwise Requested.

Barton & Loguidice, LLC

41 Sequin Drive

Glastonbury, CT 06033

Tel. (860) 633-8770 Fax (860) 633-5971

Project #: Oneagashie Firehouse Sheet #: Lot 1

Project: 3261.053-001 I PLII

Boring #: B-4

Location: Watertown CT

B&L Personnel: <u>PJM/ced</u>	Drilling Rig: <u>AMS 9520</u>	Date Started: <u>6/20/24</u>	Surface Elevation:
Drilling Contractor: <u>Ground H₂O</u>	Auger/Core Diameter:	Date Completed:	Groundwater Depth at 0 Hours:
On-Site Drillers: <u>Mark Larasie</u>	Hammer Wt. & Fall:	Sampling Method:	Groundwater Depth at _____ Hours:

Depth	Sample #	# of Blow Counts	Penetration/ Recovery	Sample Description	Sample Number
0			<u>5 1/2"</u>	1-11" Sand, fine to medium sand, trace coarse sand, trace organics, trace gravel, dark brown	Sample @ 1113
5			<u>2' 1/8"</u>	11-32 Sand fine-medium, trace coarse, trace gravel, trace cobble, dark brown, little white Initial PID: 0.0 Headspace: 0.0	
			<u>3' 1/2"</u>	3' 1/2" Sand, coarse, trace medium, trace fine, trace gravel, light brown with orange + black mottling - concrete, ~2-3" medium-coarse sand, trace gravel, light	moist at ~9 ft
10				Initial PID: 0.0 Headspace: 0.0	
			<u>5' 1/4"</u>	- sand fine-medium, trace coarse sand, trace gravel, trace cobble, light brown with red orange mottle, saturated, no odor, no obvious stain	
15				Initial PID: 0.0 Headspace: 0.0 end of boring	
20					
25					
30					

REMARKS-	Proportions Used	Cohesionless Density	Cohesive Consistency
located @ UST grave along eastern edge of site concrete @ ~7-8' BGS (possible dead man)	Trace	0 to 10% 0 - 10 Loose	0 - 4 Soft
	Little	10 to 20% 10 - 30 Med. Dense	4 - 8 Mod. Stiff
	Some	20 to 35% 30 - 50 Dense	8 - 15 Stiff
	and	35 to 50% 50+ Very Dense	15 - 30 Very Stiff

NOTES:

Water Readings Represent Direct Observations at the Times Noted Above.

Samples will be Retained for 90 Days Unless Otherwise Requested.

Barton & Loguidice, LLC

41 Sequin Drive

Glastonbury, CT 06033

Tel. (860) 633-8770 Fax (860) 633-5971

Project #: 3261,053,021 Sheet #: 1 of 1

Project: Omega Tech Fire Hawk Phase II

Boring #: B-5 / B-7

Location: Waterford CT

B&L Personnel: <u>PJM / LED</u>	Drilling Rig: <u>AMS 9520</u>	Date Started: <u>6/30/24</u>	Surface Elevation:
Drilling Contractor: <u>Ground Tech</u>	Auger/Core Diameter:	Date Completed:	Groundwater Depth at 0 Hours:
On-Site Drillers: <u>Marques Pararie</u>	Hammer Wt. & Fall:	Sampling Method:	Groundwater Depth at _____ Hours:

Depth	Sample #	# of Blow Counts	Penetration/ Recovery	Sample Description	Sample Number
0			5/38"	0-9" top soil, fine sand, trace medium coarse, trace gravel, trace organic, dark brown, weathering nodules	B-5 Sample @ 11:47
				7-38" fine sand, trace clay, trace silt, trace medium sand, trace coarse sand, trace gravel, dark brown, weathering nodules	B-7 Sample @ 11:49
5				Initial PID: 0:0 Headspace: 0.0	
			5/46"	0-9" Sand fine, trace coarse + medium sand, light brown, orange + red mottling Water ~ 7ft BGS	
10				Initial PID: 0:0 Headspace: 0.0	
			5/51"	0-40" medium sand, trace fine + coarse sand, trace gravel, trace silt, trace clay, light brown	
				40-49" fine sand, trace medium + coarse sand, trace gravel initial PID: 0:0 Headspace: 0.0	Saturated
15					
20					
25					
30					

REMARKS:

boring near concrete structures on
eastern boundary

Proportions Used		Cohesionless Density		Cohesive Consistency
Trace	0 to 10%	0 - 10	Loose	0 - 4 Soft
Little	10 to 20%	10 - 30	Med. Dense	4 - 8 Mod. Stiff
Some	20 to 35%	30 - 50	Dense	8 - 15 Stiff
And	35 to 50%	50+	Very Dense	15 - 30 Very Stiff

NOTES:

Water Readings Represent Direct Observations at the Times Noted Above.

Samples will be Retained for 90 Days Unless Otherwise Requested.

Barton & Loguidice, LLC
 41 Sequin Drive
 Glastonbury, CT 06033
 Tel. (860) 633-8770 Fax (860) 633-5971

Project #: 3261.053 Sheet #: 10f1
 Project: Ossegatchie Firehouse Pt II Boring #: B-6
 Location: Waterford, CT

B&L Personnel: PJM / CED	Drilling Rig:	Date Started: 6/20/24	Surface Elevation:
Drilling Contractor: Ground H2O	Auger/Core Diameter:	Date Completed:	Groundwater Depth at 0 Hours:
On-Site Drillers: Larbie	Hammer Wt. & Fall:	Sampling Method:	Groundwater Depth at _____ Hours:

Depth	Sample #	# of Blow Counts	Penetration/ Recovery	Sample Description	Sample Number
0			5'/34"	0-3" brown topsoil, fine sand, trace medium/coarse sand, trace organics, 3"-4" gravel + cobbles, 8"-34" fine sand, trace silt, trace medium/coarse sand, trace gravel, no odor, no staining, moist ~4' 8" Initial 0.0 Headpace: 0.0	Sample @ 12:18
5			5'/31"	0-12 fine sand, trace medium/coarse, trace gravel, trace cobbles, dark brown/grey, saturated 12"-31" saturated, black, clay/organic, peat odor	
10			5'/42"	5"-silt+clay, trace cobbles, trace fine sand, saturated	
15				Initial: 0.0 Headpace: 0.0 End of boring	
20					
25					
30					

REMARKS-

East of shed corner, temp well

Proportions Used	Cohesionless Density		Cohesive Consistency
Trace	0 to 10%	0 - 10 Loose	0 - 4 Soft
Little	10 to 20%	10 - 30 Med. Dense	4 - 8 Mod. Stiff
Some	20 to 35%	30 - 50 Dense	8 - 15 Stiff
And	35 to 50%	50+ Very Dense	15 - 30 Very Stiff

NOTES:

Water Readings Represent Direct Observations at the Times Noted Above.
 Samples will be Retained for 90 Days Unless Otherwise Requested.

Barton & Loguidice, LLC
 41 Sequin Drive
 Glastonbury, CT 06033
 Tel. (860) 633-8770 Fax (860) 633-5971

Project #: 3261,053,001 Sheet #: 1 of 1
 Project: Oswegatchie Fire House
 Phase II
 Location: Waterford CT
 Boring #: B-8

B&L Personnel: <u>PJM/CED</u>	Drilling Rig: <u>ASM 9520</u>	Date Started: <u>6/20/24</u>	Surface Elevation:
Drilling Contractor: <u>Ground H2O</u>	Auger/Core Diameter:	Date Completed:	Groundwater Depth at 0 Hours:
On-Site Drillers: <u>Marcus Lacable</u>	Hammer Wt. & Fall:	Sampling Method:	Groundwater Depth at _____ Hours:

Depth	Sample #	# of Blow Counts	Penetration/ Recovery	Sample Description	Sample Number
0			51/31'	0-7" SAND fine trace med sand trace coarse sand trace organics, dark brown	
				7"-31" SAND fine trace med sand trace coarse sand trace gravel trace cobble brown no staining no odor	
5			15/17'	init PID=0.0 Hspace PID=0.0 sample 0-S ¹ collected @ 1254	
				0-17" SAND fine trace med sand trace coarse sand trace gravel, dark grey, saturated no staining no odor init PID=0.0 Hspace PID=0.0	
10				refusal @ ~6.5' BGS end of boring	
15					
20					
25					
30					

REMARKS- Located on eastern side of
detached garage near dump

Proportions Used	Cohesionless Density	Cohesive Consistency
Trace	0 to 10%	0 - 10 Loose
Little	10 to 20%	10 - 30 Med. Dense
Some	20 to 35%	30 - 50 Dense
And	35 to 50%	50+ Very Dense

NOTES:

Water Readings Represent Direct Observations at the Times Noted Above.
 Samples will be Retained for 90 Days Unless Otherwise Requested.

Barton & Loguidice, LLC

 41 Sequin Drive
 Glastonbury, CT 06033
 Tel. (860) 633-8770 Fax (860) 633-5971

 Project #: 3261.053

 Sheet #: Loft

 Project: Oneonta Fire House

 Location: Waterford LF Bl II Boring #: B-9

B&L Personnel:	<u>PJM / CED</u>	Drilling Rig:	Date Started:	Surface Elevation:
Drilling Contractor:	<u>Ground H2O</u>	Auger/Core Diameter:	Date Completed:	Groundwater Depth at 0 Hours:
On-Site Drillers:	<u>Larrie</u>	Hammer Wt. & Fall:	Sampling Method:	Groundwater Depth at _____ Hours:

Depth	Sample #	# of Blow Counts	Penetration/ Recovery	Sample Description	Sample Number
0			<u>5'/25"</u>	0-6" dark brown topsoil, fine sand, trace medium/coarse, trace organic	<u>Sample taken at 13:22</u>
				6"-21" fine sand, trace medium/coarse sand, trace gravel, light brown, dry	
				4'-5" concrete per driller Initial PID: 0.0 Headspace: 0.0	
5			<u>15'/14"</u>	21"-25" 0-14" fine sand, trace medium/coarse, trace cobbles, light brown, no stain, no odor	
				Initial PID: 0.0 Headspace: 0.0	
10				refusal at ~6.5' End of boring	
15					
20					
25					
30					

REMARKS-

 West of shed + south of concrete
 dumpster pad

Proportions Used	Cohesionless Density		Cohesive Consistency
Trace	0 to 10%	0 - 10	Loose
Little	10 to 20%	10 - 30	Med. Dense
Some	20 to 35%	30 - 50	Dense
And	35 to 50%	50+	Very Dense

NOTES:

 Water Readings Represent Direct Observations at the Times Noted Above.
 Samples will be Retained for 90 Days Unless Otherwise Requested.

• = 15' boring
∅ = 15' boring / 1" well.

B-3

3.5

10

10

1990-91

Subject Property

Approximate location of drum
and scrap material

AT&T Electrical Substation

TEMPORARY MONITORING WELL FIELD DATA SHEETS

Monitoring Well Field Data Sheet

B-1

Client/Project Name:	Location: <u>Osweigatchie Firehouse</u>	Project:
Sample #:	Well #: <u>mw-DW</u>	
Water Level Data		
Date: <u>7/15/24</u>	Water Column Height:	Diam. (in)
Weather: <u>Sunny 80°</u>	Correction Factor: <u>x</u>	0.3
Well Diameter: <u>in.</u>	Volume to Purge: <u>gal</u>	0.5
		2.0
		4.4
	Measured Depth	
Depth to Bottom	<u>19.55</u>	Measuring Device: Tape / Elec. Tape / Other
Depth to Water	<u>13.77</u>	Measuring Point: PVC / Top of Steel / Other
Water Column Height:	Comments:	

Well Condition

General Condition: Good / Fair / Requires Repair
Protective Casing: Steel / PVC Other
Casing Condition: Good / Rusty / Bent / Requires Repair
Concrete Collar: Good / Cracked / None / Requires Maintenance
Comments: 10:10
Ponding Near Well: Yes / No
Holes Observed Near Well: Yes / No
Water Between PVC and Casing: Yes / No
Lockable Cap: Yes / No
Lock Present: Yes / No

Purge Data

Start Time: _____ Purge Device: Bailer / Peristaltic Pump / Bladder Pump / Waterra _____
Finish Time: _____ Bailer Type: Stainless Steel / Teflon / PVC / _____
Pump Rate: _____ mL/pm (if appl.) Bailer Size: 2" / 1.05" / N/A _____
Elapsed Time: _____ min Equipment Decon: Office / Dedicated / Designated / Field _____
Volume Purged: _____ gal Well Recharge: Good / Moderate / Low Dry @ _____ gal
Comments: _____

Sample Data

Date: _____ Time: _____ Additional Comments: _____
Sampler: _____ Weather: _____
Sampling Device: Bailer / Pump / Other _____
Filtering Required: Yes / No Field Filtered: Yes / No
Filter Type: Pneumatic / Syringe / Other / N/A _____
Filter Field Decontaminated: Yes / No

Field Parameters

Sample Appearance / Description / Odor:

Monitoring Well Field Data Sheet

Client/Project Name:	Location: <u>Oswegeatchie Binkhouse</u>	Project:	
Sample #:		Well #: <u>MW-Tree</u>	
Water Level Data			
Date: <u>7/15/24</u>	Water Column Height:	Diam. (in)	Corr. Factor
Weather: <u>Sunny 80°</u>		1.5	0.3
Well Diameter: <u>in.</u>	Correction Factor: <u>x</u>	2	0.5
	Volume to Purge: <u>gal</u>	4	2.0
		6	4.4
Measured Depth			
Depth to Bottom	<u>16.38</u>	Measuring Device: Tape / Elec. Tape / Other	
Depth to Water	<u>10.37</u>	Measuring Point: PVC / Top of Steel / Other	
Water Column Height:		Comments:	

B-4

a/

B-5

Well Condition

General Condition: Good / Fair / Requires Repair
Protective Casing: Steel / PVC / Other
Casing Condition: Good / Rusty / Bent / Requires Repair
Concrete Collar: Good / Cracked / None / Requires Maintenance
Comments: 10:00
Ponding Near Well: Yes / No
Holes Observed Near Well: Yes / No
Water Between PVC and Casing: Yes / No
Lockable Cap: Yes / No
Lock Present: Yes / No

10:00

Purge Data

Start Time: _____ Purge Device: Bailey / Peristaltic Pump / Bladder Pump / Waterra _____
Finish Time: _____ Bailey Type: Stainless Steel / Teflon / PVC / _____
Pump Rate: _____ mL/pm (if appl.) Bailey Size: 2" / 1.05" / N/A _____
Elapsed Time: _____ min Equipment Decon: Office / Dedicated / Designated / Field
Volume Purged: _____ gal Well Recharge: Good / Moderate / Low Dry @ _____ gal
Comments: _____

Sample Data

Date: _____ Time: _____ Additional Comments: _____
Sampler: _____ Weather: _____
Sampling Device: Bailer / Pump / Other _____
Filtering Required: Yes / No _____ Field Filtered: Yes / No 
Filter Type: Pneumatic / Syringe / Other / N/A _____
Filter Field Decontaminated: Yes / No 

Field Parameters

Sample Appearance / Description / Odor:

Monitoring Well Field Data Sheet

Client/Project Name:	Location: <i>Osuggitchie Firehouse</i>	Project:	
Sample #:	Well #: <i>mw-sneel</i>		
Water Level Data			
Date: <i>7/15/24</i>	Water Column Height:	Diam. (in)	Corr. Factor
Weather: <i>Sunny SDS</i>		1.5	0.3
Well Diameter: <i>8</i> in.	Correction Factor: <i>x</i>	2	0.5
	Volume to Purge: <i>4</i> gal	4	2.0
		6	4.4
Measured Depth			
Depth to Bottom	<i>13.07</i>	Measuring Device: Tape / Elec. Tape / Other	
Depth to Water	<i>6.11</i>	Measuring Point: PVC / Top of Steel / Other	
Water Column Height:		Comments:	

B-6

Well Condition

General Condition: Good / Fair / Requires Repair
Protective Casing: Steel / PVC / Other
Casing Condition: Good / Rusty / Bent / Requires Repair
Concrete Collar: Good / Cracked / None / Requires Maintenance
Comments:
10:15

Ponding Near Well: Yes / No
Holes Observed Near Well: Yes / No
Water Between PVC and Casing: Yes / No
Lockable Cap: Yes / No
Lock Present: Yes / No

Purge Data

Start Time: _____ Purge Device: Bailer / Peristaltic Pump / Bladder Pump / Waterra _____
Finish Time: _____ Bailer Type: Stainless Steel / Teflon / PVC / _____
Pump Rate: _____ mL/pm (if appl.) Bailer Size: 2" / 1.05" / N/A
Elapsed Time: _____ min Equipment Decon: Office / Dedicated / Designated / Field
Volume Purged: _____ gal Well Recharge: Good / Moderate / Low Dry @ _____ gal
Comments: _____

Sample Data

Date: _____ Time: _____ Additional Comments: _____
Sampler: _____ Weather: _____
Sampling Device: Bailer / Pump / Other _____
Filtering Required: Yes / No _____ Field Filtered: Yes / No _____
Filter Type: Pneumatic / Syringe / Other / N/A _____
Filter Field Decontaminated: Yes / No _____

Field Parameters

Sample Appearance / Description / Odor:

APPENDIX G

Stormwater Management System Operation and Maintenance Plan

Operations and Maintenance Plan

*Oswegatchie Fire Station
Waterford, CT*

Scope:

The purpose of the Operations and Maintenance Plan is to ensure that the existing and proposed stormwater components installed at 441 Boston Post Road in Waterford, CT are maintained in operational condition throughout the life of the project. The service procedures associated with this plan shall be performed as required by the parties legally responsible for their maintenance.

Recommended Frequency of Service:

As further defined below, all stormwater components should be checked on a periodic basis and kept in full working order. Ultimately, the required frequency of inspection and service will depend on runoff quantities, pollutant loading, and clogging due to debris. At a minimum, we recommend that all stormwater components be inspected and serviced twice per year, once before winter begins and once during spring cleanup.

Qualified Inspector:

The inspections must be completed by an individual experienced in the construction and maintenance of stormwater drainage systems. If required by the town, the inspections must be completed by a professional engineer.

Service Procedures:

1. Catch Basins & Drainage Inlets:

- a. Catch basins and drainage inlets shall be completely cleaned of accumulated debris and sediments at the completion of construction.
- b. For the first year, catch basins and drainage inlets shall be inspected on a quarterly basis.
- c. Any accumulated debris within the catch basins/inlets shall be removed and any repairs as required.
- d. From the second year onward, visual inspections shall occur twice per year, once in the spring and once in the fall, after fall cleanup of leaves has occurred.
- e. Accumulated debris within the catch basins/inlets shall be removed and repairs made as required.
- f. Accumulated sediments shall be removed at which time they are within 12 inches of the invert of the outlet pipe.
- g. Any additional maintenance required per the manufacturer's specifications shall also be completed.

2. Storm Drainage Piping and Cleanouts:

- a. All storm drainage piping shall be completely flushed of debris and accumulated sediment at the completion of construction.
- b. Cleanouts shall be inspected and repaired on an annual basis.
- c. Unless system performance indicates degradation of piping, comprehensive video inspection of storm drainage piping shall occur once every ten years.
- d. Any additional maintenance required per the manufacturer's specifications shall also be completed.

3. Rain Gardens:

- a. Rain gardens shall be inspected annually. Inspect after every major storm (1 inch or more of precipitation) during the first three months of operation.
- b. Remove trash and organic debris in the Spring and Fall.
- c. Remove sediment from the rain garden when the sediment accumulation exceeds 1 inch or more when drawdown exceeds 48 hours after the end of a storm event.
- d. Periodically remove grass clippings to prevent clogging of the surface of the rain garden.

4. Drainage Swales:

- a. All drainage swales shall be completely cleaned of accumulated debris and sediments at the completion of construction.
- b. Spring through fall, mow grass to between 4 to 6 inches, remove grass clippings.
- c. Accumulated debris shall be removed and repairs made as required.
- d. Reseed any bare areas as needed.
- e. Inspect level spreaders twice per year and remove sediment as necessary.

Disposal of Debris and Sediment:

All debris and sediment removed from the stormwater structures and rain gardens shall be disposed of legally. There shall be no dumping of silt or debris into or in proximity to any inland or tidal wetlands.

Maintenance Records:

The Owners(s) must maintain all records (logs, invoices, reports, data, etc.) and have them readily available for inspection at all times.

Operations and Maintenance Log (Page 1 of 2)

Oswegatchie Fire Station
Waterford, CT

Type of Inspection: Spring Fall Other

Inspector's Name: _____ Date of Inspection: _____

Affiliation: _____ Phone #: _____

Catch Basins & Drainage Inlets:

- Has accumulated debris been removed from grates? Yes No N/A
- Do any basins require additional repair? (identify below): Yes No N/A
- Have sumps been cleaned of sediment? Yes No N/A

Notes:

Storm Drainage Piping and Cleanouts:

- Has accumulated debris been removed? Yes No N/A
- Do any cleanouts require additional repair? (identify below): Yes No N/A
- Is there any evidence of stormwater piping failure? Yes No N/A
- Has a comprehensive video inspection been completed? Yes No N/A

Notes:

Operations and Maintenance Log (Page 2 of 2)

*Oswegatchie Fire Station
Waterford, CT*

Rain Gardens:

- Has accumulated debris or sediment been removed? Yes No N/A
- Are any repairs required? (identify below): Yes No N/A
- Has accumulated grass clippings been removed? Yes No N/A

Notes:

Drainage Swales:

- Has accumulated debris been removed? Yes No N/A
- Do any swales require repair? (identify below): Yes No N/A
- Do swales need to be mowed? (spring through fall only) Yes No N/A
- Are there any bare areas? Yes No N/A

Notes:

Signature of Inspector:

Date: